





**5-594.9**  
5H0768560001

May, 2017

## INSTALLATION AND SERVICE MANUAL

### gas-fired indoor separated combustion duct furnaces/make-up air units models DBS/DCS

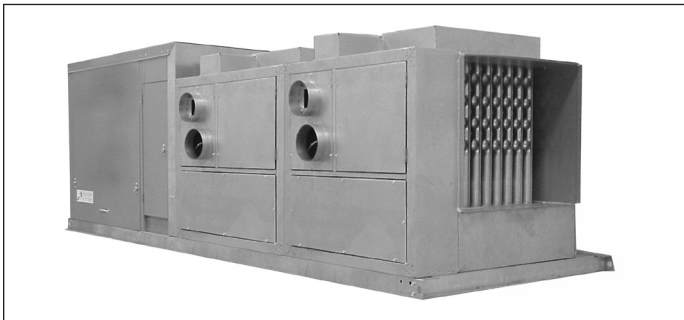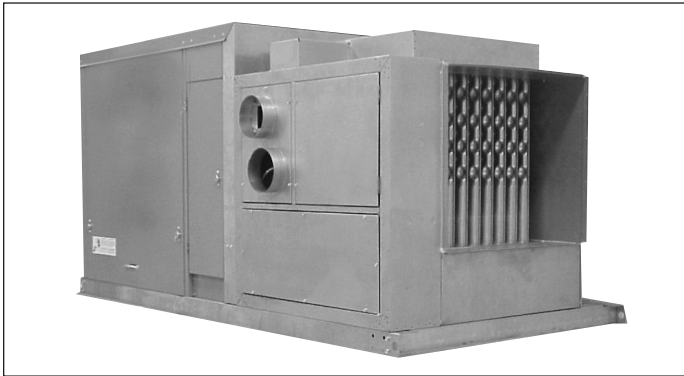

**Intertek**

DBS/DCS models approved for use in California by the CEC.

## **! CAUTION**

To prevent premature heat exchanger failure do not locate ANY gas-fired units in areas where chlorinated, halogenated, or acid vapors are present in the atmosphere.

## **FOR YOUR SAFETY**

### **IF YOU SMELL GAS:**

1. Open windows.
2. Don't touch electrical switches.
3. Extinguish any open flame.
4. Immediately call your gas supplier.

## **FOR YOUR SAFETY**

The use and storage of gasoline or other flammable vapors and liquids in open containers in the vicinity of this appliance is hazardous.

## **! WARNING**

1. Improper installation, adjustment, alteration, service or maintenance can cause property damage, injury or death, and could cause exposure to substances which have been determined by various state agencies to cause cancer, birth defects or other reproductive harm. Read the installation, operating and maintenance instructions thoroughly before installing or servicing this equipment.
2. Installing, starting up and servicing heating, ventilation and air conditioning equipment poses significant hazards and requires specialized knowledge of Modine products and training in performing those services. Failure to have any service properly performed by, or making any modification to Modine equipment without the use of, qualified service personnel could result in serious injury to person and property, including death. Therefore, only qualified service personnel should work on any Modine products.

### **Inspection on Arrival**

1. Inspect unit upon arrival. In case of damage, report it immediately to transportation company and your local factory sales representative.
2. Check rating plate on unit to verify that power supply meets available electric power at the point of installation.
3. Inspect unit upon arrival for conformance with description of product ordered (including specifications where applicable).

THIS MANUAL IS THE PROPERTY OF THE OWNER.  
PLEASE BE SURE TO LEAVE IT WITH THE OWNER WHEN YOU LEAVE THE JOB.

SPECIAL PRECAUTIONS / TABLE OF CONTENTS

SPECIAL PRECAUTIONS

THE INSTALLATION AND MAINTENANCE INSTRUCTIONS IN THIS MANUAL MUST BE FOLLOWED TO PROVIDE SAFE, EFFICIENT AND TROUBLE-FREE OPERATION. IN ADDITION, PARTICULAR CARE MUST BE EXERCISED REGARDING THE SPECIAL PRECAUTIONS LISTED BELOW. FAILURE TO PROPERLY ADDRESS THESE CRITICAL AREAS COULD RESULT IN PROPERTY DAMAGE OR LOSS, PERSONAL INJURY, OR DEATH. THESE INSTRUCTIONS ARE SUBJECT TO ANY MORE RESTRICTIVE LOCAL OR NATIONAL CODES.

HAZARD INTENSITY LEVELS

- 1. **DANGER:** Indicates an imminently hazardous situation which, if not avoided, WILL result in death or serious injury.
- 2. **WARNING:** Indicates a potentially hazardous situation which, if not avoided, COULD result in death or serious injury.
- 3. **CAUTION:** Indicates a potentially hazardous situation which, if not avoided, MAY result in minor or moderate injury.
- 4. **IMPORTANT:** Indicates a situation which, if not avoided, MAY result in a potential safety concern.

 **DANGER**

Appliances must not be installed where they may be exposed to a potentially explosive or flammable atmosphere.

 **WARNING**

- 1. Gas fired heating equipment must be vented - do not operate unvented.
- 2. A built-in power exhauster is provided - additional external power exhausters are not required or permitted.
- 3. All field gas piping must be pressure/leak tested prior to operation. Never use an open flame. Use a soap solution or equivalent for testing.
- 4. Gas pressure to appliance controls must never exceed 14" W.C. (1/2 psi).
- 5. Disconnect power supply before making wiring connections to prevent electrical shock and equipment damage.
- 6. All appliances must be wired strictly in accordance with wiring diagram furnished with the appliance. Any wiring different from the wiring diagram could result in a hazard to persons and property.
- 7. Any original factory wiring that requires replacement must be replaced with wiring material having a temperature rating of at least 105°C.
- 8. To reduce the opportunity for condensation, the minimum sea level input to the appliance, as indicated on the serial plate, must not be less than 5% below the rated input, or 5% below the minimum rated input of dual rated units.
- 9. Ensure that the supply voltage to the appliance, as indicated on the serial plate, is not 5% greater than the rated voltage.
- 10. When servicing or repairing this equipment, use only Modine-approved service replacement parts. A complete replacement parts list may be obtained by contacting Modine Manufacturing Company. Refer to the rating plate on the appliance for complete appliance model number, serial number, and company address. Any substitution of parts or controls not approved by Modine will be at the owners risk.

 **CAUTION**

- 1. The concentric vent adapter box must be installed inside of the structure or building. Do not install this box on the exterior of a building or structure.
- 2. Purging of air from gas lines should be performed as described in ANSI Z223.1 - latest edition "National Fuel Gas Code", or in Canada in CAN/CGA-B149 codes.
- 3. Ensure that the supply voltage to the appliance, as indicated on the serial plate, is not less than the rated voltage.
- 4. Do not attempt to reuse ignition controllers which have been wet. Replace defective controller.

**IMPORTANT**

- 1. To prevent premature heat exchanger failure, do not locate ANY gas-fired appliances in areas where corrosive vapors (i.e. chlorinated, halogenated or acid) are present in the atmosphere.
- 2. To prevent premature heat exchanger failure, the input to the appliance, as indicated on the serial plate, must not exceed the rated input by more than 5%.
- 3. To prevent premature heat exchanger failure, observe heat exchanger tubes by looking at the heat exchanger through the field installed access openings in connecting ductwork in cooling package units or the unit access doors in blower package units. If the bottom of the tubes become red while blower and duct furnace are in operation, check to be sure the blower has been set to the proper rpm for the application. Refer to page 20 for Blower Adjustments.
- 4. Start-up and adjustment procedures should be performed by a qualified service agency.
- 5. To check most of the Possible Remedies in the trouble-shooting guide listed in Tables 53.1 and 54.1, refer to the applicable sections of the manual.

**Table of Contents**

|                                              |           |
|----------------------------------------------|-----------|
| Inspection on Arrival                        | 1         |
| Special Precautions                          | 2         |
| SI (Metric) Conversion Factors               | 3         |
| Unit Location                                | 3         |
| Combustible Material and Service Clearances  | 3         |
| Unit Lifting and Unit Mounting               | 4         |
| Duct Installation                            | 5         |
| Unit Installation                            | 5         |
| Venting                                      | 6         |
| Gas Connections                              | 12        |
| Considerations for Elevation                 | 14        |
| Electrical Connections                       | 15        |
| Cooling Coil Specifications and Installation | 16        |
| Start-Up Procedure                           | 18        |
| Pilot Burner and Main Burner Adjustment      | 18        |
| Blower Adjustment                            | 20        |
| Lubrication Recommendations                  | 20        |
| Damper Linkage Adjustment                    | 20        |
| Control Operating Sequence                   | 21        |
| Options                                      | 23        |
| General Performance Data                     | 31        |
| Pressure Drop and Blower Performance Data    | 33        |
| Blower Sheave Assembly Data                  | 37        |
| Dimensions Unit                              | 42        |
| Weights                                      | 50        |
| Maintenance                                  | 47        |
| Service & Troubleshooting                    | 49        |
| Model Designations                           | 51        |
| Start-Up Checklist                           | 53        |
| Model Nomenclature                           | 54        |
| Commercial Warranty                          | Back Page |

# SI (METRIC) CONVERSION FACTORS / UNIT LOCATION

## SI (METRIC) CONVERSION FACTORS

Table 3.1

| To Convert | Multiply By     | To Obtain           | To Convert          | Multiply By | To Obtain           |
|------------|-----------------|---------------------|---------------------|-------------|---------------------|
| "W.C.      | 0.24            | kPa                 | CFH                 | 1.699       | m <sup>3</sup> /min |
| psig       | 6.893           | kPa                 | Btu/ft <sup>3</sup> | 0.0374      | mJ/m <sup>3</sup>   |
| °F         | (°F-32) x 0.555 | °C                  | pound               | 0.453       | kg                  |
| inches     | 25.4            | mm                  | Btu/hr              | 0.000293    | kW/hr               |
| feet       | 0.305           | meters              | gallons             | 3.785       | liters              |
| CFM        | 0.028           | m <sup>3</sup> /min | psig                | 27.7        | "W.C.               |

## UNIT LOCATION

### DANGER

Appliances must not be installed where they may be exposed to a potentially explosive or flammable atmosphere.

### IMPORTANT


To prevent premature heat exchanger failure, do not locate ANY gas-fired appliances in areas where corrosive vapors (i.e. chlorinated, halogenated or acid) are present in the atmosphere.

## Location Recommendations

- When locating the furnace, consider general space and heating requirements, availability of gas and electrical supply, and proximity to vent locations.
- Unit must be installed on the positive pressure side of the circulating blower.
- Be sure the structural support at the unit location site is adequate to support the weight of the unit. For proper operation the unit must be installed in a level horizontal position.
- Do not install units in locations where the flue products can be drawn into the adjacent building openings such as windows, fresh air intakes, etc.
- Be sure that the minimum clearances to combustible materials and recommended service clearances are maintained. Units are designed for installation on non-combustible surfaces with the minimum clearances shown in Figure 3.1 and Table 3.2.
- Units installed downstream of refrigeration systems, or exposed to inlet air temperatures of 40°F or less, may experience condensation, therefore, provisions should be made for disposal of condensate. Means have been provided in the bottom pan of the unit to accommodate a condensate drain line connection flange.
- When locating units, it is important to consider that the combustion air and exhaust vent piping must be connected to the outside atmosphere. The maximum equivalent lengths are listed in Table 6.1 on page 6.
- In garages or other sections of aircraft hangars such as offices and shops which communicate with areas used for servicing or storage, keep the bottom of the unit at least 7" above the floor. In public garages, the unit must be installed in accordance with the Standard for Parking Structures NFPA #88A and the Standard for Repair Garages NFPA#88B. In Canada, installation of unit heaters in airplane hangars must be in accordance with the requirements of the enforcing authority, and in public garages in accordance with the current CAN/CGA-B149 codes.
- Do not install units in locations where gas ignition system is exposed to water spray, rain, or dripping water.

- All mechanical equipment generates some sound and vibration that may require attenuation. Libraries, private offices and hospital facilities will require more attenuation, and in such cases, an acoustical consultant may be retained to assist in the application. Locating the equipment away from the critical area is desirable within ducting limitations. Generally, a unit should be located within 15 feet of a primary support beam. Smaller deflections mean lesser vibration and noise transmission.

Figure 3.1 - Combustible Material Clearances

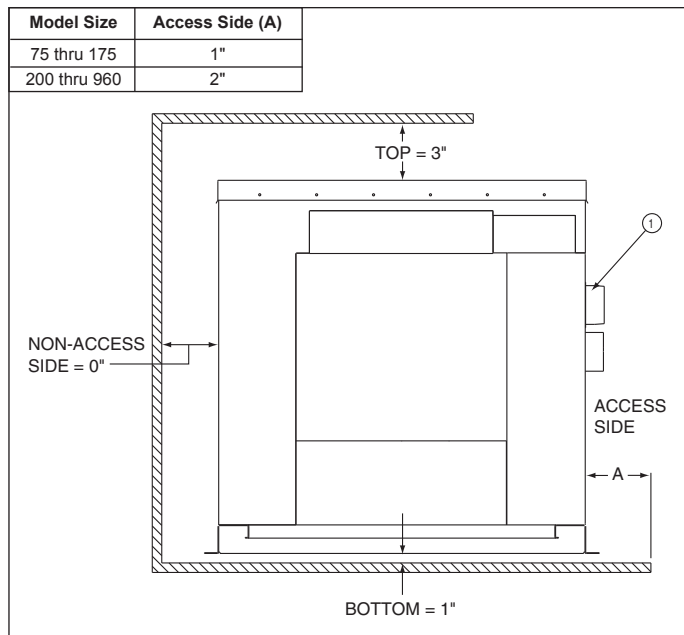

① A 3" minimum clearance to combustible material is required from the vent collar.

Table 3.2 - Recommended Service Clearances

| Model Size | Access Side | Non-Access Side | Top |
|------------|-------------|-----------------|-----|
| 75         | 18"         | 6"              | 10" |
| 100/125    | 20"         | 6"              | 10" |
| 150/175    | 25"         | 6"              | 10" |
| 200/225    | 27"         | 6"              | 10" |
| 250/300    | 30"         | 6"              | 10" |
| 350/400    | 41"         | 6"              | 10" |
| 500/600    | 30"         | 6"              | 10" |
| 700/800    | 41"         | 6"              | 10" |
| 840/960    | 41"         | 6"              | 10" |

# UNIT LIFTING / UNIT MOUNTING

## UNIT LIFTING

All standard blower system units are shipped fully crated with skid supports below the unit. The unit may be lifted from the bottom by means of a fork lift or other lifting device only if the shipping support skids are left in place. DO NOT attempt to lift the unit from the bottom unless the shipping skid supports are still in place. When lifting units, make sure the load is balanced. All extended cabinet systems are shipped without a crate and cannot be lifted with a fork truck. Use a crane or other overhead lifting device in conjunction with the lifting holes (refer to page 48 for base rail lifting hole locations) for safe unit relocation. If the unit must be lifted from the bottom for final installation of the unit be sure to properly support the unit over its entire length to prevent damage.


## UNIT MOUNTING

Be sure the method of unit support (suspension or floor mounting) is adequate to support the weight of the unit (see Weights for base unit and factory installed option weights). For proper operation, the unit must be installed in a level horizontal position. Combustible material and service clearances as specified in Figure 3.1 and Tables 3.2 and 3.3 must be strictly maintained. To assure that flames are directed into the center of the heat exchanger tubes, the unit must be level in a horizontal position. Use a spirit level to ensure that the unit is suspended or floor mounted correctly.

## Unit Suspension

Four 3/4" diameter suspension hanging locations are provided in the base rail assembly of the unit. Refer to Figure 48.1 for Suspension Hanging Locations and Figure 4.1 demonstrates how the unit should be suspended and fastened to the unit base rail. If required, vibration isolators may be added.

Figure 4.1 - Unit Suspension Method

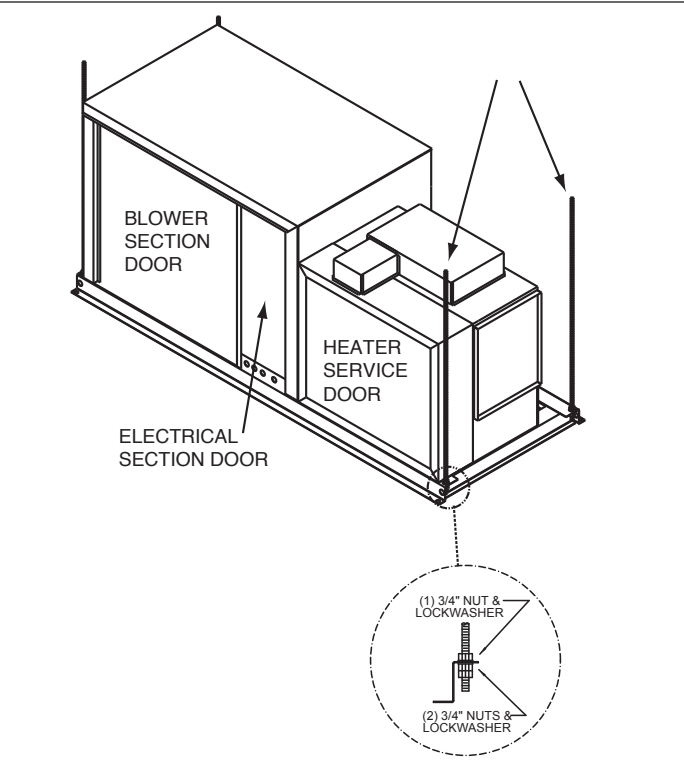

## Floor Mounted Units

For floor installations, the floor structure must be adequately designed to support the live weight load of the unit and any other required support structure. Additional reinforcement should be provided, if necessary. The floor should include threaded 5/8-inch anchor bolts spaced according to Figure 4.2 and Table 4.1, for securing the unit in place. Anchor bolts should extend at least 1-1/2" above the surface of the floor to allow clearance for mounting washers, nuts and bolts (mounting washers, nuts, and bolts by others).

Figure 4.2 - Floor Mounted Units

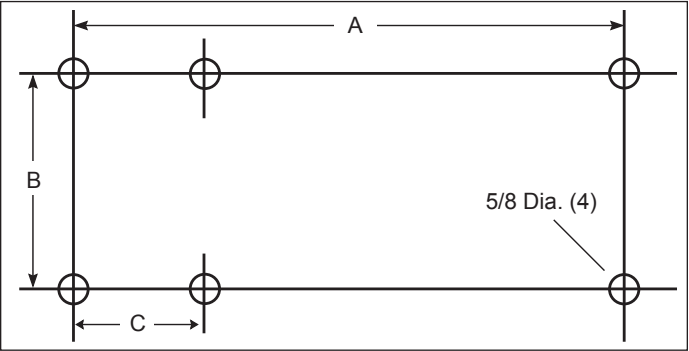


Table 4.1 - Floor Mounted Unit Anchor Bolt Dimensions (inches)


| Model Size | Blower Type (Digit 16) | DBS Units (A) | DCS Units (A) | All Units (B) | DBS Units (C) |
|------------|------------------------|---------------|---------------|---------------|---------------|
| 75         | All                    | 86.27         | 110.25        | 33.85         | -             |
| 100/25     | All                    | 86.37         | 110.25        | 36.36         | -             |
| 150/175    | All                    | 86.37         | 110.25        | 40.61         | -             |
| 200/225    | All                    | 86.37         | 110.25        | 42.71         | -             |
| 250/300    | E,F,G, or H            | 86.27         | 110.25        | 45.75         | -             |
| 250/300    | I,J, or K              | 112.12        | 146.10        | 45.75         | -             |
| 350/400    | E,F,G or H             | 86.27         | 110.25        | 57.27         | -             |
| 350/400    | I,J, or K              | 122.2         | 146.10        | 57.27         | -             |
| 500/600    | G or H                 | 127.39        | -             | 45.75         | 41.37         |
| 500/600    | I,J, or K              | 163.25        | -             | 45.75         | 41.37         |
| 700/800    | G or H                 | 127.39        | -             | 57.27         | 41.37         |
| 700/800    | I,J,K, or L            | 163.25        | -             | 57.27         | 41.37         |
| 840/960    | I,J,K, or L            | 204.39        | -             | 57.27         | 82.50         |

# DUCT INSTALLATION / UTILITY CONNECTIONS / UNIT INSTALLATION


## DUCT CONNECTION TO UNIT

1. The furnace discharge (units with Model Digit 2=B) is designed to accept straight ductwork (see Figure 5.1.). The blower section end and bottom openings (all units) and cooling cabinet section discharge (units with Model Digit 2=C) are designed to accept 90° flanged ductwork (see Figure 5.2). Provide an airtight seal between the ductwork and the furnace. Seams with cracks in the ductwork should be caulked and/or taped and be of permanent type. All duct connections **MUST** be airtight to prevent air leakage.
2. Provide uniform air distribution over the heat exchanger. Use turning vanes where required to obtain uniform air distribution. (See Figure 5.3).
3. Provide removable access panels on the downstream side of the ductwork. (See Figure 5.1.) This opening should be large enough to view smoke or reflect light inside the casing to indicate leaks in the heat exchanger and to check for hot spots on heat exchangers due to poor air distribution or lack of sufficient air (CFM).


**Figure 5.1 - Furnace Discharge Duct Connection**

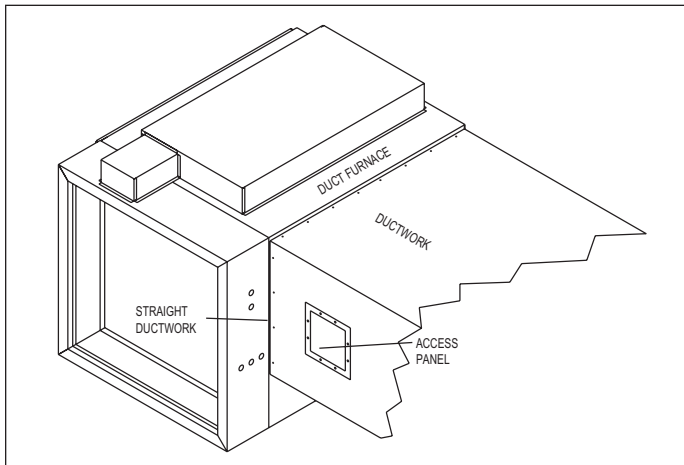

**Figure 5.2 - Blower Section Inlet and Cooling Coil Section Discharge Duct Connections**

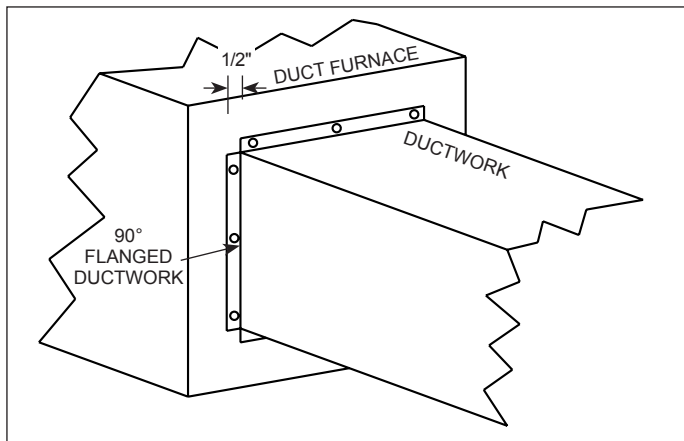

**Figure 5.3 - Recommended Field Installed Discharge Duct Configurations for Blower Package Units**

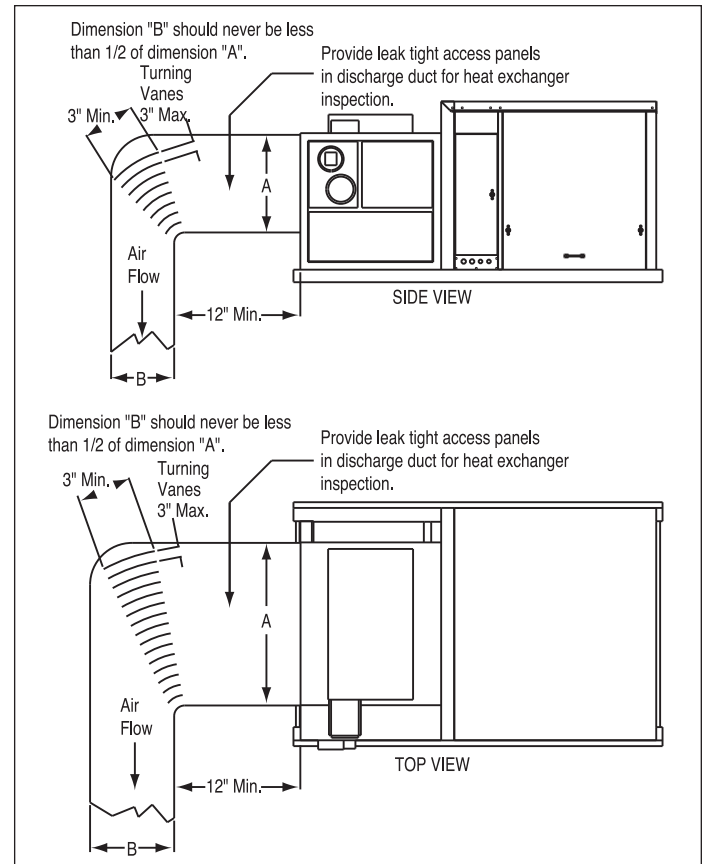

## Utility Connections

Utility and control connections can be made to the unit from the bottom or through the fixed side panels for floor mounted units. Holes can be made in fixed side panels to accommodate utility connections for any model or as specified according to the unit dimensional drawings. Seating of holes cut in the unit casing for utility connections should be done with care to prevent air leaks.

## Unit Installation

Follow site preparation instructions for Unit Mounting for applicable unit suspension or floor mounted units before installation. Check Model Identification Plate of unit with plans to be sure unit is properly located (See page 56). Also, inspect damper motors and dampers for proper type (e.g., two-position, modulating, fresh air only, fresh and return air, etc.). Although units may look outwardly similar, their function, capacities, options, and accessories will often vary. Check dimensions. Orient unit to its ductwork and suspend or floor mount unit. For proper operations, the unit must be installed in a level horizontal position.

Refer to the applicable sections to make Venting, Gas Connections, Electrical Connections, and Cooling Coil Connections. Make final unit connections to the electric power supply and remote control circuits. Connect the gas lines to the unit heating compartment in accordance with the submittal drawings and architect plans. Caulk all utility line clearance holes on the unit after connections are completed.

## INSTALLATION - VENTING

### WARNING

1. Gas fired heating equipment must be vented - do not operate unvented.
2. A built-in power exhauster is provided - additional external power exhausters are not required or permitted.
3. If you are replacing an existing heater, it may be necessary to resize the venting systems. Improperly sized venting systems can result in vent gas leakage or the formation of condensate. Refer to the National Fuel Gas Code ANSI Z223.1 or CSA B149.1 latest edition. Failure to follow these instructions can result in serious injury or death.
4. Under no circumstances should two sections of double wall vent pipe be joined together within one horizontal vent system due to the inability to verify complete seal of inner pipes.

### CAUTION

Installation must conform with local building codes or in the absence of local codes, with Part 7, Venting of Equipment, of the National Fuel Gas Code, ANSI Z223.1 (NFPA 54) - latest edition. In Canada installation must be in accordance with CSA B149.1.

Model DFS duct furnaces must be vented with the proper passageway as described in these instructions to convey flue gases from the unit or the vent connector to the outside atmosphere. The heaters must also have a separate combustion air intake pipe to bring in fresh air for combustion from the outside atmosphere.

The venting instructions are organized in sections, based on installation type. The sections are identified as follows:

| Section | Installation Instructions by Vent System Type            |
|---------|----------------------------------------------------------|
| A       | General Instructions for <b>ALL</b> installations        |
| B       | <b>VERTICAL 2-PIPE</b> vent systems ①                    |
| C       | <b>HORIZONTAL 2-PIPE</b> vent systems ①                  |
| D       | <b>HORIZONTAL AND VERTICAL CONCENTRIC</b> vent systems ① |

① The differences between Vertical and Horizontal vent systems in 2-Pipe or Concentric Vent configurations will be identified in "Section A - General Instructions - All Units".

## Section A - General Instructions - All Units

- A1. If the heater being installed is replacing existing equipment and using the existing vent system from that equipment, inspect the venting system for proper size and horizontal pitch, as required in the National Fuel Gas Code ANSI Z223.1 or CSA B149.1 Installation Code-latest edition and these instructions. Determine that there is no blockage or restriction, leakage, corrosion and other deficiencies, which could cause an unsafe condition.
- A2. The combustion air and vent pipes should be galvanized steel or other suitable corrosion resistant material. Follow the National Fuel Gas Code for minimum thickness of vent material. The minimum thickness for connectors varies depending on the pipe diameter. Do not vent unit with PVC or other forms of plastic venting material.

- A3. All heaters come with factory installed vent and combustion air adapters for attaching the pipe to the heater. The pipe diameters are 4" for model sizes 75-175 and 6" for model sizes 200-400. All units are classified as Category III vented appliances, which defined by ANSI is positive pressure, non-condensing, and requires the vent system to be gastight. Attach the vent pipe to the adapter with 3 corrosion resistant screws. (Drill pilot holes through the vent pipe and adapter prior to screwing in place). Vent pipe must not be smaller than the connector size. Category III vent systems listed by a nationally recognized agency and matching the diameters specified may be used. Different brands of vent materials may not be intermixed.
- A4. Limit the total equivalent vent pipe length to a minimum of 5' and a maximum as shown in Table 6.1, making the vent system as straight as possible. Total equivalent vent pipe length must include elbows. The equivalent length of a 4" elbow is 5' and for a 6" elbow is 7'.


**Table 6.1 - Individual Total Equivalent Lengths for Combustion Air and Exhaust Vent Pipes**

| Model Size         | Minimum (ft) | Maximum (ft) |
|--------------------|--------------|--------------|
| 75                 | 5            | 48           |
| 100, 125, 150, 175 | 5            | 55           |
| 200, 225           | 5            | 70           |
| 250, 300           | 5            | 63           |
| 350, 400           | 5            | 70           |

- A5. A minimum of 12" straight pipe is recommended from the flue outlet before turns in the vent pipe.
- A6. Horizontal sections of vent and combustion air pipes are to be installed with a minimum downward slope from the appliance of 1/4 inch per foot and suspended securely from overhead structures at points not greater than 3' apart.
- A7. Fasten individual lengths of vent together with at least three corrosion resistant sheet metal screws.
- A8. Keep single wall vent pipe at least 6" from combustible materials. For double wall vent pipe, follow the vent pipe manufacturer's clearances to combustibles. The minimum distance from combustible materials is based on the combustible material surface not exceeding 160°F. Clearance from the vent pipe (or the top of the unit) may be required to be greater than 6" if heat damage other than fire could result (such as material distortion or discoloration).
- A9. Avoid venting through unheated space when possible. When venting does pass through an unheated space or if the unit is installed in an environment that promotes condensation, insulate runs greater than 5' to minimize condensation. Inspect for leakage prior to insulating and use insulation that is noncombustible with a rating of not less than 400°F. Install a tee fitting at the low point of the vent system and provide a drip leg with a clean out cap as shown in Figure 8.1.
- A10. When the vent passes through a combustible INTERIOR wall or floor, a metal thimble 4" greater than the vent diameter is necessary. If there is 6' or more of vent pipe in the open space between the appliance and where the vent pipe passes through the wall or floor, the thimble need only be 2" greater than the diameter of the vent pipe. If a thimble is not used, all combustible material must be cut away to provide 6" of clearance. Where authorities have jurisdiction type B vent may be used for the last section of vent pipe to maintain clearance to combustibles while passing through wall or floor. See Figure 7.1. Any material used to close the opening must be noncombustible.

# INSTALLATION - VENTING

**Figure 7.1 - Venting Through Combustible Roof or Wall**

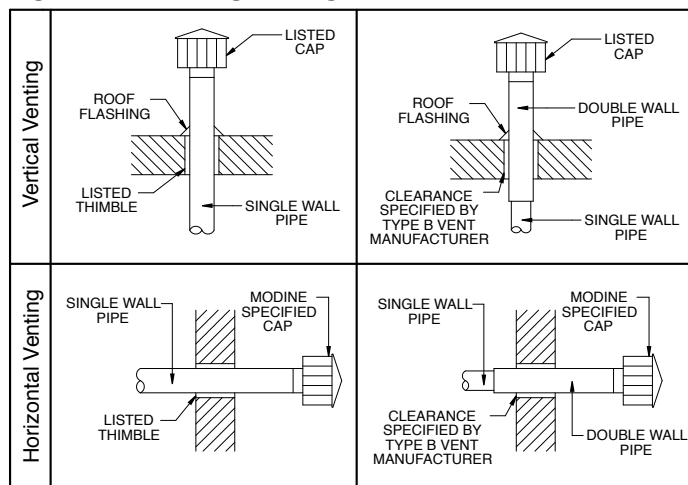

① See Instruction A12 for attaching single wall pipe to double wall pipe

- A11. All seams and joints of un-gasketed single wall pipe must be sealed with metallic tape (3M aluminum foil tapes 433 or 363 are acceptable) or silastic suitable for temperatures up to 400°F. Wrap the tape two full turns around the vent pipe. One continuous section of double wall vent pipe may be used within the vent system. Refer to instruction A12 in "Section A – General Instructions – All Units" for attaching double wall pipe to single wall pipe.
- A12. The following are General Instructions for Double Wall (Type B) Terminal Pipe Installation. Under no circumstances should two sections of double wall vent pipe be joined together within one horizontal vent system due to the inability to verify complete seal of inner pipes.

## How to attach a single wall vent terminal to double wall (type B) vent pipe:

1. Look for the "flow" arrow on the vent pipe.
2. Slide the vent terminal inside the exhaust end of the double wall vent pipe.
3. Drill (3) holes through the pipe and the vent terminal. Using 3/4" long sheet metal screws, attach the cap to the pipe. Do not over tighten.

## How to connect a single wall vent system to a double wall (type B) vent pipe:

1. Slide the single wall pipe inside the inner wall of the double wall pipe.
2. Drill (3) holes through both walls of the single and double wall vent pipes. Using 3/4" sheet metal screws, attach the two pieces of pipe. Do not over tighten.
3. The gap between the single and double wall pipe must be sealed but it is not necessary to fill the full volume of the annular area. To seal, run a large bead of 400°F silastic around the gap.

- A13 Do NOT vent this appliance into a masonry chimney.
- A14. Do NOT use dampers or other devices in the vent or combustion air pipes.
- A15. The venting system must be exclusive to a single appliance, and no other appliance is allowed to be vented into it.
- A16. Precautions must be taken to prevent degradation of building materials by flue products.
- A17. Single wall vent pipe must not pass through any unoccupied attic, inside wall, concealed space, or floor.
- A18. Uninsulated single wall vent pipe must not be used outdoors for venting appliances in regions where the 99% winter design temperature is below 32°F.

A19. Long runs of horizontal or vertical combustion air pipes may require insulation in very cold climates to prevent the buildup of condensation on the outside of the pipe where the pipe passes through conditioned spaces.

A20. Vent termination clearances must be maintained:

**Table 7.1 - Vent Termination Clearances**

| Structure                                                        | Minimum Clearances for Vent Terminal Location          |
|------------------------------------------------------------------|--------------------------------------------------------|
| Forced air inlet within 10 feet                                  | 3 feet above                                           |
| Combustion air inlet of another appliance                        | 6 feet all directions                                  |
| Door, window, gravity air inlet, or any building opening         | 4 feet horizontal and below<br>1 foot above            |
| Electric meter, gas meter, gas regulator, and relief equipment ① | 4 feet horizontal (U.S.)<br>6 feet horizontal (Canada) |
| Gas regulator ①                                                  | 3 feet horizontal (U.S.)<br>6 feet horizontal (Canada) |
| Adjoining building or parapet wall                               | 6 feet all directions                                  |
| Adjacent public walkways                                         | 7 feet all directions                                  |
| Grade (ground level)                                             | 3 feet above ②                                         |

① Do not terminate the vent directly above a gas meter or regulator.

② The vent must be at least 6" higher than anticipated snow depth.

- A21. Vertical combustion air pipes should be fitted with a tee with a drip leg and a clean out cap to prevent against the possibility of any moisture in the combustion air pipe from entering the unit. The drip leg should be inspected and cleaned out periodically during the heating season.
- A22. In addition to following these General Instructions, specific instructions for Vertical and Horizontal vent systems in 2-Pipe or Concentric Vent configurations must also be followed. The following outlines the differences:

## Vertical Vent System Determination


- Vertical vent systems terminate vertically (up) (an example is shown in Figure 8.1).
- Determine the venting configuration as follows:
  - > For two building penetrations through the wall or roof (one for the combustion air inlet pipe and one for the vent pipe), proceed to "Section B - Vertical 2-Pipe Venting".
  - > For a single larger building penetration through the wall or roof, through which both the combustion air inlet and vent pipes will pass, proceed to "Section D - Horizontal and Vertical Concentric Venting".
  - > For all other cases, proceed to the next section for Horizontal Vent System Determination.

## Horizontal Vent System Determination

- Horizontal vent systems terminate horizontally (sideways) (an example is shown in Figure 9.1).
- Determine the venting configuration as follows:
  - > For two building penetrations through the wall or roof (one for the combustion air inlet pipe and one for the vent pipe), proceed to "Section C - Horizontal 2-Pipe Venting".
  - > For a single larger building penetration through the wall or roof, through which both the combustion air inlet and vent pipes will pass, proceed to "Section D - Horizontal and Vertical Concentric Venting".

## Section B - Vertical 2-Pipe Vent System Installation


- ### Figure 8.1 - Vertical Venting - 2 Pipes Sloped Roof

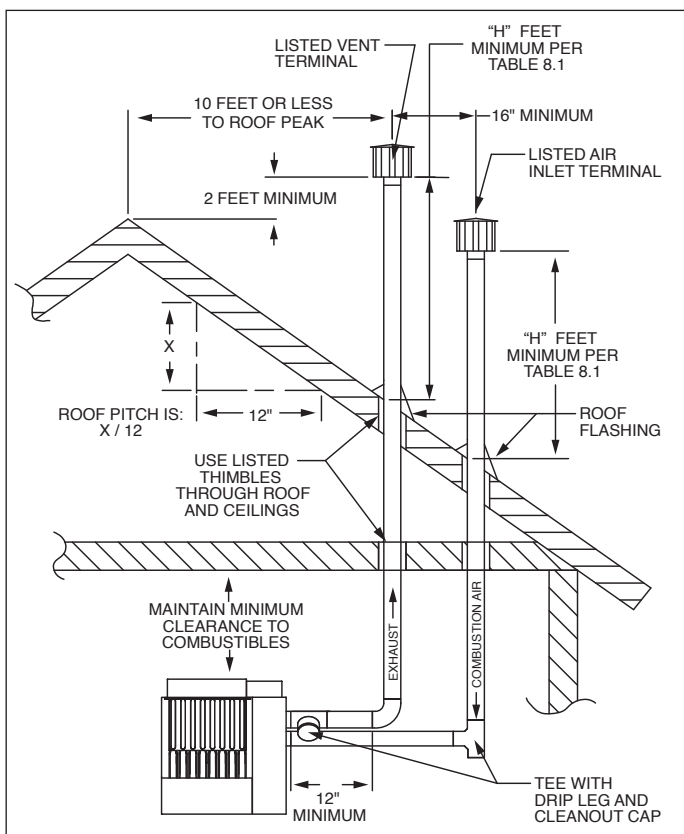

### Table 8.1 - Minimum Height from Roof to Lowest Discharge Opening

| RooF Rise<br>"X" (in) | Equivalent<br>RooF Pitch | Minimum Height<br>"H" (ft) ① |
|-----------------------|--------------------------|------------------------------|
| 0-10                  | Flat to 10/12            | 3.00                         |
| 10-12                 | 10/12 to 12/12           | 4.00                         |
| 12-14                 | 12/12 to 14/12           | 5.00                         |
| 14-16                 | 14/12 to 16/12           | 6.00                         |
| 16-18                 | 16/12 to 18/12           | 7.00                         |
| 18-21                 | 18/12 to 21/12           | 8.00                         |

### Figure 8.2 - Vertical Venting - 2 Pipes Flat Roof

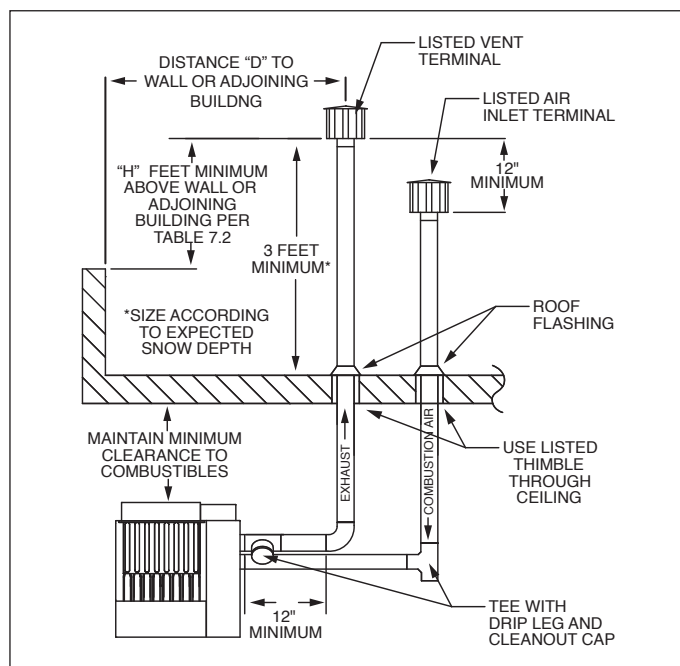

**Table 8.2 - Minimum Height Above Adjacent Wall  
Less than 10 Feet Away**


| "D"                  | "H"                           |
|----------------------|-------------------------------|
| 10 Feet or Less      | 2 Feet Minimum                |
| Greater than 10 Feet | No Additional Height Required |

## Section C - Horizontal 2-Pipe Vent System Installation

- C1. This section applies to horizontally vented 2-pipe vent systems (one combustion air inlet pipe and one vent pipe) and is in addition to “Section A - General Instructions - All Units”.
- C2. Horizontal vent systems terminate horizontally (sideways).
- C3. All horizontal vents must be terminated with a Modine part number:
  - 5H072285-0001 (Item Code 27866) for 4" vent pipe
  - 5H072285-0002 (Item Code 27868) for 6" vent pipeA Gary Steel 1092 cap is an acceptable alternate. The cap must terminate a minimum distance from the external wall, as summarized in Figure 9.1.
- C4. The termination of horizontally vented system must extend 12 inches beyond the exterior surface of an exterior wall.
- C5. The combustion air pipe must be a minimum of 16 inches below the vent pipe, and 24 inches from the exterior wall.
- C6. Construct the vent system as shown in Figure 9.1.


# INSTALLATION - VENTING

**Figure 9.1 - Horizontal 2-Pipe Venting**

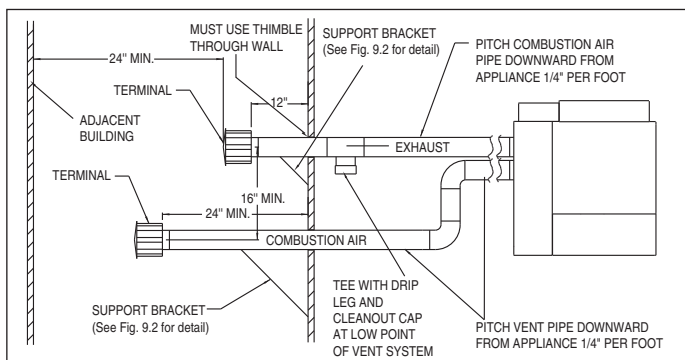

- C7. When horizontal vents pass through a combustible wall (up to 8 inches thick), the vent passage must be constructed and insulated as shown in Figure 9.2.
- C8. The vent must be supported as shown in Figure 9.2.
- C9. When condensation may be a problem, the vent system shall not terminate over public walkways or over an area where condensate or vapor could create a nuisance or hazard or could be detrimental to the operation of regulators, relief openings, or other equipment.

**Figure 9.2 - Exhaust Vent Construction Through Combustible Walls and Support Bracket**

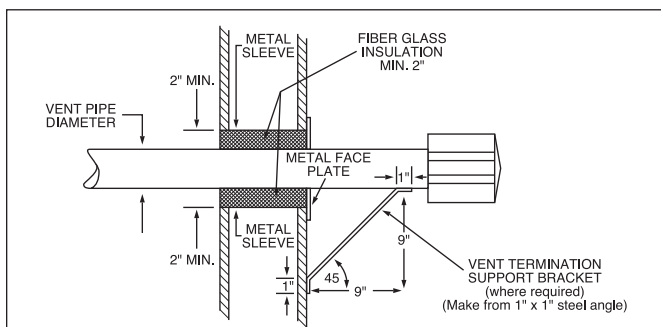

- C10. Maintain a 1/4" per foot downward slope away from the heater and place a drip leg with clean out near the exit of the vent as shown in Figure 9.1, or allow the condensate to drip out the end.
- C11. For a vent termination located under an eave, the distance of the overhang must not exceed 24". The clearance to combustibles above the exterior vent must be maintained at a minimum of 12". Consult the National Fuel Gas Code for additional requirements for eaves that have ventilation openings.
- C12. Once venting is complete, proceed section titled "Installation - Gas Connections".


## Section D - Concentric Vent System Installation

- D1. This section applies to both horizontally and vertically vented concentric vent systems as defined in "Section A – General Instructions – All Units", and is in addition to the instructions in that section.
- D2. When utilizing the concentric vent option, it should have been predetermined whether the appliance will be horizontally or vertically vented. Before proceeding, verify that the concentric vent kit received contains the correct components for the installation:

### For Vertically Vented Units (Refer to Figure 9.3):

- Concentric adapter assembly (same for horizontal and vertical kits)
- Modine part number:
  - 5H072285-0001 (Item Code 27866) for 4" vent pipe
  - 5H072285-0002 (Item Code 27868) for 6" vent pipe
 A Gary Steel 1092 cap is an acceptable alternate.
- Specially designed inlet terminal (part #5H75154)


**Figure 9.3 - Vertical Concentric Vent Kit Components**

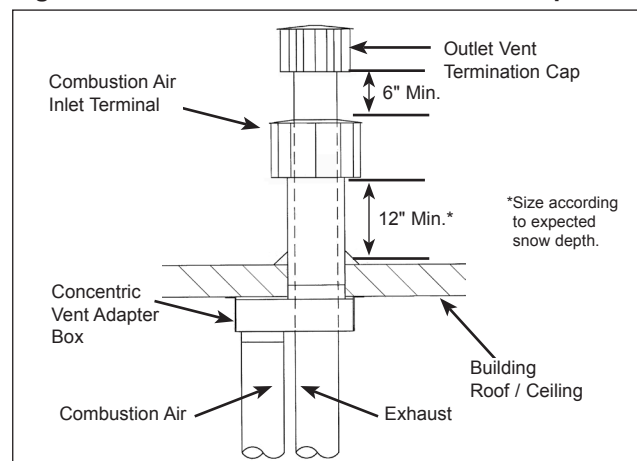

### For Horizontally Vented Units (Refer to Figure 9.4):

- Concentric adapter assembly (same for horizontal and vertical kits)
- Special vent termination cap (part #5H75150)
- Special inlet air guard

**Figure 9.4 - Horizontal Concentric Vent Kit Components**

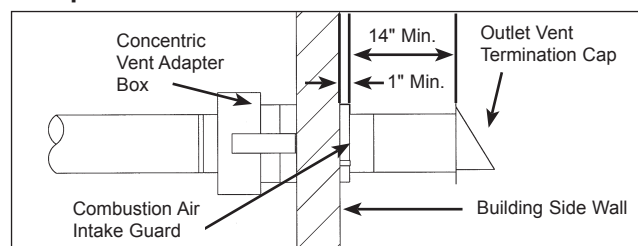

## ⚠ CAUTION

The concentric vent adapter box must be installed inside of the structure or building. Do not install this box on the exterior of a building or structure.

## INSTALLATION - VENTING

- D3. Once the kit contents have been verified as correct for the direction of venting, the concentric vent adapter box is to be installed. Determine the location of the box. Be sure to maintain all clearances as listed in these instructions.
- D4. The adapter box is to be mounted on the interior side of the building. It must not be mounted outside the building. The adapter box has integral mounting holes for ease of installation. When horizontal venting multiple units, the minimum spacing between any sides of the adapter boxes must be 18" and boxes must not overlap in the vertical plane (above or below). When condensation may be a problem, the vent system shall not terminate over public walkways or over an area where condensate or vapor could create a nuisance or hazard or could be detrimental to the operation of regulators, relief openings, or other equipment.
- D5. The adapter box can be mounted flush to the wall (for horizontal kits) or to the ceiling (for vertical kits). The box can also be offset from the wall or ceiling by using field supplied brackets. When mounting the box, consider serviceability and access to the vent and combustion air pipes. If the box is to be mounted using field supplied brackets, these brackets must be strong enough to rigidly secure the box to the wall or ceiling, and should be made from corrosion resistant material.
- D6. Determine the length of the vent pipe and combustion air inlet pipe for the selected location. THE VENT PIPE WILL PASS THROUGH THE CONCENTRIC VENT BOX. THE LAST SECTION OF VENT PIPE IS A CONTINUOUS LENGTH OF DOUBLE WALL "B" VENT. See section A12 for attaching and terminating double wall pipe. Begin with pipe lengths on the concentric pipe side of the adapter box referring to Figure 10.1. These pipes will extend through the building wall or roof as well as any added length for the thickness of the wall and the offset from any field installed brackets.

### For Vertical Concentric Vent Kits (refer to Figure 9.3):

- The bottom of the combustion air intake pipe must terminate above the snow line, or at least 12 inches above the roof, whichever distance is greater.
- The bottom of the vent cap must terminate at least 6 inches above the top of the combustion air intake cap.


### For Horizontal Concentric Vent Kits (refer to Figure 9.4):

- The combustion air intake pipe must terminate at least 1 inch from the wall to prevent water from running down the wall and into the pipe.
- The back of the vent cap must terminate at least 14 inches from the combustion air intake pipe.

- D7. Cut the concentric side vent and combustion air pipes to the proper length as determined in the previous step. Note that the vent pipe diameter is 4" and the combustion air intake pipe diameter is 6" for model sizes 75-175, and 6" and 8" respectively for model sizes 200-400. The pipes must be single wall galvanized or stainless steel material, except for the last section of vent pipe, which must be one continuous length of double wall B-vent extended through the concentric vent box and combustion air inlet pipe on the concentric side of the box.
- D8. Allow the concentric side vent pipe to pass through the concentric vent adapter box, as shown in Figure 10.1. Attach the double wall vent pipe to the single wall vent pipe that goes to the unit. Be sure to seal the joint and the open area around the double wall vent. Seal all joints and seams using sealant suitable for temperatures up to 400°F.

- D9. Slide the combustion air pipe over the vent pipe and attach to the air inlet of the concentric adapter box, as shown in Figure 10.1, using at least 3 corrosion resistant sheet metal screws. Seal the joint and seam using sealant suitable for temperatures up to 400°F.
- D10. Place this assembly (the adapter box, vent pipe and combustion air pipe) through the wall or roof and verify that the distance requirements as defined in Step D7 are met. Securely attach the assembly building.
- D11. From outside the building, caulk the gap between the combustion air intake pipe and the building penetration.
- D12. Attach the combustion air intake and vent pipe terminations as follows:

**Figure 10.1 - Adapter Box with Combustion Air Intake Pipe Attached**

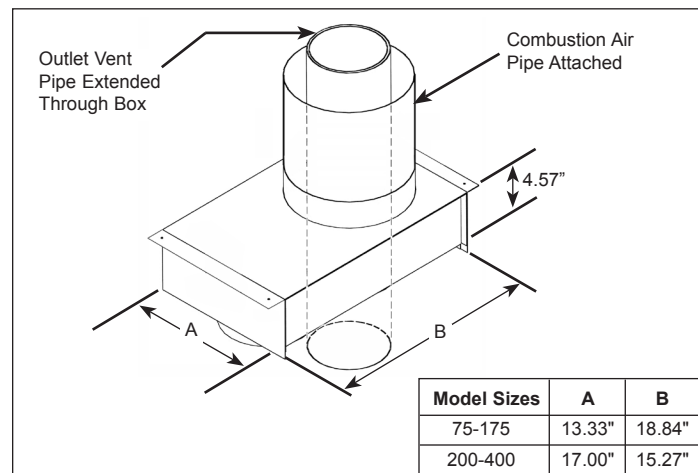

### For Vertical Concentric Vent Kits (refer to Figure 9.3):

- Slide the combustion air cap down over the vent pipe and fasten it to the combustion air pipe with at least 3 corrosion resistant sheet metal screws.
- Attach the vent cap to the vent pipe using at least 3 corrosion resistant sheet metal screws. Refer to instruction A12 for connecting terminal to double wall pipe.
- Caulk the gap between the combustion air cap and the vent pipe with silicone sealant, or other appropriate sealants suitable for metal to metal contact and for temperatures up to 400° F.

### For Horizontal Concentric Vent Kits (refer to Figure 9.4):

- Attach the combustion air intake guard using corrosion resistant screws at the end of the combustion air intake pipe to prevent animals and debris from entering.
  - Attach the vent cap to the vent pipe using at least 3 corrosion resistant sheet metal screws.
- D13. Install vent pipe and combustion air pipe between unit heater and concentric vent adapter box as outlined in "Section A – General Instructions – All Units".
- D14. Once venting is complete, proceed to the section titled "Installation - Gas Connections".

**PAGE INTENTIONALLY LEFT BLANK**

UNIT INSTALLATION

Gas Connections

⚠ WARNING

- 1. All field gas piping must be pressure/leak tested prior to operation. Never use an open flame. Use a soap solution or equivalent for testing.
- 2. Gas pressure to appliance controls must never exceed 14" W.C. (1/2 psi).
- 3. To reduce the opportunity for condensation, the minimum sea level input to the appliance, as indicated on the serial plate, must not be less than 5% below the rated input, or 5% below the minimum rated input of dual rated units.

⚠ CAUTION


Purging of air from gas supply line should be performed as described in ANSI Z223.1 - latest edition "National Fuel Gas Code", or in Canada in CAN/CGA-B149 codes.

IMPORTANT

To prevent premature heat exchanger failure, the input to the appliance, as indicated on the serial plate, must not exceed the rated input by more than 5%.

- 1. Installation of piping must conform with local building codes, or in the absence of local codes, with the National Fuel Gas Code, ANSI Z223.1 (NFPA 54) - Latest Edition. In Canada, installation must be in accordance with CAN/CGA-B149.1 for natural gas units and CAN/CGA-B149.2 for propane units.
- 2. Piping to units should conform with local and national requirements for type and volume of gas handled, and pressure drop allowed in the line. Refer to Table 13.1 to determine the cubic feet per hour (cfh) for the type of gas and size of unit to be installed. Using this cfh value and the length of pipe necessary, determine the pipe diameter from Table 12.1. Where several units are served by the same main, the total capacity, cfh and length of main must be considered. Avoid pipe sizes smaller than 1/2". Table 12.1 allows for a 0.3" W.C. pressure drop in the supply pressure from the building main to the unit. The inlet pressure to the unit must be 6-7" W.C. for natural gas and 11-14" W.C. for propane gas. When sizing the inlet gas pipe diameter, make sure that the unit supply pressure can be met after the 0.3" W.C. has been subtracted. If the 0.3" W.C. pressure drop is too high, refer to the Gas Engineer's Handbook for other gas pipe capacities.
- 3. The gas piping to the unit can enter the unit from the side of the unit or from below. Install a ground joint union with brass seat and a manual shut-off valve external of the unit casing, and adjacent to the unit for emergency shut-off and easy servicing of controls, including a 1/8" NPT plugged tapping accessible for test gauge connection (See Figure 12.1). Verify the manual shut-off valve is gas tight on an annual basis.
- 4. Provide a sediment trap before each unit in the line where low spots cannot be avoided. (See Figure 12.1).
- 5. When Pressure/Leak testing, pressures above 14" W.C. (1/2 psi), close the field installed shut-off valve, disconnect the appliance and its combination gas control from the gas supply line, and plug the supply line before testing. When testing pressures 14" W.C. (1/2 psi) or below, close the manual shut-off valve on the appliance before testing.

Figure 12.1 - Recommended Sediment Trap/Manual Shut-off Valve Installation - Side or Bottom Gas Connection

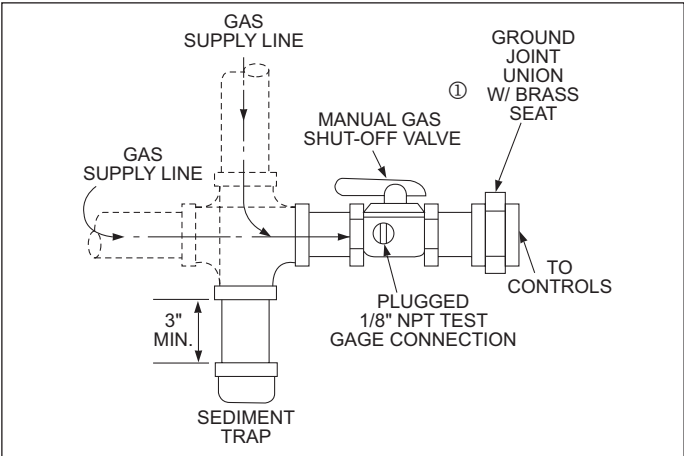

① Manual shut-off valve is in the "OFF" position when handle is perpendicular to pipe.

Table 12.1 - Gas Pipe Capacities - Natural Gas ① ②

| Pipe Length (ft) | Natural Gas |      |     |        |        |      |
|------------------|-------------|------|-----|--------|--------|------|
|                  | 1/2"        | 3/4" | 1"  | 1-1/4" | 1-1/2" | 2"   |
| 10               | 132         | 278  | 520 | 1050   | 1600   | 3050 |
| 20               | 92          | 190  | 350 | 730    | 1100   | 2100 |
| 30               | 73          | 152  | 285 | 590    | 890    | 1650 |
| 40               | 63          | 130  | 245 | 500    | 760    | 1450 |
| 50               | 56          | 115  | 215 | 440    | 670    | 1270 |
| 60               | 50          | 105  | 195 | 400    | 610    | 1150 |
| 70               | 46          | 96   | 180 | 370    | 560    | 1050 |
| 80               | 43          | 90   | 170 | 350    | 530    | 930  |
| 100              | 38          | 79   | 150 | 305    | 460    | 870  |
| 125              | 34          | 72   | 130 | 275    | 410    | 780  |
| 150              | 31          | 64   | 120 | 250    | 380    | 710  |

① Capacities in Cubic Feet per Hour through Schedule 40 pipe with maximum 0.3" W.C. pressure drop with up to 14" W.C. gas pressure. Specific gravity is 0.60 for Natural gas and 1.50 for Propane gas.

② For Pipe Capacity with Propane Gas, divide Natural gas capacity by 1.6. Example: What is the Propane gas pipe capacity for 60 feet of 1-1/4" pipe? The Natural gas capacity is 400 CFH. Divide by 1.6 to get 250 CFH for Propane gas.

# INSTALLATION

**Table 13.1 - Burner Orifice Sizing and Gas Consumption**

| Model Size |                    | Gas Type  |           | Orifice Qty |
|------------|--------------------|-----------|-----------|-------------|
|            |                    | Natural ① | Propane ② |             |
| 75         | Cfh                | 72.1      | 30.0      | 1           |
|            | Orifice Drill Size | 20        | 39        |             |
| 100        | Cfh                | 96.1      | 40.0      | 2           |
|            | Orifice Drill Size | 30        | 45        |             |
| 125        | Cfh                | 120.2     | 50.0      | 2           |
|            | Orifice Drill Size | 25        | 42        |             |
| 150        | Cfh                | 144.2     | 60.0      | 3           |
|            | Orifice Drill Size | 30        | 45        |             |
| 175        | Cfh                | 168.3     | 70.0      | 3           |
|            | Orifice Drill Size | 27        | 43        |             |
| 200        | Cfh                | 192.3     | 80.0      | 3           |
|            | Orifice Drill Size | 23        | 42        |             |
| 225        | Cfh                | 216.3     | 90.0      | 3           |
|            | Orifice Drill Size | 20        | 39        |             |
| 250        | Cfh                | 240.4     | 100.0     | 4           |
|            | Orifice Drill Size | 25        | 42        |             |
| 300        | Cfh                | 288.7     | 120.0     | 4           |
|            | Orifice Drill Size | 20        | 39        |             |
| 350        | Cfh                | 336.5     | 140.0     | 6           |
|            | Orifice Drill Size | 27        | 43        |             |
| 400        | Cfh                | 384.6     | 160.0     | 6           |
|            | Orifice Drill Size | 23        | 42        |             |
| 500<br>③   | Cfh                | 240.4     | 100.0     | 4           |
|            | Orifice Drill Size | 25        | 42        |             |
| 600<br>③   | Cfh                | 288.7     | 120.0     | 4           |
|            | Orifice Drill Size | 20        | 39        |             |
| 700<br>③   | Cfh                | 336.5     | 140.0     | 6           |
|            | Orifice Drill Size | 27        | 43        |             |
| 800<br>④   | Cfh                | 384.6     | 160.0     | 6           |
|            | Orifice Drill Size | 23        | 42        |             |
| 840<br>④   | Cfh                | 336.5     | 140.0     | 6           |
|            | Orifice Drill Size | 27        | 43        |             |
| 960<br>④   | Cfh                | 384.6     | 160.0     | 6           |
|            | Orifice Drill Size | 23        | 42        |             |

① Based on natural gas properties of 1040 Btu/Cu. Ft. and specific gravity of 0.60.

② Based on propane gas properties of 2500 Btu/Cu. Ft. and specific gravity of 1.53.

③ Model sizes 500-800 contain 2 furnaces. Values shown are per furnace.

④ Model sizes 840-960 contain 3 furnaces. Values shown are per furnace.

# INSTALLATION

## Considerations for Elevation

The standard ratings for Models DBS/DCS are certified for elevations up to 2000 feet above sea level. Operation at elevations above 2,000 feet requires ratings be reduced 4% for each 1000 feet above sea level per ANSI Z223.1. The exception is for units in Canada, CSA requires that ratings be reduced 10% for elevations between 2,001 and 4500 feet. The following instructions are for units that will be installed over 2,000 feet elevation. If this does not apply, you may skip ahead to the Electrical Connections section on page 15.

## Manifold Pressure Adjustment

The unit manifold pressure is factory set for operation at elevations up to 2000 feet as follows:

- For **Natural Gas** units, 3.5" W.C. based on a gas heating value of 1,050 BTU/ft<sup>3</sup>.
- For **Propane Gas** units, 10.0" W.C. based on a gas heating value of 2,500 BTU/ft<sup>3</sup>.

For higher elevations, some utility companies may derate the BTU content (heating value) of the gas provided at altitude to a lower value to allow certain heating appliances to be used with no manifold pressure adjustments. For this reason it is necessary that the supplying utility be contacted for detailed information about the gas type and BTU content (heating value) before operating any heater. Table 14.1 shows the standard derated heating values of natural and propane gases at various elevations.

**Table 14.1**  
**Gas Heating Values at Altitude (Btu/ft<sup>3</sup>)** ①②③⑤

| Altitude (ft) | Natural Gas | Propane |
|---------------|-------------|---------|
| 0-2,000       | 1,050       | 2,500   |
| 2,001-3,000   | 929 ③       | 2,212 ④ |
| 3,001-4,000   | 892 ③       | 2,123 ④ |
| 4,001-4,500   | 874 ③       | 2,080 ④ |
| 4,501-5,000   | 856         | 2,038   |
| 5,001-6,000   | 822         | 1,957   |
| 6,001-7,000   | 789         | 1,879   |
| 7,001-8,000   | 757         | 1,803   |
| 8,001-9,000   | 727         | 1,731   |
| 9,001-10,000  | 698         | 1,662   |

① Values shown are for 3.5" W.C. manifold pressure for Natural Gas and 10.0" W.C. for Propane Gas. If the local utility supplies gas with a different Btu/ft<sup>3</sup> value, use Equation 14.1 to calculate the required manifold pressure.

② Gas heating values shown are derated 4% per 1,000' of elevation (10% between 2,000' and 4,500' elevation in Canada) in accordance with ANSI Z223.1 and CSA-B149, respectively.

③ 945 Btu/ft<sup>3</sup> for Canada

④ 2,250 Btu/ft<sup>3</sup> for Canada

⑤ When installed at altitudes above 2,000', a pressure switch may need to be changed. Refer to Tables 14.2 and 14.3 to determine if a switch change is required.

If the utility is supplying gas with heating values **SAME** as shown in Table 14.1, the manifold pressure should remain set to 3.5" W.C. for natural gas and 10.0" W.C. for propane gas and you may proceed to the section on this page titled "Selection of the Proper High Altitude Kit".

If the utility is supplying gas with heating values **DIFFERENT** than shown in Table 14.1, use Equation 14.1 to determine the appropriate manifold pressure for the elevation and gas heating value being supplied. Note what that value is, as it will be needed later for Start-Up. Proceed to the section on this page titled "Selection of the Proper High Altitude Kit".

## Equation 14.1 - Manifold Pressure for Gas Heating Values Different Than Shown in Table 10.1

$$MP_{ELEV} = \left( \frac{BTU_{TBL}}{BTU_{ACT}} \right)^2 \times MP_{SL}$$

Where:

$MP_{ELEV}$  = Manifold Pressure (" W.C.) at installed elevation

$BTU_{TBL}$  = BTU/ft<sup>3</sup> content of gas from Table 14.1

$BTU_{ACT}$  = BTU/ft<sup>3</sup> content of gas obtained from the utility company

$MP_{SL}$  = Manifold Pressure (" W.C.), at Sea Level (use 3.5" W.C. for natural gas and 10.0" W.C. for propane)

**NOTE:** For units equipped with two-stage or modulating gas controls, only the high fire manifold pressure needs to be adjusted. No adjustments to the low fire manifold pressure are necessary on these units.

## Selection of the Proper High Altitude Kit

All units installed at elevations greater than 2000 feet above sea level require a kit, in addition to potential manifold pressure adjustment outlined in the previous step. To determine the proper kit to use, refer to Table 14.2.

Table 14.3 shows the contents of the kit. For more information, refer to the latest revision of Modine Bulletin 75-530.

**Table 14.2 - High Altitude Kit Selection Table** ①②③④

| Model Size  | Item Code by Elevation Above Sea Level (ft) |             |             |             |             |             |             |
|-------------|---------------------------------------------|-------------|-------------|-------------|-------------|-------------|-------------|
|             | 2,001-2,500                                 | 2,501-4,500 | 4,501-5,000 | 5,001-5,500 | 5,501-6,500 | 6,501-7,000 | 7,001-7,500 |
| 75          | 67248                                       | 67248       | 67248       | 67248       | 67248       | 67248       | 67248       |
| 100         | 67248                                       | 67248       | 67248       | 67248       | 77785       | 77785       | 68406       |
| 125         | 67248                                       | 77786       | 77786       | 77786       | 77785       | 77785       | 68406       |
| 150         | 77787                                       | 77786       | 77786       | 77786       | 77785       | 77785       | 68406       |
| 175         | 77786                                       | 77786       | 68408       | 68408       | 68408       | 68410       | 68410       |
| 200         | 67248                                       | 67248       | 67248       | 67248       | 67248       | 67248       | 67248       |
| 225         | 67248                                       | 67248       | 67248       | 67248       | 67248       | 67248       | 67248       |
| 250/500     | 67248                                       | 67248       | 67248       | 67248       | 67248       | 67248       | 67248       |
| 300/600     | 67248                                       | 67248       | 67248       | 67248       | 67248       | 67248       | 67248       |
| 350/700/840 | 67248                                       | 67248       | 67248       | 77786       | 77785       | 77785       | 68406       |
| 400/800/960 | 77786                                       | 77786       | 77785       | 77785       | 77785       | 68410       | 68410       |

① Applies to both installations in the U.S. and Canada.

② Applies to both natural and propane gas.

③ Sizes 75-400 require a kit qty. of 1, sizes 500-800 require a kit qty of 2, sizes 840-960 require a kit qty of 3.

④ All kits include a High Altitude Conversion Label and Installation Instructions. Additionally, all kits except 67248 include a Pressure Switch to replace the standard switch.

If a unit is to be installed at higher elevations AND converted from natural gas to propane gas operation, a propane conversion kit must be used in conjunction with the manifold pressure adjustment and high altitude kit listed above. For the Selection and Installation Instructions for propane conversion kits, please see the latest revision of Modine Bulletin 75-511.

# UNIT INSTALLATION

## Electrical Connections

### **! WARNING**

1. Disconnect power supply before making wiring connections to prevent electrical shock and equipment damage.
2. All appliances must be wired strictly in accordance with wiring diagram furnished with the appliance. Any wiring different from the wiring diagram could result in a hazard to persons and property.
3. Any original factory wiring that requires replacement must be replaced with wiring material having a temperature rating of at least 105°C.
4. Ensure that the supply voltage to the appliance, as indicated on the serial plate, is not 5% greater than rated voltage.

### **! CAUTION**

Ensure that the supply voltage to the appliance, as indicated on the serial plate, is not 5% less than the rated voltage.

1. Installation of wiring must conform with local building codes, or in the absence of local codes, with the National Electric Code ANSI/NFPA 70 - Latest Edition. Unit must be electrically grounded in conformance to this code. In Canada, wiring must comply with CSA C22.1, Part 1, Electrical Code.
2. Two copies of the job specific wiring diagram are provided with each unit, one located in the duct furnace electrical junction box and one in the electrical section of the unit. Refer to this diagram for all wiring connections.
3. The wire gauge must be sized according to the National Electric Code or CSA code based on the power supply voltage, amp draw, and length of run. Refer to the Table 15.1 for maximum wire lengths for the number of wires that can be wired to each low voltage terminal block.


**Table 15.1 - Low Voltage (24V) Maximum Wire Length (Ft.)**

NEC-1996, Table 310-17, Copper wire with 90°C insulation, conductors in free space (not in conduit), 86°F ambient. For other wire types, refer to the NEC of CSA code.

| Digit 15                        | Transformer Size (VA) | Wire Gauge |       |       |       |       |
|---------------------------------|-----------------------|------------|-------|-------|-------|-------|
|                                 |                       | 18 Ga      | 16 Ga | 14 Ga | 12 Ga | 10 Ga |
| 1                               | 40                    | 162        | 216   | 315   | 360   | 495   |
| 2                               | 75                    | 86         | 115   | 168   | 192   | 264   |
| 3                               | 150                   | 43         | 58    | 84    | 96    | 132   |
| 4                               | 250                   | 26         | 35    | 50    | 58    | 79    |
| Maximum # of Wires per Terminal |                       | 5          | 4     | 3     | 2     | 1     |

4. Make sure all multi-voltage components (motors, transformers, etc.) are wired in accordance with the power supply voltage.
5. The power supply to the unit must be protected with a fused or circuit breaker disconnect switch. Refer to the Factory Mounted Option Locations (Figure 23.1) for the factory mounted disconnect switch location and then review the unit to determine if a factory installed dead front disconnect switch was provided. Accessory field installed disconnect switches should be mounted where shown in Figure 15.1. For fusible disconnect switches, refer to the Model Identification plate for the fuse size and type.

**Figure 15.1 - Recommended Accessory Field Installed Disconnect Switch Mounting Locations**

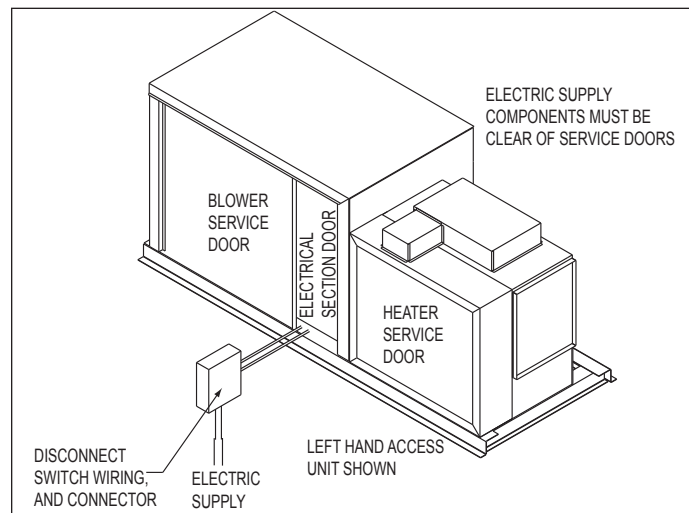

6. The power supply must be within 5% of the voltage rating and each phase must be balanced within 2 percent of each other. If not, advise the utility company.
7. External electrical service connections that must be installed include:
  - a. Supply power connection (120, 208, 240, 480, or 600 volts).
  - b. Connection of thermostats, remote monitoring panels, building pressure sensors, CO detectors, time clocks, or any other accessory control devices that may be supplied (24 volts).
8. All outdoor electrical connections must be weatherized to prevent moisture from entering the electrical compartment.
9. Refer to the unit dimensional drawings on Figures 42.1 and 43.1 for the electrical entry locations.
10. All supply power electrical connections are made in the electrical section of the unit. The low voltage (thermostat and accessory control devices) can be wired to either the electrical section or the duct furnace electrical junction box. Refer to the wiring diagram for the terminal location of all low voltage wiring.

# UNIT INSTALLATION


## Cooling Coil Units

Models with a cooling section can be provided with either a factory installed direct expansion (DX) evaporator, a chilled fluid (for use with water, ethylene glycol, or propylene glycol fluids) coil, or the coil can be field supplied and installed by others. For units equipped with a factory installed cooling coil (Digit 23 = 1), refer to the packing slip to determine the coil type provided.

The cooling section includes a full coverage, 3-way sloping 409 stainless steel drain pan to remove condensate from coil headers, thermal expansion valves, and refrigerant piping. Insulation is standard on outdoor units and optional on indoor units. The cabinet includes two doors, a removable upper door for service access to the coil once the plumbing has been installed and a lower door which includes a factory supplied 1" stubbed drain connection to the exterior of the cabinet. Field connections for coil inlet and outlet piping can be made through the cabinet corner post or back of the unit. The cooling section duct transition includes 1-1/2" flanges for fastening the sides of the coil. The bottom duct transition is angled to remove any condensation that may be entrained in the supply air stream.

For field supplied coils, do not exceed the maximum coil dimensions listed in Literature 82-135. The dimensions listed are for the maximum coil dimensions. If the coil supplied is smaller than the listed dimensions, field supplied blank off plates are required to prevent air bypass around the coil. The coil is supported by two 14 gauge support rails which contain mounting provisions for fastening 4", 5", 6", 7.5", 8.5", and 10" deep coils.

**Figure 16.1 - Cooling Section**

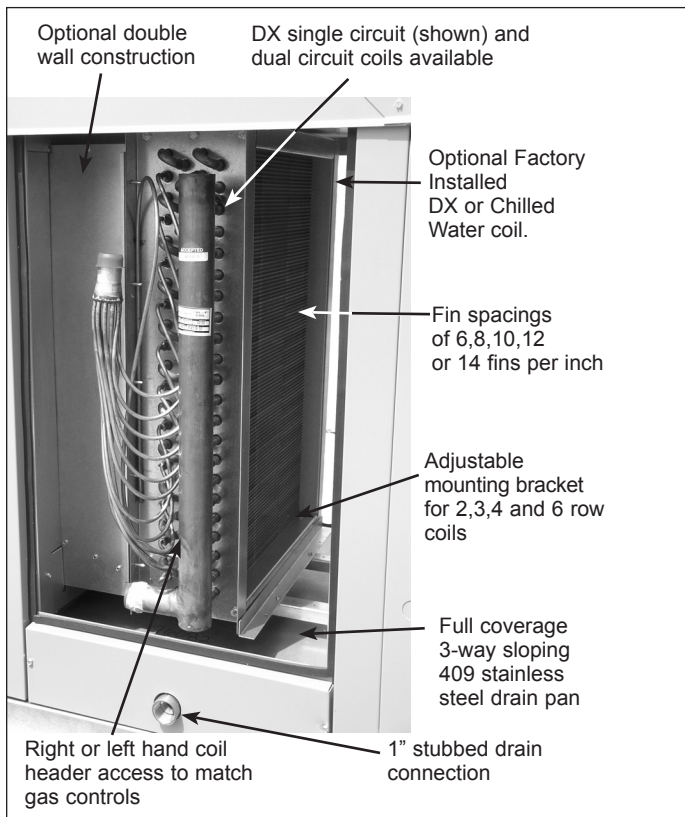


## Condensate Drain Pan Trap

The condensate drain line needs to include a P-trap immediately downstream of the connection to the unit. This trap should extend at least two inches below the connection to prevent air pressure from forcing air into the unit. The trap should be primed with a water/glycol solution to prevent freezing.

## Direct Expansion (DX) Piping

The refrigerant lines should be insulated to prevent warming or cooling of the refrigerant. If the suction line is allowed to be cooled, liquid will condense in the line and can severely damage the compressor. If the liquid line is warmed, the refrigerant can "flash" into a gas. This will cause erratic operation of the expansion device and impair the heat transfer ability of the cooling coil. Long runs of piping need to be periodically supported to prevent excess vibration that can damage the piping and joints. It is recommended to provide dampening supports at intervals of length equivalent to 15 tube diameters.

**Figure 16.2 - General DX Piping**

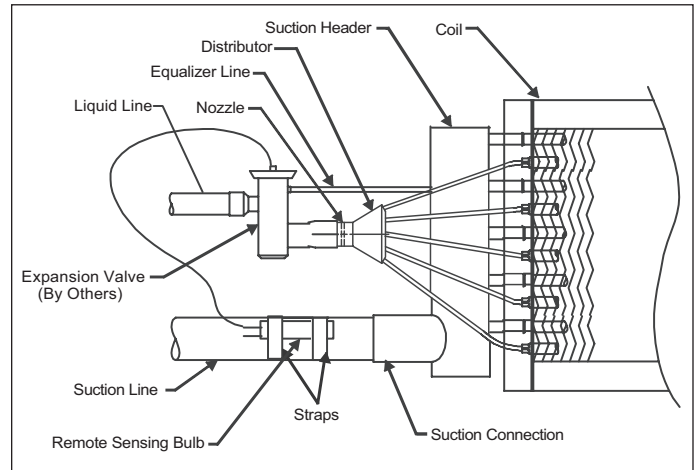

1. Inspect the refrigerant distributor and verify that the nozzle is in place.
2. All field brazing and welding should be performed using high quality materials and an inert gas purge (such as nitrogen) to reduce oxidation of the internal surface of the coil.
3. For DX coils, the use of filter-driers in the system piping is recommended along with a sight glass that has a moisture indicator.
4. Connect the suction line and suction connection.
5. Install the expansion valve (By Others). Follow the expansion valve manufacturer's recommendations for installation to avoid damaging the valve.
6. Connect the liquid line to the expansion valve. Pressurize the coil, expansion valve assembly and suction connection to 100 psig with dry nitrogen or other suitable gas. The coil should be left pressurized for a minimum of 10 minutes.
7. If the coil holds pressure, the installation can be considered leak free. If the pressure drops by 5 psi or less, repressurize the coil and wait another 10 minutes. If the pressure drops again, there are more than likely one or more small leaks, which should be located and repaired. Pressure losses greater than 5 psi would indicate a larger leak, which should be isolated and repaired. Be sure to check valves and fittings as potential sites for leakage or bleed.
8. Use a vacuum pump to evacuate the coil and any interconnecting piping that has been open to atmosphere. Measure the vacuum in the piping using a micron gauge located as far from the pump as possible (the vacuum at the pump will be greater than the rest of the system). Evacuate the coil to 500 microns or less then close the valve between the pump and the system. If the vacuum holds to 500 microns or less for one minute, the system is ready to be charged or refrigerant pumped down in another portion of the system can be opened to the coil. A steady rise in microns would indicate that moisture is still present and that the coil should be further vacuumed until the moisture has been removed.

## UNIT INSTALLATION

9. Failure to obtain a high vacuum is indicative of a great deal of moisture or a small leak. Break the vacuum with a charge of dry nitrogen or other suitable gas and recheck for leaks (soapy water works well). If no leaks are found, continue vacuuming the coil until the desired vacuum is reached.
10. All field piping must be self-supporting.


### Chilled Fluid Piping

To prevent noise and coil damage from water hammer, an air vent is necessary to bleed off the accumulated air in the system. The vent should be located on the top of the inlet manifold where the air collects. This vent should be opened twice a year.

The outlet manifold should have a drain installed on the bottom to allow for periodic flushing of the system to remove sediments and corrosion products from the cooling coil. This drain should be opened to allow some fluid to drain twice a year. Check coloration and viscosity of the effluent for indications of corrosion in the system. The lines between the unit and the structure should be insulated to prevent freezing of the water.

1. Once installed, the coil should be pressurized to 100 psig with dry nitrogen or other suitable gas. The coil should be left pressurized for a minimum of 10 minutes. If the coil holds the pressure, the hook-up can be considered leak free. If the pressure drops by 5 psig or less re-pressurize the coil and wait another 10 minutes. If the pressure drops again, there is more than likely one or more small leaks which should be located and repaired. Pressure losses greater than 5 psig would indicate a larger leak that should be isolated and repaired.
2. All field brazing and welding should be performed using high quality materials and an inert gas purge (such as nitrogen) to reduce oxidation of the internal surface of the coil.
3. All field piping must be self supporting. System piping should be flexible enough to allow for thermal expansion and contraction of the coil.
4. Fill the coil with water with all air vents open so that air is eliminated from within the coil circuitry and headers. Verify that all vents and drains are not obstructed and do discharge a stream of water.
5. Close all vents and perform a hydrostatic leak test of all brazed, threaded or flanged joints, valves and interconnecting piping. Recheck the coil level and correct if necessary. When the setup is found to be leak free, discharge and discard initial water charge. It is important that all grease, oil, flux and sealing compounds present from the installation be removed.

**Figure 17.1 - General Chilled Fluid Piping**

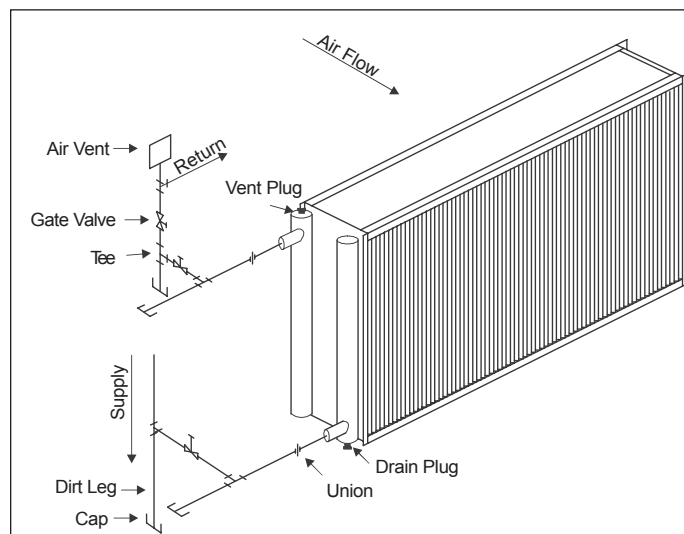

**Table 17.1 - Cooling Coil Performance Limits**

| Cooling Type  | Model Size | Min CFM | Single Circuit |            | Dual Circuit |            | Max Cooling (Tons) ② |
|---------------|------------|---------|----------------|------------|--------------|------------|----------------------|
|               |            |         | Max CFM ①      | Area (ft²) | Max CFM ①    | Area (ft²) |                      |
| DX            | 75         | 688 ③   | 1,891          | 3.44       | 1,707        | 3.10       | 9.4                  |
|               | 100        | 802 ④   | 2,206          | 4.01       | 2,048        | 3.72       | 11.4                 |
|               | 125        | 937     |                |            |              |            |                      |
|               | 150        | 1,125   | 2,521          | 4.58       | 2,416        | 4.39       | 13.4                 |
|               | 175        | 1,312   |                |            |              |            |                      |
|               | 200        | 1,500   | 3,352          | 6.09       | 3,165        | 5.76       | 18.1                 |
|               | 225        | 1,687   |                |            |              |            |                      |
|               | 250        | 1,875   | 3,724          | 6.77       | 3,538        | 6.43       | 20.2                 |
|               | 300        | 2,250   |                |            |              |            |                      |
|               | 350        | 2,625   | 5,214          | 9.48       | 4,996        | 9.08       | 27.3                 |
|               | 400        | 3,000   |                |            |              |            |                      |
| Chilled Water | 75         | 609     | 1,676          | 3.05       | n/a          | n/a        | 10.6                 |
|               | 100        | 750     | 2,011          | 3.66       | n/a          | n/a        | 12.6                 |
|               | 125        | 937     |                |            |              |            |                      |
|               | 150        | 1,125   | 2,372          | 4.31       | n/a          | n/a        | 14.8                 |
|               | 175        | 1,312   |                |            |              |            |                      |
|               | 200        | 1,500   | 3,214          | 5.84       | n/a          | n/a        | 19.3                 |
|               | 225        | 1,687   |                |            |              |            |                      |
|               | 250        | 1,875   | 3,592          | 6.53       | n/a          | n/a        | 21.3                 |
|               | 300        | 2,250   |                |            |              |            |                      |
|               | 350        | 2,625   | 5,073          | 9.22       | n/a          | n/a        | 29.3                 |
|               | 400        | 3,000   |                |            |              |            |                      |

① Based on 550 feet per minute (FPM) coil face velocity.

② Based on 95°F/75°F Entering Dry Bulb/Wet Bulb.

③ Model Size 75 minimum CFM for DX Dual Circuit is 621.

④ Model Size 100 minimum CFM for DX Dual Circuit is 745.

# START-UP PROCEDURE

## Start-Up Procedure

### IMPORTANT

1. To prevent premature heat exchanger failure, observe heat exchanger tubes by looking at the heat exchanger through the field installed access openings in connecting ductwork in blower package units or the unit access doors in cooling package units. If the bottom of the tubes become red while blower and duct furnace are in operation, check to be sure the blower has been set to the proper rpm for the application. Refer to page 20 for Blower Adjustments.
  2. Start-up and adjustment procedures should be performed by a qualified service agency.
1. Turn off power to the unit at the disconnect switch. Check that fuses or circuit breakers are in place and sized correctly. Turn all hand gas valves to the "OFF" position.
  2. Remove the duct furnace and blower exterior panels and open the electrical compartment door.
  3. Check that the supply voltage matches the unit supply voltage listed on the Model Identification plate. Verify that all wiring is secure and properly protected. Trace circuits to insure that the unit has been wired according to the wiring diagram.
  4. Check to insure that the venting system is installed and free from obstructions.
  5. Check to see that there are no obstructions to the intake and discharge of the unit.
  6. Check the belt tension and sheave alignment. Refer to Blower Adjustments for proper belt tension.
  7. Check bearings for proper lubrication. For units provided with pillow block bearings (See Model Nomenclature), refer to Lubrication Recommendations for lubrication requirements.
  8. Check to make sure that all filters are in place and that they are installed properly according to direction of air flow.
  9. Perform a visual inspection of the unit to make sure no damage has occurred during installation.
  10. Turn on power to the unit at the disconnect switch. Check to insure that the voltage between duct furnace electrical box terminals 1 and 2 is 24V.
  11. Check the thermostat, ignition control, gas valve, and supply fan blower motor for electrical operation. If these do not function, recheck the wiring diagram. Check to insure that none of the Control Options have tripped.
  12. For units with a return air damper, the return air damper linkage needs to be adjusted. Refer to Damper Linkage Adjustment.
  13. Check to make sure that the damper opens properly without binding.
  14. Check the blower wheel for proper direction of rotation when compared to the air flow direction arrow on the blower housing. Blower wheel rotation, not air movement, must be checked as some air will be delivered through the duct furnace with the blower wheel running backwards.
  15. Check the blower speed (rpm). Refer to Blower Adjustments for modification.
  16. Check the motor speed (rpm).
  17. Check the motor voltage. On three phase systems, check to make sure all legs are in balance.
  18. Check the motor amp draw to make sure it does not exceed the motor nameplate rating. On three phase systems, check all legs to insure system is balanced.
  19. Recheck the gas supply pressure at the field installed manual shut-off valve. The minimum inlet pressure should be 6" W.C. on natural gas and 11" W.C. on propane gas.
- The maximum inlet pressure for either gas is 14" W.C. If inlet pressure exceeds 14" W.C., a gas pressure regulator must be added upstream of the combination gas valve.
20. Open the field installed manual gas shut-off valve.
  21. Open the manual main gas valve on the combination gas valve. Call for heat with the thermostat and allow the pilot to light. On a call for heat the power exhaustor relay will energize the power exhaustor motor. Once the power exhaustor motor reaches full speed, a differential pressure switch will close before the pilot can light. If the pilot does not light, purge the pilot line. If air purging is required, disconnect the pilot line at outlet of pilot valve. In no case should line be purged into heat exchanger. Check the pilot flame length (See Pilot Flame Adjustment).
  22. Once the pilot has been established, check to make sure that the main gas valve opens. Check the manifold gas pressure (See Main Gas Adjustment) and flame length (See Air Shutter Adjustment) while the supply fan blower is operating.
  23. Check to insure that gas controls sequence properly (See Control Operating Sequence). Verify if the unit has any additional control devices and set according to the instructions in the Control Options.
  24. Once proper operation of the unit has been verified, remove any jumper wires that were required for testing.
  25. Close the electrical compartment door.
  26. Replace all exterior panels.
- Refer to page 56 for the Start-up Checklist.


### Pilot Burner Adjustment

The pilot burner is orificed to burn properly with an inlet pressure of 6-7" W.C. on natural gas and 11-14" W.C. on propane gas, but final adjustment must be made after installation. If the pilot flame is too long or large, it is possible that it may cause soot and/or impinge on the heat exchanger causing failure. If the pilot flame is shorter than shown, it may cause poor ignition and result in the controls not opening the combination gas control. A short flame can be caused by a dirty pilot orifice. Pilot flame condition should be observed periodically to assure trouble-free operation.

#### To Adjust the Pilot Flame

1. Create a call for heat from the thermostat.
2. Remove the cap from the pilot adjustment screw. For location, see the combination gas control literature supplied with unit.
3. Adjust the pilot length by turning the screw in or out to achieve a soft steady flame 3/4" to 1" long and encompassing 3/8"-1/2" of the tip of the thermocouple or flame sensing rod (See Figure 18.1).
4. Replace the cap from the pilot adjustment screw.

Figure 18.1 - Correct Pilot Flame

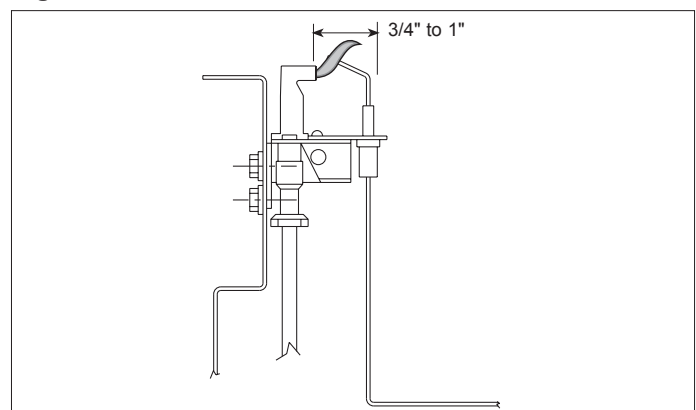

# START-UP PROCEDURE

## Main Burner Adjustment


The gas pressure regulator (integral to the combination gas control) is adjusted at the factory for average gas conditions. It is important that gas be supplied to the duct furnace in accordance with the input rating on the serial plate. Actual input should be checked and necessary adjustments made after the duct furnace is installed. Over-firing, a result of too high an input, reduces the life of the appliance and increases maintenance. Under no circumstances should the input exceed that shown on the serial plate.

Measuring the manifold pressure is done at the tee in the manifold or at the pressure tap of the gas valve for standard gas string. (See Figure 19.1).


### To Adjust the Manifold Pressure

1. Move the field installed manual shut-off valve to the "OFF" position.
2. Remove the 1/8" pipe plug in the pipe tee or gas valve and attach a water manometer of "U" tube type which is at least 12" high.
3. Move the field installed manual gas shut-off valve to the "ON" position.
4. Create a high fire call for heat from the thermostat.
5. Determine the correct high fire manifold pressure. For natural gas 3.5" W.C., for propane gas 10" W.C. Adjust the main gas pressure regulator spring to achieve the proper manifold pressure (for location, see the combination gas control literature supplied with unit).
6. If the unit has Electronic Modulation gas controls (determine from the Model Identification Digit 12), the low fire gas pressure needs to be adjusted. Using Figure 19.2 for item number locations, this is accomplished as follows:
  - a. Disconnect power.
  - b. Remove all wires from Maxitrol Amplifier terminal "3" or duct furnace terminal "43" (if available).
  - c. Turn on power at the disconnect switch.
  - d. Remove the maximum adjustment screw (4), spring (5), and plunger (8). A small magnet is useful for this purpose. CAUTION - The plunger is a precision part. Handle carefully to avoid marring or picking up grease and dirt. Do not lubricate.
  - e. Using minimum adjusting screw (9), adjust low fire manifold pressure to 0.56" W.C. for natural gas and 1.6" W.C. for propane gas.
  - f. Replace plunger and spring retainer, spring, and maximum adjusting screw in proper order.
  - g. Using maximum adjustment screw (4), adjust high fire manifold pressure to 3.5" W.C. for natural gas and 10" W.C. for propane gas.
  - h. Disconnect power.
  - i. Replace cover plate (2) and re-install all wires from Maxitrol amplifier terminal "3" or duct furnace terminal "43".
7. After adjustment, move the field installed manual shut-off valve to the "OFF" position and replace the 1/8" pipe plug.
8. After the plug is in place, move the field installed manual shut-off valve to the "ON" position and recheck pipe plugs for gas leaks with soap solution.

**Figure 19.1 - Checking Manifold Pressure with "U" Tube Manometer**

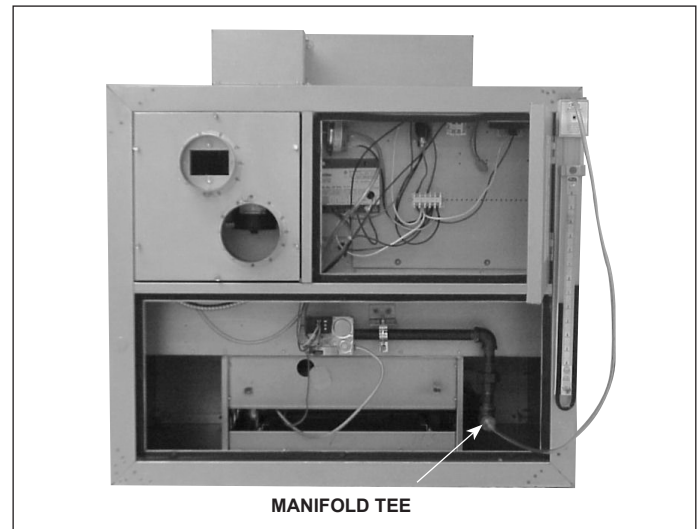

**Figure 19.2 - Maxitrol Modulating Valve Adjustments**

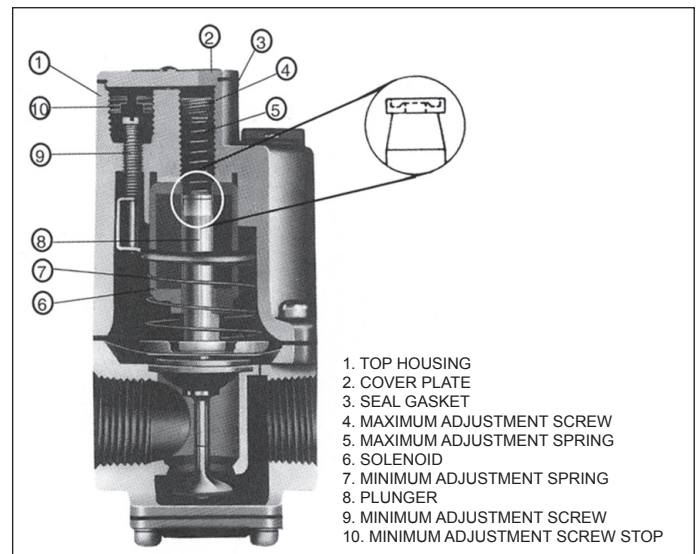

## Air Shutter Adjustment

Proper operation provides a soft blue flame with a well-defined inner core. A lack of primary air will reveal soft yellow-tipped flames. Excess primary air produces short, well-defined flames with a tendency to lift off the burner ports. For both natural and propane gas, the air shutters can be adjusted to control the burner flame height. The air shutters can be accessed by reaching behind the manifold tee in Figure 19.1. The larger models may require the removal of the manifold (see Manifold Assembly Removal).

Adjusting the primary combustion air is achieved by resetting the primary air shutters (See Figure 52.2). Prior to flame adjustment, operate duct furnace for about fifteen minutes. The main burner flame can be viewed after loosening and pushing aside the gas designation disc on the side of the burner box.

1. To increase primary air, loosen the air shutter set screws and move the air shutters closer to the manifold until the yellow tipped flames disappear and a clean blue flame with a well defined inner cone appears.
2. To decrease primary air, move the air shutters away from the manifolds until flames no longer lift from burner ports, but being careful not to cause yellow tipping.
3. Re-tighten set screws after adjustment.


# START-UP PROCEDURE

## Blower Adjustments

If blower fan speed changes are required, adjust motor sheave as follows:


1. Refer to page 39 to determine correct blower speed according to job requirements, then proceed with steps 2 through 8.
2. Loosen motor base and take belt off of motor sheave.
3. Loosen set screw on outer side of adjustable motor sheave.

**Figure 20.1 - Motor Sheave Adjustment**

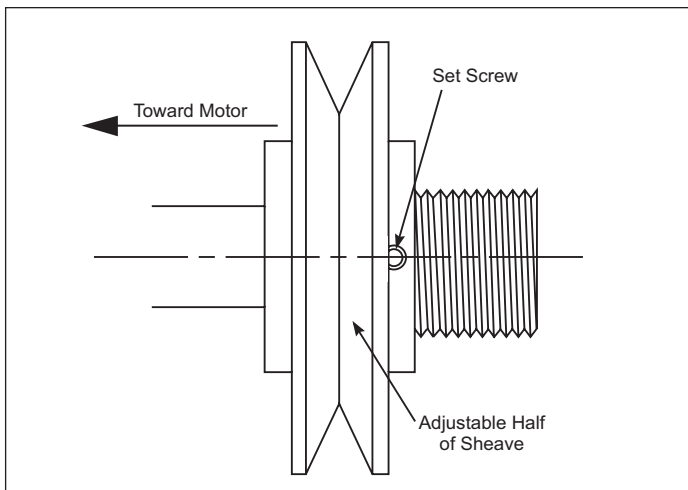

4. Turn outer side of motor sheave clockwise until motor sheave is fully closed.
5. From fully closed position, turn outer side of motor sheave counterclockwise until the proper number of turns open are achieved.
6. Retighten motor sheave set screw, replace belt and retighten motor base. Motor base should be shifted for proper belt tension which is 3/4" deflection with about 5 lbs. of force.

**Figure 20.2 - Belt Tension Adjustment**

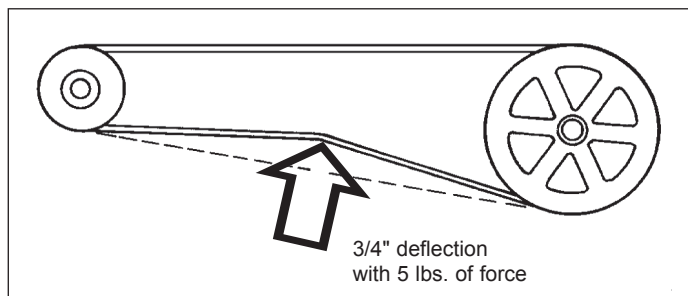

7. Recheck blower rpm after adjustment.  
**NOTE:** Do not fire unit until blower adjustment has been made or unit may cycle on high limit control.
8. Check motor amps. Do not exceed nameplate amps shown on motor nameplate.

## Lubrication Recommendations


The blower can be provided with either spider or pillow block bearings. Spider bearings are permanently lubricated and do not require lubrication. Pillow block bearings are shipped greased from the factory but will require lubrication. The bearings should be checked and lubricated before each heating season but a more frequent lubrication schedule may be required based on the environment in which the unit is installed, and the frequency of the equipment operation. Shell Alvania #2 lubricant is recommended.

## Damper Linkage Adjustment

If the unit is provided with a return air damper, to prevent shipping damage, the return air damper linkage is disconnected and the damper closed. Before operating the unit, the fresh and return air dampers must be connected. This is accomplished by the following:

1. The damper actuator should be de-energized and the fresh air damper in a fully closed position.
2. Open the return air damper in a fully open position.
3. Slide the connecting rod into the ball joint on the blade arm with the return air damper fully open. See Figure 20.3.
4. Tighten the 5/16" hex head screw on the ball joint.

**Figure 20.3 - Damper Linkage Adjustment**

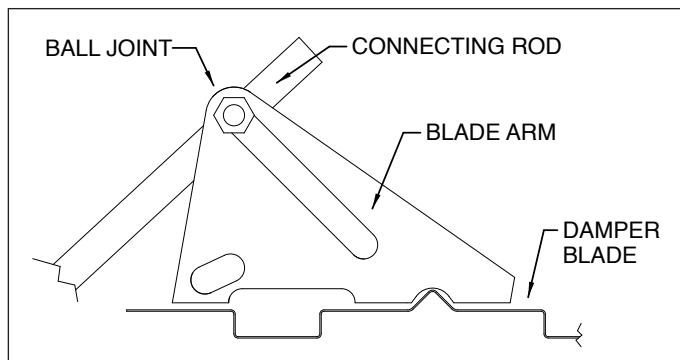

## Cooling Coil Operation

1. Proper air distribution is vital to coil performance. Air flow anywhere on the coil face should not vary by more than 20%.
2. Air velocities should be maintained between 200 and 550 feet per minute.
3. For chilled fluid coils, fluid velocities should be maintained within the recommended values of 1 to 8 feet per second (fps) for Water and 1 to 6 fps for Glycol solutions.

# START- UP PROCEDURE

## Control Operating Sequence

### IMPORTANT

To prevent premature heat exchanger failure, with all control systems, a blower starting mechanism must be provided so that the blower is running or energized within 45 seconds of the gas control operation.

Indoor duct furnaces are supplied with intermittent pilot systems with continuous retry, which both the main burner and pilot burner are turned off 100% when the thermostat is satisfied. On a call for heat, the system will attempt to light the pilot for 70 seconds. If the pilot is not sensed for any reason, the ignition control will wait for approximately six minutes with the combination gas control closed and no spark. After six minutes, the cycle will begin again. After three cycles, some ignition controllers lockout for approximately one hour before the cycle begins again. This will continue indefinitely until the pilot flame is sensed or power is interrupted to the system.

**Note:** Gas Control Options (see page 23) could change the listed sequence of operation based on their function. The descriptions given are for the basic duct furnace.

## Single Furnace Controls

### Staged Control (Digit 12=1 or 2):

These units utilize a single- or two-stage combination gas valve, an ignition control, and a low voltage thermostat.

### Electronic Modulating Control (Digit 12=4, 7, or 8):

These units utilize a single-stage combination gas valve, an electronic modulating gas valve, a modulating amplifier, an ignition control, and one of the following:

- Modulating room thermostat
- Modulating duct thermostat with remote temperature set point adjuster
- Building Management System (BMS) signal by others (an inverted signal where 0 VDC or 4 mA is high fire and 10 VDC or 20 mA is low fire).

The control operating sequence for all units is as follows:

1. The thermostat calls for heat. For BMS controlled units, the BMS closes a heat enable contact at the unit.
2. The power exhaustor relay is energized starting the power exhaustor motor. Once the motor has reached full speed, the differential pressure switch closes. The power exhaustor pre-purge time delay relay then closes after 20 to 40 seconds and energizes the gas control circuit.
3. The pilot valve opens and the spark igniter sparks in an attempt to light the pilot. (If the unit was not provided with a time delay relay, the blower starts).
4. Once the pilot is lit, the flame sensor proves the pilot and stops the spark igniter from sparking.
5. The main gas valve is opened and the main burner is controlled as follows:
  - a. **Single-Stage Units:** The main burner is lit to 100% full fire.
  - b. **Two-Stage Units:** The main burner is lit to 50% fire. If the temperature at the thermostat continues to fall, the thermostat will call for high stage heat and the main burner is lit to 100% full fire.
  - c. **Modulating Thermostat (Room or Duct):** The main gas valve is opened 100% and the burner firing rate is modulated between 40% and 100% full fire. A resistance signal (8000 to 12000 ohms) in the thermostat is converted by the modulating amplifier to an inverted DC voltage

(0VDC for high fire to 12 VDC for low fire). The output voltage is applied to the modulating gas valve to control the gas flow to the main burner. The modulating valve is modulated open or closed based on the voltage from the amplifier (less gas flow required = higher voltage, more gas flow required = lower voltage).

**Note:** When modulating duct sensing is utilized, a room override thermostat can be added. When the room override calls for heat, the burner modulates to full fire operation until the room override is satisfied. The unit then reverts back to duct sensing control. When equipped with both, either the duct sensor or the room override thermostat can call for heat.

- d. **BMS Signal:** The main gas valve is opened 100% and the burner firing rate is modulated between 40% and 100% full fire. A BMS 0-10VDC or 4-20mA signal (inverted, such that 0 VDC or 4 mA is high fire and 10 VDC or 20 mA is low fire) is converted by the signal conditioner/modulating amplifier into an inverted DC voltage (0VDC for high fire to 12 VDC for low fire). The output voltage is applied to the modulating gas valve to control the gas flow to the main burner. The signal conditioner can accept a 0-10 VDC signal when all the dip switches are in the "OFF" position and 4-20 mA signal when all the dip switches are in the "ON" position. The modulating valve is modulated open or closed based on the voltage from the amplifier (less gas flow required = higher voltage, more gas flow required = lower voltage), which correlates to the control signal from the BMS.

**Note:** For further information regarding the operation of any of the electronic modulating system options above, consult the literature provided with the unit.

6. If the unit was provided with a time delay relay, the blower starts after 30 to 45 seconds.
7. The unit continues to operate until the thermostat is satisfied, Once satisfied:
  - a. **Single-Stage Units:** Both the main and pilot valves close 100%.
  - b. **Two-Stage Units:** Once the high stage of the thermostat is satisfied, the main valve closes to 50% fire. The unit continues to operate until the low stage thermostat is satisfied, at which time both the main and pilot valves close 100%.
  - c. **Electronic Modulation Units:** The unit continues to operate in this manner until the thermostat is satisfied or the BMS heat enable contact opens. Power is then cut to both the main and pilot valves, closing them 100% and stopping gas flow to the main and pilot burners.
8. If the unit was not provided with a time delay relay, the blower stops immediately. If the unit was provided with a time delay relay, the blower stops after 30 to 45 seconds.

# START-UP PROCEDURE

## Multiple Furnace Controls

### Staged Control (Digit 12=1):

For control of multiple staged units, each furnace would be individually controlled. Refer to the section for Single Furnace Controls, Staged Control (Digit 12=1 or 2).

### Electronic Modulating Control (Digit 12=4):

These units are the same as Electronic Modulating Gas Controls – Single Furnace (Digit 12=4) except the Master unit features a modulating amplifier capable of driving multiple modulating gas valves for systems with a Master and up to two Slave units. Slave units do not have a modulating amplifier.

The units would be controlled by one of the following:

- Modulating room thermostat
- Modulating duct thermostat with remote temperature set point adjuster

The sequence of operation for Electronic Modulating Gas Controls - Master/Slave is the same as Electronic Modulating Gas Controls - Single Furnace. The modulating amplifier sends an equal voltage signal to all of the modulating gas valves so that they modulate at the same percentage, between 40% and 100% full fire.

### Electronic Modulating Control (Digit 12=7, or 8):

For control of multiple electronic modulation units for BMS control, each furnace would be individually controlled. Refer to the section for Single Furnace Controls, Electronic Modulation Control (Digit 12=7 or 8).

## Variable Air Movement Applications

Units may be supplied with variable frequency drives for applications where variable air volume is required. The minimum air flow may be varied between 30 and 100% of the full speed air flow depending on the controls selection of the unit. Due to the extra restrictions of the controller all selections must be performed with the AccuSpec configuration software. Within AccuSpec, three variable frequency drive speed control changeover options are available:

1. Two speed which may be controlled by a manual high/low switch which may be factory mounted on the control panel or shipped loose for field installation or by exhaust fan interlocks.
2. Floating building pressure sensing which utilizes a photohelic pressure controller to adjust the building pressure by varying the amount of makeup air supplied to the the space.
3. Building management control which allows for an external signal of 0-10VDC of 4-20mA to adjust the unit airflow.


The allowable minimum CFM of the system can be 66% of the minimum listed CFM in Table 31.1 if the unit is applied as follows:

1. The unit is provided with 2-stage or electronic modulating gas controls.
2. The unit is provided with a discharge air thermostat.
3. The system does not include a room thermostat.

The discharge air thermostat will prevent the unit from firing above the allowable 100°F rise when the unit is at or above the minimum CFM by monitoring the discharge air and going to low fire. A room thermostat, because it is located remote from the unit, could cause the unit to over-fire.

## OPTIONS - FACTORY INSTALLED

**Figure 23.1 - Factory Mounted Option Locations**

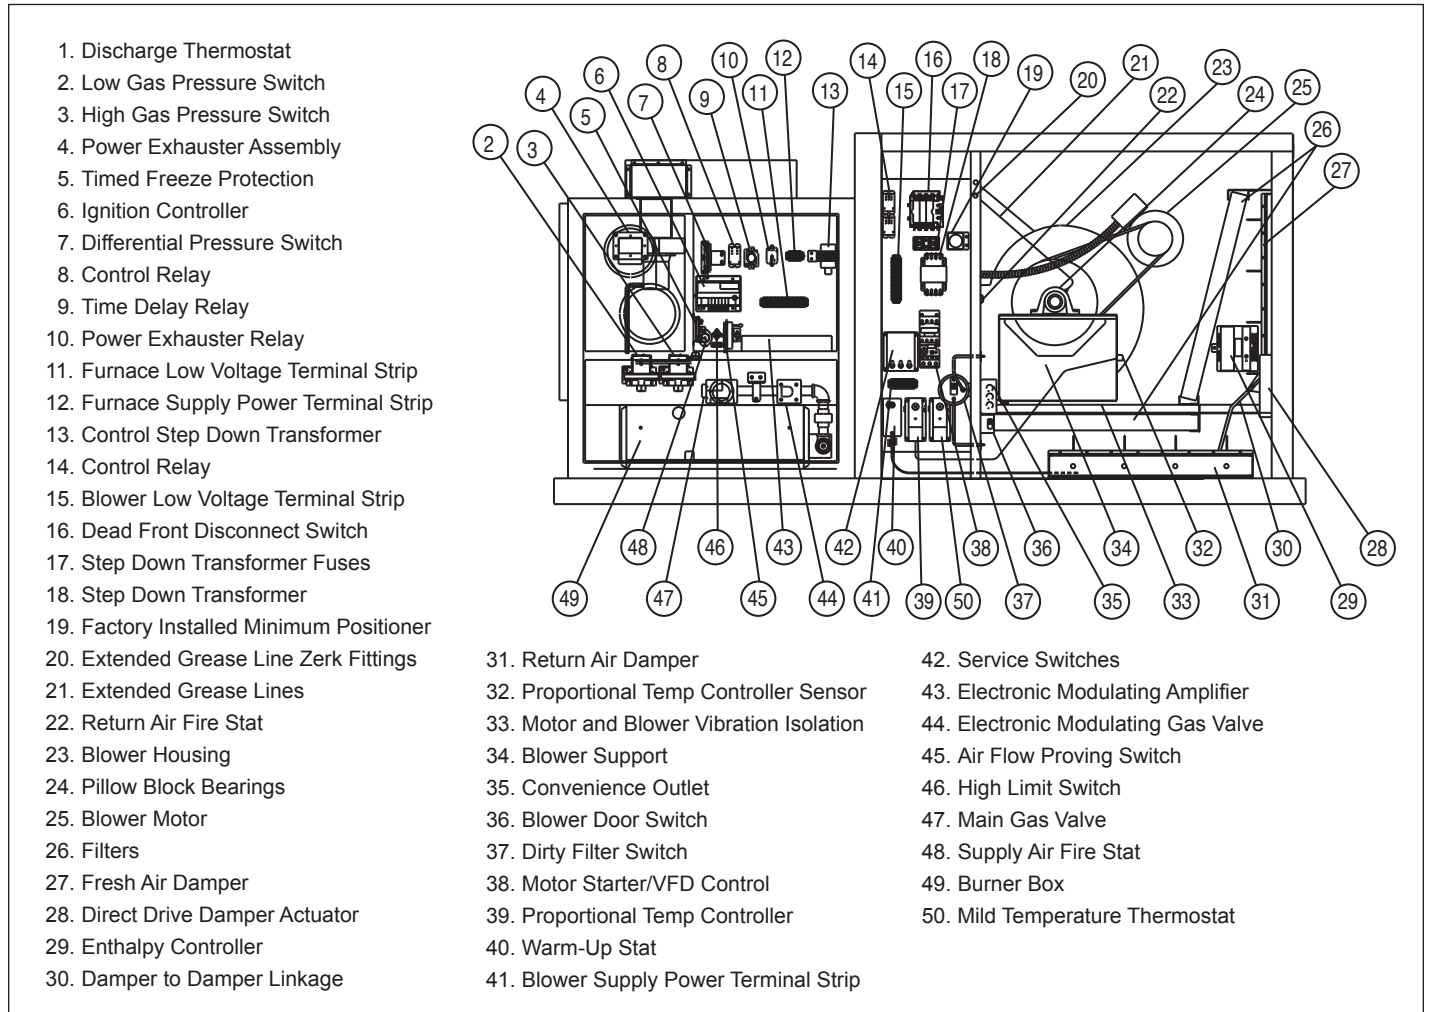


All units include the standard (STD) features. The unit must be reviewed to determine the optional (OPT) features that may have been supplied with the unit.

### (1) Discharge Thermostat – (OPT) (Not Shown)

The discharge thermostat is field installed in the discharge air stream of the unit. For additional information, refer to the thermostat vendor literature provided in the literature packet with the unit. Model Sizes 500-960 contain multiple furnaces so multiple thermostats/sensors may be included. The thermostat(s) provided can be one of the following:

- a) Two-stage Capillary Type Thermostat – The thermostat includes a thermostat body and capillary to be field installed in duct work. The thermostat body contains the discharge air set point adjuster that must be field set.

**Figure 23.2 - Two-Stage Capillary Type Thermostat**

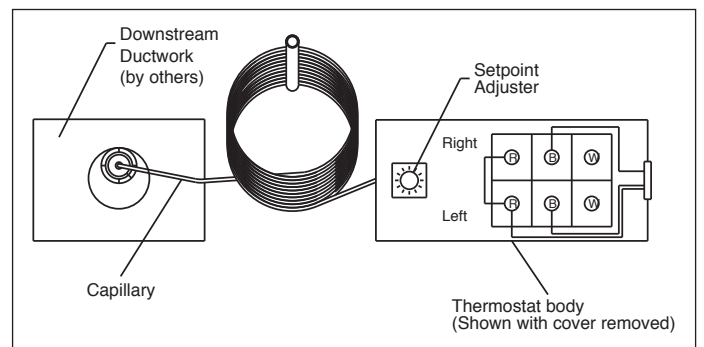

## OPTIONS

- b) Two-stage Electronic Type Thermostat - Includes a field installed discharge air sensor. The thermostat body is field installed remotely and includes the discharge air set point adjuster that must be field set. Refer to Literature 5-577 latest revision.

**Figure 24.1 - Two-Stage Electronic Type Thermostat Sensor**



- c) Electronic Modulating Discharge Air Thermostat – Includes a field installed mixing tube and discharge air sensor field installed in duct work. The set point adjuster is field installed remotely and must be field set. Refer to Literature 5-578 latest revision.

**Figure 24.2 - Electronic Modulating Discharge Air Thermostat**



### (2) Low Gas Pressure Switch – (OPT)

The low gas pressure switch is factory installed in the duct furnace above the gas train. The switch monitors the gas pressure upstream of all the gas controls and shuts off the electric supply to the ignition controller and combination gas valve if low gas pressure is experienced. This will shut off all gas flow to the burner. The switch has an automatic reset so that if the gas pressure is interrupted and then is returned, the switch will automatically allow the unit to operate when gas conditions are returned to the allowable range of the pressure switch. The pressure switch range is 2" to 14" W.C. and should be set to insure that the minimum inlet gas pressure is available (6" W.C. for natural gas, 11" W.C. for propane gas).

### (3) High Gas Pressure Switch – (OPT)

The high gas pressure switch is factory installed in the duct furnace above the gas train. The switch monitors the gas pressure downstream of all the gas controls and shuts off the electric supply to the ignition controller and combination gas valve if high gas pressure is experienced right before the manifold. This will shut off all gas flow to the burner. The switch has a manual reset so that if the gas pressure is too high, a service person must check the unit to make sure that none of

**Figure 24.3 - Low or High Gas Pressure Switch**



the gas controls have been damaged by the high gas pressure and then reset the switch to allow the unit to operate when gas conditions are returned to the allowable range of the pressure switch. The pressure switch range is 2" to 16" W.C. and should be set to insure that the maximum manifold gas pressure is not exceeded (3.5" W.C. for natural gas, 10" W.C. for propane gas).


### (4) Power Exhauster Assembly - (STD)

The power exhauster is factory installed in the duct furnace section. On a call for heat, the power exhauster creates a combustion draft through the duct furnace prior to the pilot being energized. The draft is proven through a differential pressure switch that closes when the motor reaches full speed. For information about venting, refer to the Installation - Venting section.

### (5) Timed Freeze Protection – (OPT)

The timed freeze protection system is factory installed in the duct furnace electrical junction box with the sensor (30°-75°F adjustable) factory installed in the discharge air stream. On initial start-up, the timed delay in the system allows the unit to go through the normal ignition sequence. The timed delay is a manual reset switch and adjustable for 1-10 minutes. In the event that the unit fails to fire after this period, the discharge air sensor will sense the cold air and will shut down the entire unit.

**Figure 24.4 - Timed Freeze Protection Module**

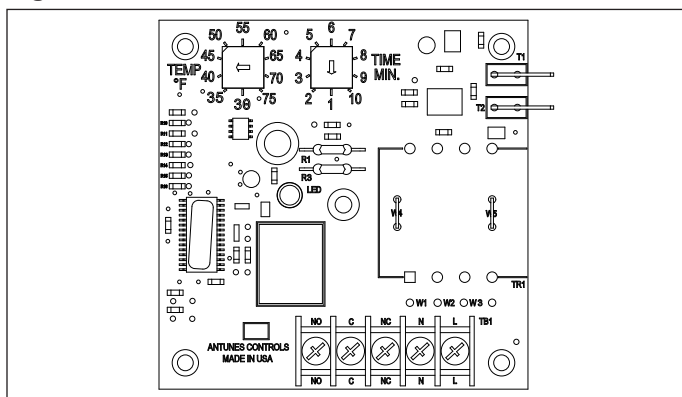

### (6) Ignition Controller – (STD)

The ignition controller is factory installed in the duct furnace electrical junction box with the spark ignitor and sensor located on the burner.

For both natural and propane gas units, the ignition controller is 100% shut-off with continuous retry. On a call for heat, the system will attempt to light the pilot for 70 seconds. If the pilot is not sensed for any reason, the ignition control will wait for approximately six minutes with the combination gas control closed and no spark. After six minutes, the cycle will begin again. After three cycles, some ignition controllers lockout for approximately one hour before the cycle begins again. This will continue indefinitely until the pilot flame is sensed or power is interrupted to the system.

## OPTIONS

### (7) Differential Pressure Switch - (STD)

The differential pressure switch is factory installed in the duct furnace electrical junction box. The differential pressure switch monitors the pressure differential between the duct furnace vent discharge and the atmosphere. The purpose of the differential pressure switch is to cut power to the gas controls if a positive vent pressure is not measured by the switch. This could be caused by a blocked combustion air inlet vent pipe.

### (8) Control Relay - (OPT)

The control relay is factory installed in the duct furnace electrical junction box. The relay has a 24V coil with double-pole, double throw (DPDT) contacts. Refer to the unit wiring diagram for the function of the switching operation of the relay. The two normally open and two normally closed contacts are rated for a maximum of 30 amps @ 115V/1Ph.

### (9) Time Delay Relay - (STD)

The time delay relay is factory installed in the duct furnace electrical junction box. The time delay relay allows the gas controls to operate for approximately 30 seconds before the blower starts. This allows the heat exchanger a warm up period so that the initial delivered air coming out of the ductwork is not cool. The time delay relay also keeps the motor running for approximately 30 seconds after the call for heat has been satisfied to remove the residual heat from the heat exchanger. For single phase units below 1-1/2 Hp, the time delay relay controls the motor directly. For single phase units 1-1/2 Hp and greater and all three phase units, the time delay relay controls the motor starter.

### (10) Power Exhauster Relay - (STD)

The control relay is factory installed in the duct furnace electrical junction box. The relay has a 24V coil with single-pole single throw (SPST) contacts. On a call for heat, the relay coil is energized resulting in the contacts energizing the power exhauster motor.

### (11) Furnace Low Voltage Terminal Strip - (STD)

The furnace low voltage terminal strip is located in the duct furnace electrical junction box. The terminal strip is labeled to match the electrical wiring diagram provided with the unit. Low voltage labeling ranges from terminal numbers 1 to 79. All field wiring connections should be made to the top side of the terminals to prevent miswiring by modifying the factory wiring which is made to the bottom of the terminal strip.

### (12) Furnace Supply Power Terminal Strip - (STD)

The furnace supply power terminal strip is located in the duct furnace electrical junction box. The terminal strip is labeled to match the electrical wiring diagram provided with the unit. Supply power labeling ranges from terminal numbers 80 to 99. All field wiring connections should be made to the bottom side of the terminals to prevent miswiring by modifying the factory wiring which is made to the top of the terminal strip.

### (13) Control Step Down Transformer - (STD)

The control step down transformer is located in the duct furnace electrical junction box. The transformer is used to step down the supply power (115V, 208V, 230V, 460V, 575V) to 24V. This transformer is used to control the gas controls, damper actuator, motor starter, etc. Refer to the unit model number to determine the volt- amp (VA) capacity of the duct furnace. The 15th digit indicates the VA (See Model Nomenclature).

### (14) Control Relay - (OPT)

The control relay is factory installed in the electrical section. See description of Option 8 for additional details.

### (15) Blower Low Voltage Terminal Strip - (STD)

The blower low voltage terminal strip is located in the electrical section. The terminal strip is labeled to match the electrical wiring diagram provided with the unit. Low voltage labeling ranges from terminal numbers 1 to 79. All field wiring connections should be made to the right side of the terminals to prevent miswiring by modifying the factory wiring which is made to the left side of the terminal strip.


### 16) Dead Front Disconnect Switch - (OPT)

## ! WARNING

When the dead front disconnect switch is in the "OFF" position, supply power remains energized at the blower supply power terminal strip and the top of the dead front disconnect switch. When providing service on or near these terminals, building supply power to the unit should be de-energized.

The dead front disconnect switch is factory installed in the electrical section. The disconnect switch is designed so that it must be turned "OFF" before entry to the electrical control cabinet can be obtained (See Figure 25.1). When in the "OFF" position, power is disconnected to all unit wiring electrically following the switch (See Warning). For servicing the unit, the disconnect switch can be manually overridden by using a wrench and turning the disconnect switch shaft 90° clockwise (See Figure 25.1). Fusible and circuit breaker switches available. For fusible switches, Class "J" time delay fuses must be field provided matching the fuse size listed on the Model Identification plate.

Figure 25.1 - Dead Front Disconnect Switch Assembly

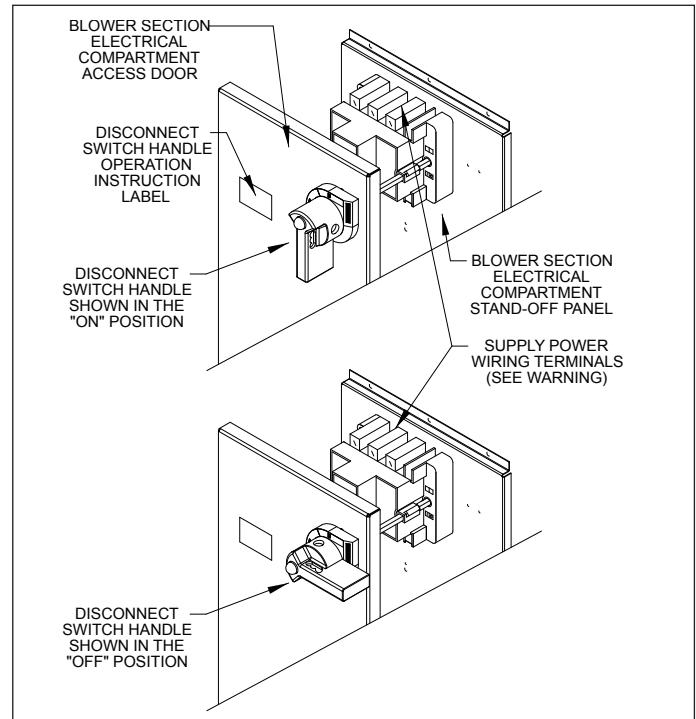

### (17) Step Down Transformer Fuses - (OPT)

The transformer fuses are factory installed in the electrical section. The fuses are included to protect the transformer. Fuses included.

### (18) Step Down Transformer - (OPT)


The step down transformer is factory installed in the electrical section. The transformer is required for power exhausted units with a supply voltage of 460V/3Ph and 575V/3Ph.

### (19) Factory Installed Minimum Positioner - (OPT)

The factory installed minimum positioner is installed in the electrical section and is used with a modulating damper actuator to set the minimum percentage of outside air. The minimum positioner dial is manually set between 0 to 100% resulting in a 2 to 10 VDC signal being sent to the damper actuator. When used in conjunction with the Proportional Temp Controller, the positioner sets the minimum outside air percentage and the Proportional Temp Controller then modulates between the minimum position and 100% outside air.

## OPTIONS

**Figure 26.1 - Minimum Positioner**

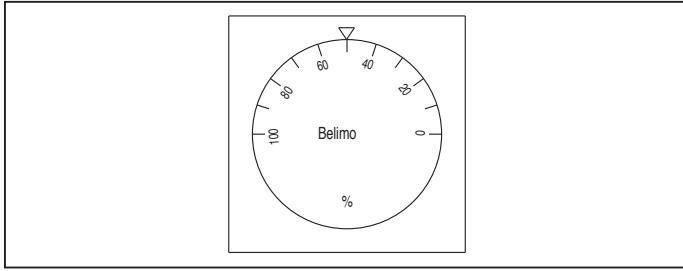

**(20, 21) Extended Grease Lines – (OPT)**

The extended grease lines (21) are factory installed in the blower section and include Zerk® grease fittings (20) factory installed on the exterior corner post between the electrical and blower sections. This option allows the pillow block bearings to be lubricated with a grease gun without requiring the service personnel to remove both blower doors to access the bearings. Refer to Lubrication Recommendations for lubricant recommendations.

**(22) Return Air Fire Stat – (OPT)**

The return air fire stat is factory installed in the electrical section with the sensor in the return air stream. In case of elevated temperatures in the return air stream, the manual reset switch shuts down the entire unit. If the limit temperature is exceeded, a service person must inspect the unit for the cause of the high discharge temperature, take corrective action, and then reset the switch.

**(23) Blower Housing – (STD)**

The blower housing is factory installed in the blower section. The blower housing contains a double width, double inlet (DWDI) blower wheel so both sides of the blower must be free from obstructions for proper operation. For Right Hand units (Digit 9 = R), during operation the blower wheel should rotate in the clockwise direction when viewed from the service side of the unit. For Left Hand units (Digit 9 = L), during operation the blower wheel should rotate in the counterclockwise direction when viewed from the service side of the unit. If necessary, interchange supply power wiring to reverse blower rotation.

**(24) Pillow Block Bearings – (OPT)**

The blower bearings are factory installed in the blower section. The blower can be provided with either spider or pillow block bearings. Spider bearings are permanently lubricated and do not require lubrication. Pillow block bearings are shipped non-greased from the factory and require lubrication before start-up. For lubrication recommendations, see Lubrication Recommendations.

**(25) Blower Motor – (STD)**

The blower motor is factory installed in the blower section. The blower motor can be provided in a variety of supply voltages, frame types, and motor horsepower. Refer to the model nomenclature to determine the type of motor provided. The blower motor is supplied with an adjustable sheave that can be used to increase/decrease the blower RPM. For instructions on changing the blower RPM, refer to Blower Adjustments.

**(26) Filters – (OPT)**

When filters are supplied with the unit, a rack and the filters are factory installed in the blower section. The unit can be supplied with 1" or 2" permanent filters, 2" FARR® Aeropleat MERV 7 or 2" FARR® 30/30 MERV 8 filters. For filter replacement, refer to Maintenance.

**(27) Fresh Air Damper – (OPT)**

When a fresh air damper is supplied with the unit, the damper is factory installed in the blower section. The fresh air damper is used as an outside air shut-off damper, so ultra low leak, Class II leakage resistance (less than 10 CFM/ft<sup>2</sup> at 1" W.C.) dampers with self-compensating stainless steel side seals and santoprene and galvanized steel blade seals are used.

**(28) Direct Drive Damper Actuator – (OPT)**


The direct drive damper actuator is factory installed in the blower section on the side of the fresh air damper. The actuator controls the position of the fresh air damper. The return air damper, if provided, is controlled by the damper linkage between the two dampers. All damper actuators are low voltage (24V). For Right Hand units (Digit 9 = R), during operation the actuator should rotate in the counterclockwise direction when viewed from the service side of the unit. For Left Hand units (Digit 9 = L), during operation the actuator should rotate in the clockwise direction when viewed from the service side of the unit. Three different types of dampers actuators can be provided: Two-position, Modulating, and Floating.

**Two-position Damper Actuator:** A two-position damper actuator is provided with Air Control options DA, EA and EQ (Digits 20 & 21). The two-position damper actuator provides open/closed operation of the fresh air damper. When the damper is energized, the fresh air damper is opened to 100% outside air in 75 seconds (for outside air percentages lower than 100%, refer to the following section, "Setting the Damper Limiter"). All two-position damper actuators are spring return, so when the damper is de-energized, the fresh air damper will spring closed. All two-position dampers include auxiliary switches (one normally open and one normally closed) that reverse when the damper actuator is at 85° rotation (adjustable).

**Setting the Damper Limiter:** The two-position damper limiter is factory set to prevent the outside air damper from opening 100%. Field adjustment of the two-position damper limiter is accomplished by the following:

1. Determine the amount of damper rotation required (Percentage of outside air).
2. Locate the angle of rotation limiter on the actuator so that its edge lines up with the degree graduation on the actuator face which corresponds with the required rotation. (See Figure 26.2 which is shown at 50% rotation limit.)
3. Position the limiter back to the desired position, making sure the locating "teeth" on the limiter are engaged into the locating holes on the actuator.
4. Fasten the limiter to the actuator using the screw provided.
5. Test the damper rotation either manually with the manual crank or apply power. Re-adjust if necessary.
6. If the damper end switch is being used in the control circuit and needs to be adjusted for the new minimum position, refer to the next section, "Adjusting the Damper End Switch".

**Figure 26.2 - Two-position Damper Actuator and Limiter**

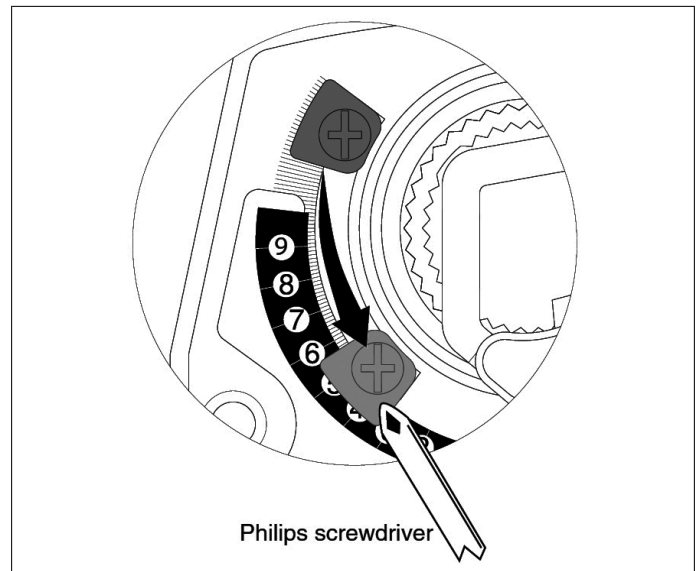


## OPTIONS

### Adjusting the Damper End Switch

If the damper limiter was adjusted in the previous section, it may be required to adjust the Damper End Switch as follows:

- 1 The actuator must be in its fail-safe position.
2. Insert the crank handle into the torx shaped hole located in the center of the adjustable switch pointer as shown in Figure 27.1.
3. Gently rotate the crank until the switch pointer is at the desired switch point in degrees as shown.

**Figure 27.1 - Adjusting the Damper End Switch**

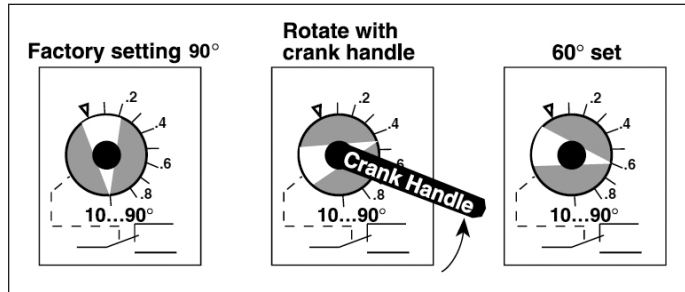

**Modulating Damper Actuator:** A modulating damper actuator is provided with Air Control options GA, GB, GC, GD, GE, GG, GH, GJ, GK and GM (Digits 20 & 21). The modulating damper actuator provides incremental operation of the fresh air damper (The return air damper is controlled by the fresh air damper position). Full 90° rotation of the modulating actuator requires 150 seconds. All modulating damper actuators operate using a 0-10 Vdc input signal (Air Control GB utilizes a resistor to convert from a 4-20 mA to 0-10 Vdc) from a damper controller. All modulating damper actuators are spring return, so when the damper is de-energized, the fresh air damper will spring closed.

**Floating Damper Actuator:** A floating damper actuator is provided with Air Control option HP (Digits 20 & 21). The floating damper actuator provides forward and reversing damper operation in response to contact closures from the space pressure controller. When the space pressure is above the desired set point, a high pressure contact on the space pressure controller energizes the damper to drive the fresh air damper closed. When the space pressure is below the desired set point, a low pressure contact on the space pressure controller energizes the damper to drive the fresh air damper open. When the space pressure is between the high and low set points, the damper “floats” at the fresh air percentage that satisfied the space pressure controller. Full 90° rotation of the floating actuator requires 150 seconds. For additional information on the space pressure controller, refer to Literature 5-585.

The damper actuator is designed to “float” and therefore it is not spring return. When the unit is de-energized under normal operation, the fresh air damper is closed by a relay contact closure which electrically drives the damper closed. If the supply power to the unit is interrupted before the damper actuator can drive closed, the fresh air damper will remain open. The damper can be manually closed through the use of the manual override switch on the floating damper actuator.

### (29) Enthalpy Controller – (OPT)

An enthalpy controller is provided with Air Control option GJ (Digits 20 & 21) and factory installed in the blower section. The purpose of the enthalpy controller is to use outside air for cooling, whenever possible, to reduce compressor operation of the mechanical cooling system. The economizer functions as a true first stage of cooling and provides maximum fuel economy during the cooling cycle.

The components used for the Enthalpy Economizer are:

- **Enthalpy Economizer Controller.** The Enthalpy Controller is used in conjunction with the Enthalpy Sensor and a Mixed Air Temperature sensor. The controller is factory mounted in the blower control cabinet.
- **Outside Air Enthalpy Sensor.** The sensor provides a signal in relation to enthalpy (temperature and humidity) of the outside air. The sensor is installed in the outside air stream.
- **Mixed Air Temperature Sensor.** The sensor is factory installed in the blower section to sense the mixed air temperature of the fresh and return air streams.

### Typical Sequence of Operation

#### Heating or Ventilation Mode

When the space thermostat calls for heat or the fan is on without a call for cooling (ventilation mode), the economizer is automatically locked out and holds the outdoor air damper at the minimum position setting. The minimum position adjustment keeps the outdoor air damper from closing completely during system operation to provide ventilation in both the heating and cooling modes.

#### Cooling Mode

When the space thermostat calls for cooling, the system operates as follows:

#### Outdoor Air Enthalpy is Below Changeover Set Point

1. The outdoor air damper is proportioned open (and the return air damper is proportioned closed) to maintain a temperature of 53°F (default, adjustable) at the mixed temperature air sensor.
2. During economizer operation, mechanical cooling is operated by the second stage of the cooling on the space thermostat.

#### Outdoor Air Enthalpy is Above Changeover Set Point

1. The outdoor air damper is closed to its minimum position.
2. A call for cooling from the space thermostat brings on mechanical cooling.

For complete details on the Enthalpy Economizer controller setup and operation, please refer to the latest revision of Modine publication 5-598, “Setup Instructions, Enthalpy Economizer Controller”.

**Figure 27.2 - Enthalpy Controller**



## OPTIONS

### (30) Damper to Damper Linkage – (OPT)

Units with fresh and return air dampers include a damper actuator that controls the fresh air damper. The return air damper position is controlled by the fresh air damper through the connecting rod. For adjustment, refer to Damper Linkage Adjustment.

### (31) Return Air Damper – (OPT)

When a return air damper is supplied with the unit, the damper is factory installed in the blower section. The return air damper is used as an air balancing damper so low leak, Class III leakage resistance (less than 40 CFM/ft<sup>2</sup> at 1" W.C.) dampers with self-compensating stainless steel side seals and santoprene blade seals are used.


### (32) Proportional Temperature Controller Sensor – (OPT)

A proportional temperature controller sensor is provided with Air Control options GG, GH, GK or GM (Digits 20 & 21) and factory installed in the blower section. The sensor provides the mixed air temperature signal to the A350P Proportional Temperature Controller which is mounted in the electrical section.

### (33) Motor and Blower Vibration Isolation – (STD)

The motor vibration isolation is factory installed in the blower section below the blower support bracket. The four (4) 13/32"-neoprene vibration mount grommet provides isolation of the blower housing and motor from the blower support channels. The blower vibration isolation is factory installed in the blower section between blower discharge and the blower duct connection. The blower duct connection is not rigidly mechanically fastened and the 1/4" thick gasketing around the duct transition provides vibration isolation.

**Figure 28.1 - Blower/Motor Vibration Isolation**

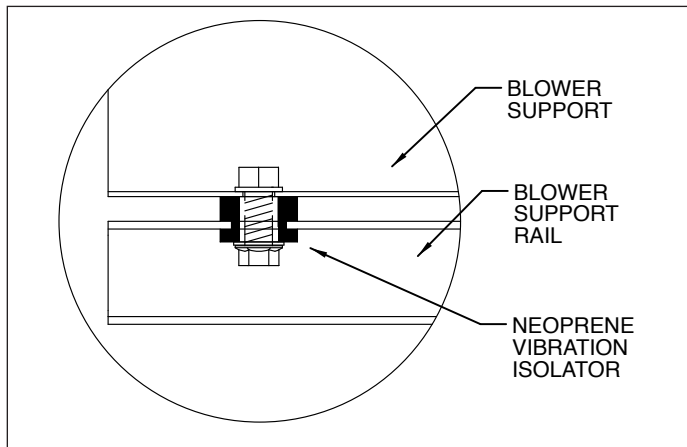

### (34) Blower Support – (STD)

The blower supports are factory installed in the blower section. The blower supports are used to rigidly support the weight of the blower and motor during operation and shipping.

### (35) Convenience Outlet – (OPT)

## ⚠ WARNING


Do not perform service on the convenience outlet without disconnecting its power supply. The convenience outlet power supply is separate from main power supply to the unit. When the main disconnect switch is de-energized, the convenience outlet power supply remains energized.

The convenience outlet is factory installed in the blower section for providing power for 115V service equipment (trouble light, power tools, etc.). The 115V ground fault circuit interrupter (GFCI) is rated for 15 amps and includes test and reset switches. A separate field supplied 115V/1Ph power supply must be routed through the electrical section wall into the back of the convenience outlet junction box.

### (36) Blower Door Switch – (OPT)

The blower door switch is factory installed inside the blower section door on the access side of the unit. When the blower section door is removed, the momentary switch is released and interrupts power to the low voltage circuit. For single phase units 1-1/2 Hp and less, the door switch de-energizes a relay that controls blower motor operation. For three phase units and single phase units 1-1/2 Hp and greater, the door switch de-energizes the motor starter that controls blower motor operation. For servicing, the switch is equipped with an override position that can be manually pulled out to override the switch. (See Figure 28.2).

**Figure 28.2 - Blower Door Switch with Manual Override**

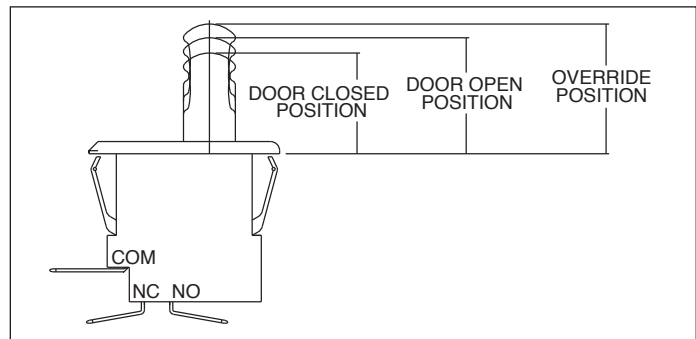

### (37) Dirty Filter Switch – (OPT)

The dirty filter pressure switch is factory installed in the electrical section. The dirty filter pressure switch monitors the pressure differential between the two sides of the filters. When the filters become dirty, the differential pressure increases and trips the pressure switch which energizes a light on the remote monitoring panel. The pressure differential switch must be field set because setting the switch requires the blower to be in operation and the ductwork to be installed.


#### Setting the Dirty Filter Switch

The range of the dirty filter pressure switch is adjustable between 0.17" to 5.0" W.C.

1. Ensure that the unit filters are clean. Clean or replace if necessary.
2. Connect the leads of a continuity tester to the NO and C terminals of the dirty filter pressure switch. See Figure 29.1
3. Set the thermostat so that there is a call for heat. This should fire the burner and the blower should start.
4. Turn the set screw of the pressure switch clockwise until it stops. This will set the pressure at 5.0" W.C. and the continuity tester should be sensing an open circuit.
5. Begin turning the screw counterclockwise until the continuity tester senses a closed circuit. This determines the base pressure of the system.
6. Turn the screw clockwise until the continuity tester senses an open circuit and then one additional full turn (This is approximately 0.25" W.C.) This will allow for the increase in static pressure due to dirty filters.

## OPTIONS

**Figure 29.1 - Dirty Filter Pressure Switch and Air Flow Proving Switch**

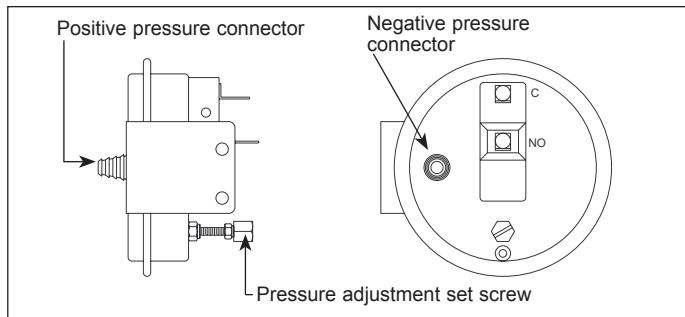

### (38) Motor Starter – (OPT)

The motor starter is factory installed in the electrical section. A motor starter is required for all three phase motors and single phase motors 1-1/2 Hp and greater. The motor starter current set point dial is factory set to the motor full load amp draw listed on the motor nameplate.

### (38) Variable Frequency Drive – (OPT)


The VFD controller adjusts the motor rpm to vary the unit air flow. The minimum air flow may be varied between 30 and 100% of the full speed air flow depending on the controls selection of the unit. The control changeover options are two speed, floating building pressure sensing, and building management control.

The overload module of the motor starter is designed to trip to protect the motor from exceeding the nameplate amps. If the motor exceeds the amp draw on the current set point dial, the trip condition is indicated by a red color in the trip indicator window. The motor starter can be placed in the automatic or manual reset positions. Automatic reset is accomplished by depressing the “RESET” button and turning the button 1/4 turn. When in the automatic reset position, if the overload module trips, the module will reset itself once the overload relay has cooled. In the manual reset position, if the overload module trips, the “RESET” button must be depressed before the blower can operate.

The contractor module includes one (1) normally open auxiliary contact. The contact rating is 10 amps.

If the factory installed motor starter option was not ordered with a unit that has a three phase motor or single phase motor 1-1/2 Hp or greater, a motor starter must be field supplied and installed.

**Figure 29.2 - Motor Starter**

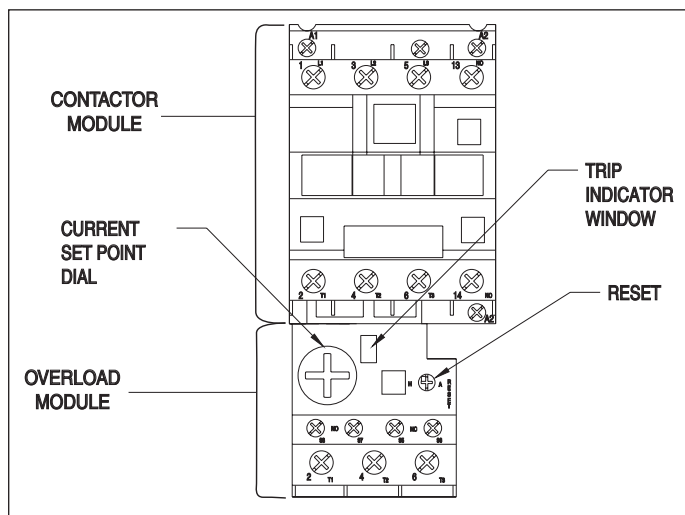

### (39) Proportional Temperature Controller – (OPT)

A proportional temperature controller is provided with Air Control options GG, GH, GK or GM (Digits 20 & 21) and factory installed in the electrical section. The controller compares the mixed air temperature set point and the mixed air temperature from the Proportional Temperature Controller Sensor. The controller sends a 2-10 Vdc signal to the modulating damper actuator in order to maintain the set point. The controller includes a set point dial that must be field set to the desired mixed air temperature (typically 55°F).

**Figure 29.3 - Proportional Temperature Controller**



### (40) Warm-Up Stat – (OPT)

A warm-up stat is provided with Air Control options GK or GM (Digits 20 & 21) and factory installed in the electrical section with the sensor in the return air stream. The warm-up thermostat monitors the return air temperature to the unit and prevents the fresh air dampers from opening until the temperature of the return air has reached the desired set point (typically 65°F or 5°F below the room temperature).


### (41) Blower Supply Power Terminal Strip – (STD)

The blower supply power terminal strip is located in the electrical section. The terminal strip is labeled to match the electrical wiring diagram provided with the unit. Supply power labeling ranges from terminal numbers 80 to 99. All field wiring connections should be made to the bottom side of the terminals to prevent miswiring by modifying the factory wiring which is made to the top of the terminal strip.

### (42) Service Switches – (OPT)

The service switches are factory installed in the electrical section. The service switches allow for service personnel to independently test operation of the damper, blower, and furnace without using jumper wires. The switches override the remote monitoring panel and/or thermostats to energize each component directly. All switches need to be reset to the “OFF” position after testing otherwise the components will remain energized.

**Figure 29.4 - Service Switches**

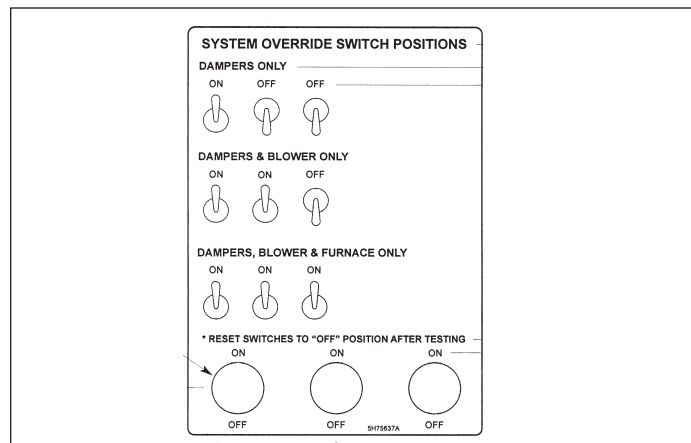

## OPTIONS

### (43) Electronic Modulation Amplifier – (OPT)

An electronic modulation amplifier is provided factory installed in the duct furnace electrical junction box when the unit is equipped with Electronic Modulating Gas Controls (Digit 12 = 4). The amplifier processes the thermostat temperature and set point signals to modulate the firing rate between 40% to 100% full fire. For additional information, refer to Control Operating Sequence.

### (44) Electronic Modulating Gas Valve – (OPT)

An electronic modulating gas valve is provided factory installed in the duct furnace gas train when the unit is equipped with Electronic Modulating Gas Controls (Digit 12 = 4, 7, or 8). The gas valve modulates the firing rate between 40% to 100% full fire based on the input signal from the Electronic Modulation Amplifier or Signal Conditioner. For additional information, refer to Control Operating Sequence.

### (45) Air Flow Proving Switch – (OPT)

The air flow proving switch is factory installed in the duct furnace electrical junction box. The air flow proving switch monitors the pressure differential between the duct furnace and the atmosphere. The purpose of the air flow proving switch is to cut power to the gas controls if a positive pressure is not measured by the switch. This could be caused by a lack of air movement through the heat exchanger.

**NOTE:** The air flow proving switch will prevent any heat exchanger warm-up because the gas controls can not be energized until air flow is proven.

### Setting the Air Flow Proving Switch

The range of the air flow proving switch is adjustable between 0.17" to 5.0" W.C.

1. Set the thermostat so that there is a call for heat. This should start the blower and then the burner ignition sequence.
2. Turn the set screw of the pressure switch clockwise until it stops. This will set the pressure at 5.0" W.C.
3. Turn the screw counter-clockwise until the gas controls light and then one additional full turn (This is approximately 0.25" W.C.). This will allow for dirty filters or any other slight static pressure increases in the system.

### (46) High Limit Switch

Automatic – (STD)

The automatic reset high limit switch is factory installed in the duct furnace electrical junction box. If the limit temperature is exceeded, the gas controls are de-energized until the switch is cooled.

Manual – (OPT)

The manual reset high limit switch is factory installed in place of the standard automatic reset high limit switch located in the duct furnace electrical junction box. In case of a failure of the blower motor, blockage of the inlet air, etc., the manual reset switch prevents the unit from cycling on the high limit. If the limit temperature is exceeded, a service person must inspect the unit for the cause of the high discharge temperature, take corrective action, and then reset the switch.

### (47) Main Gas Valve – (STD)

The main gas valve is factory installed in the duct furnace gas train. The main gas valve provides the pilot, regulator, main gas, and manual shutoff functions. For additional information, see the supplier literature included with the unit.

### (48) Supply Air Fire Stat – (OPT)

The supply air fire stat is factory installed in the duct furnace electrical junction box with the sensor in the discharge air stream. In case of elevated temperatures in the supply air stream, the manual reset switch shuts down the entire unit. If the limit temperature is exceeded, a service person must inspect the unit for the cause of the high discharge temperature, take corrective action, and then reset the switch.

### (49) Burner Box – (STD)

The burner box is located in the duct furnace section and contains the burner and pilot assembly. The burner box includes an access panel for removal of the burner for inspection and servicing.

### (50) Mild Temperature Thermostat - (OPT)

The mild temperature thermostat is designed to lockout the burner during mild weather conditions which prevents the burner from cycling. The thermostat must be field set to the desired mild temperature condition. Refer to the latest revision of Modine publication 75-540, "Installation/Setup Instructions, Electronic Mild Temperature Thermostat" for additional instructions.

### (Not Shown) Circuit Analyzer – (OPT)

The circuit analyzer is factory installed on the door of the electrical section. The circuit analyzer is used to quickly assist service personnel in troubleshooting by monitoring the unit firing sequence and vital operating steps. Lights will come on as a point of electrical operation is passed and proven. If any light is not lit, that is the point where failure occurred.

### Figure 30.1 - Circuit Analyzer

Circuit analyzer tagging will vary based on the unit ordered. Circuit analyzer shown is for reference only.



# GENERAL PERFORMANCE DATA

**Table 31.1 - General Performance Data - Models With Blower**

| Model Size<br>(Digits 4-6) | Btu/Hr<br>Input ① | Btu/Hr<br>Output ① | Blower Style/Size |       | Minimum<br>CFM ② | Maximum<br>CFM | Temperature Rise (°F) |         |
|----------------------------|-------------------|--------------------|-------------------|-------|------------------|----------------|-----------------------|---------|
|                            |                   |                    | (Digit 16)        | Size  |                  |                | Maximum               | Minimum |
| 75                         | 75,000            | 60,750             | A or B            | 9-7   | 562              | 1800           | 100                   | 31      |
|                            |                   |                    | C or D            | 9-9   | 750              | 2813           | 75                    | 20      |
| 100                        | 100,000           | 81,000             | C or D            | 9-9   | 750              | 3000           | 100                   | 25      |
|                            |                   |                    | E or F            | 12-12 | 1500             | 3750           | 50                    | 20      |
| 125                        | 125,000           | 101,250            | C or D            | 9-9   | 937              | 3000           | 100                   | 31      |
|                            |                   |                    | E or F            | 12-12 | 1500             | 4688           | 63                    | 20      |
| 150                        | 150,000           | 121,500            | C or D            | 9-9   | 1125             | 3000           | 100                   | 38      |
|                            |                   |                    | E or F            | 12-12 | 1250             | 5550           | 90                    | 20      |
| 175                        | 175,000           | 141,750            | C or D            | 9-9   | 1312             | 3000           | 100                   | 44      |
|                            |                   |                    | E or F            | 12-12 | 1312             | 5550           | 100                   | 24      |
| 200                        | 200,000           | 162,000            | C or D            | 9-9   | 1500             | 3000           | 100                   | 50      |
|                            |                   |                    | E or F            | 12-12 | 1750             | 5000           | 86                    | 30      |
|                            |                   |                    | G or H            | 15-15 | 1750             | 6500           | 86                    | 23      |
| 225                        | 225,000           | 182,250            | C or D            | 9-9   | 1687             | 3000           | 100                   | 56      |
|                            |                   |                    | E or F            | 12-12 | 1750             | 5000           | 96                    | 34      |
|                            |                   |                    | G or H            | 15-15 | 1750             | 6500           | 96                    | 26      |
| 250                        | 250,000           | 202,500            | E or F            | 12-12 | 1875             | 5500           | 100                   | 34      |
|                            |                   |                    | G or H            | 15-15 | 1875             | 6500           | 100                   | 29      |
|                            |                   |                    | I, J, or K        | 18-18 | 3000             | 9375           | 63                    | 20      |
| 300                        | 300,000           | 243,000            | E or F            | 12-12 | 2250             | 5500           | 100                   | 41      |
|                            |                   |                    | G or H            | 15-15 | 2250             | 6500           | 100                   | 35      |
|                            |                   |                    | I, J, or K        | 18-18 | 3000             | 11250          | 75                    | 20      |
| 350                        | 350,000           | 283,500            | E or F            | 12-12 | 2625             | 5500           | 100                   | 48      |
|                            |                   |                    | G or H            | 15-15 | 2625             | 6500           | 100                   | 40      |
|                            |                   |                    | I, J, or K        | 18-18 | 4000             | 12000          | 66                    | 22      |
| 400                        | 400,000           | 324,000            | E or F            | 12-12 | 3000             | 5500           | 100                   | 55      |
|                            |                   |                    | G or H            | 15-15 | 3000             | 6500           | 100                   | 46      |
|                            |                   |                    | I, J, or K        | 18-18 | 4000             | 12000          | 75                    | 25      |
| 500                        | 500,000           | 405,000            | G or H            | 15-15 | 3125             | 6500           | 120                   | 58      |
|                            |                   |                    | I, J, or K        | 18-18 | 4000             | 9375           | 94                    | 40      |
|                            |                   |                    | L                 | 20-18 | 4000             | 9375           | 94                    | 40      |
| 600                        | 600,000           | 486,000            | G or H            | 15-15 | 3750             | 6500           | 120                   | 69      |
|                            |                   |                    | I, J, or K        | 18-18 | 4000             | 11250          | 113                   | 40      |
|                            |                   |                    | L                 | 20-18 | 5000             | 11250          | 90                    | 40      |
| 700                        | 700,000           | 567,000            | G or H            | 15-15 | 4375             | 6500           | 120                   | 81      |
|                            |                   |                    | I, J, or K        | 18-18 | 4375             | 13000          | 120                   | 40      |
|                            |                   |                    | L                 | 20-18 | 4375             | 13000          | 120                   | 40      |
| 800                        | 800,000           | 648,000            | G or H            | 15-15 | 5000             | 6500           | 120                   | 92      |
|                            |                   |                    | I, J, or K        | 18-18 | 5000             | 13000          | 120                   | 46      |
|                            |                   |                    | L                 | 20-18 | 5000             | 14500          | 120                   | 41      |
| 840                        | 1,050,000         | 850,500            | I, J, or K        | 18-18 | 6562             | 13000          | 120                   | 61      |
|                            |                   |                    | L                 | 20-18 | 6562             | 13000          | 120                   | 61      |
| 960                        | 1,200,000         | 972,000            | I, J, or K        | 18-18 | 7500             | 13000          | 120                   | 69      |
|                            |                   |                    | L                 | 20-18 | 7500             | 14500          | 120                   | 62      |

① Ratings are shown for elevations up to 2,000 feet. For higher elevations, refer to section "Considerations for Elevation" on page 10.

② For Variable Air Movement Applications, see page 22.

# GENERAL PERFORMANCE DATA

**Table 32.1 - Air Temperature Rise**

| Model Size | Btu/Hr Input ① | Btu/Hr Output ① | Air Temperature Rise Through Unit (°F) |        |        |        |        |        |        |       |       |       |
|------------|----------------|-----------------|----------------------------------------|--------|--------|--------|--------|--------|--------|-------|-------|-------|
|            |                |                 | 20                                     | 40     | 50     | 60     | 70     | 80     | 90     | 100   | 110   | 120   |
| 75         | 75,000         | 60,750          | 2,813                                  | 1,406  | 1,125  | 938    | 804    | 703    | 625    | 562   | -     | -     |
| 100        | 100,000        | 81,000          | 3,750                                  | 1,875  | 1,500  | 1,250  | 1,071  | 938    | 833    | 750   | -     | -     |
| 125        | 125,000        | 101,250         | 4,688                                  | 2,344  | 1,875  | 1,563  | 1,339  | 1,172  | 1,042  | 937   | -     | -     |
| 150        | 150,000        | 121,500         | 5,500                                  | 2,813  | 2,250  | 1,875  | 1,607  | 1,406  | 1,250  | 1,125 | -     | -     |
| 175        | 175,000        | 141,750         | 5,500                                  | 3,281  | 2,625  | 2,188  | 1,875  | 1,641  | 1,458  | 1,312 | -     | -     |
| 200        | 200,000        | 162,000         | 6,500                                  | 3,750  | 3,000  | 2,500  | 2,143  | 1,875  | 1,667  | 1,500 | -     | -     |
| 225        | 225,000        | 182,250         | 6,500                                  | 4,219  | 3,375  | 2,813  | 2,411  | 2,109  | 1,875  | 1,687 | -     | -     |
| 250        | 250,000        | 202,500         | 9,375                                  | 4,688  | 3,750  | 3,125  | 2,679  | 2,344  | 2,083  | 1,875 | -     | -     |
| 300        | 300,000        | 243,000         | 11,250                                 | 5,625  | 4,500  | 3,750  | 3,214  | 2,813  | 2,500  | 2,250 | -     | -     |
| 350        | 350,000        | 283,500         | 12,000                                 | 6,563  | 5,250  | 4,375  | 3,750  | 3,281  | 2,917  | 2,625 | -     | -     |
| 400        | 400,000        | 324,000         | 12,000                                 | 7,500  | 6,000  | 5,000  | 4,286  | 3,750  | 3,333  | 3,000 | -     | -     |
| 500        | 500,000        | 405,000         | -                                      | 9,375  | 7,500  | 6,250  | 5,357  | 4,688  | 4,167  | 3,750 | 3,409 | 3,125 |
| 600        | 600,000        | 486,000         | -                                      | 11,250 | 9,000  | 7,500  | 6,429  | 5,625  | 5,000  | 4,500 | 4,091 | 3,750 |
| 700        | 700,000        | 567,000         | -                                      | 13,000 | 10,500 | 8,750  | 7,500  | 6,563  | 5,833  | 5,250 | 4,773 | 4,375 |
| 800        | 800,000        | 648,000         | -                                      | 14,500 | 12,000 | 10,000 | 8,571  | 7,500  | 6,667  | 6,000 | 5,455 | 5,000 |
| 840        | 1,050,000      | 850,500         | -                                      | -      | -      | 13,000 | 11,250 | 9,844  | 8,750  | 7,875 | 7,159 | 6,562 |
| 960        | 1,200,000      | 972,000         | -                                      | -      | -      | 14,500 | 12,857 | 11,250 | 10,000 | 9,000 | 8,182 | 7,500 |

① Ratings are shown for elevations up to 2000 feet. For higher elevations, refer to section "Considerations for Elevation" on page 9.

② Minimum Air Temperature Rise, Maximum Air Temperature Rise, and Maximum Discharge Air Temperature are as follows:

-For Model Sizes 75-400, Min Air Temp Rise is 20°F, Max Air Temp Rise is 100°F, and Max Discharge Air Temp is 150°F.

-For Model Sizes 500-800, Min Air Temp Rise is 40°F, Max Air Temp Rise is 120°F, and Max Discharge Air Temp is 150°F.

-For Model Sizes 840-960, Min Air Temp Rise is 60°F, Max Air Temp Rise is 120°F, and Max Discharge Air Temp is 150°F.

--Note that these are typical limits but may vary by Model Size. Refer to Table 31.1 for actual limits.

③ For Variable Air Movement Applications, see page 22.

## Air Temperature Limits

The maximum allowable discharge air temperature is 150°F. The maximum allowable air temperature rise per furnace for Low Air Temperature Rise Units is 60°F. All system units are designed for a maximum allowable total static pressure of 3.0" W.C.

# OPTION & ACCESSORY PRESSURE DROP DATA

Table 33.1 - Option & Accessory Pressure Drop Tables (in "W.C.) ①

| Unit Size                     | Digit 16    | CFM   | All Units               |                         |                                |                          | Weatherproof Unit Only  |                                        |                          |                                         |                    |                            |                     |
|-------------------------------|-------------|-------|-------------------------|-------------------------|--------------------------------|--------------------------|-------------------------|----------------------------------------|--------------------------|-----------------------------------------|--------------------|----------------------------|---------------------|
|                               |             |       | 1" Permanent<br>Filters | 2" Permanent<br>Filters | 2" Farr<br>Aeroleaf<br>Filters | 2" Farr 30/30<br>Filters | Evap Cooler<br>6" Media | Evap Cooler<br>6" Media<br>w/Prefilter | Evap Cooler<br>12" Media | Evap Cooler<br>12" Media<br>w/Prefilter | Downturn<br>Plenum | Rainhood and<br>Birdscreen | Discharge<br>Damper |
| 75                            | A,B,C,D     | 556   | 0.01                    | 0.01                    | 0.02                           | 0.03                     | 0.01                    | 0.05                                   | 0.02                     | 0.07                                    | 0.00               | 0.01                       | 0.00                |
|                               |             | 600   | 0.01                    | 0.01                    | 0.02                           | 0.03                     | 0.01                    | 0.05                                   | 0.02                     | 0.07                                    | 0.00               | 0.01                       | 0.01                |
|                               |             | 800   | 0.02                    | 0.01                    | 0.03                           | 0.04                     | 0.02                    | 0.08                                   | 0.04                     | 0.12                                    | 0.01               | 0.02                       | 0.01                |
|                               |             | 1000  | 0.02                    | 0.02                    | 0.04                           | 0.05                     | 0.03                    | 0.11                                   | 0.06                     | 0.17                                    | 0.01               | 0.03                       | 0.01                |
|                               |             | 1200  | 0.03                    | 0.02                    | 0.05                           | 0.06                     | 0.04                    | 0.14                                   | 0.08                     | 0.22                                    | 0.02               | 0.03                       | 0.01                |
|                               |             | 1400  | 0.03                    | 0.03                    | 0.06                           | 0.07                     | 0.06                    | 0.17                                   | 0.11                     | 0.29                                    | 0.03               | 0.04                       | 0.02                |
|                               |             | 1600  | 0.04                    | 0.04                    | 0.07                           | 0.09                     | 0.08                    | 0.21                                   | 0.15                     | 0.36                                    | 0.04               | 0.06                       | 0.02                |
|                               |             | 1800  | 0.04                    | 0.04                    | 0.08                           | 0.10                     | 0.10                    | 0.25                                   | 0.19                     | 0.44                                    | 0.05               | 0.07                       | 0.03                |
|                               |             | 2000  | 0.05                    | 0.05                    | 0.10                           | 0.11                     | 0.12                    | 0.30                                   | 0.23                     | 0.53                                    | 0.06               | 0.08                       | 0.03                |
|                               |             | 2300  | 0.06                    | 0.07                    | 0.11                           | 0.13                     | 0.16                    | 0.37                                   | 0.31                     | 0.68                                    | 0.08               | 0.11                       | 0.04                |
|                               |             | 2778  | 0.08                    | 0.09                    | 0.15                           | 0.16                     | 0.23                    | 0.51                                   | 0.45                     | 0.96                                    | 0.12               | 0.15                       | 0.06                |
| 100/125                       | C,D,E,F     | 741   | 0.01                    | 0.02                    | 0.02                           | 0.02                     | 0.01                    | 0.06                                   | 0.02                     | 0.08                                    | 0.00               | 0.03                       | 0.01                |
|                               |             | 1000  | 0.02                    | 0.02                    | 0.03                           | 0.04                     | 0.02                    | 0.08                                   | 0.04                     | 0.12                                    | 0.01               | 0.05                       | 0.01                |
|                               |             | 1500  | 0.03                    | 0.04                    | 0.05                           | 0.07                     | 0.04                    | 0.14                                   | 0.08                     | 0.23                                    | 0.02               | 0.07                       | 0.02                |
|                               |             | 2000  | 0.05                    | 0.06                    | 0.07                           | 0.10                     | 0.08                    | 0.21                                   | 0.15                     | 0.36                                    | 0.04               | 0.10                       | 0.03                |
|                               |             | 2500  | 0.07                    | 0.08                    | 0.10                           | 0.14                     | 0.12                    | 0.30                                   | 0.23                     | 0.53                                    | 0.07               | 0.13                       | 0.04                |
|                               |             | 3000  | 0.09                    | 0.11                    | 0.13                           | 0.19                     | 0.17                    | 0.40                                   | 0.34                     | 0.73                                    | 0.11               | 0.16                       | 0.05                |
|                               |             | 3500  | 0.11                    | 0.13                    | 0.16                           | 0.24                     | 0.23                    | 0.51                                   | 0.46                     | 0.97                                    | 0.15               | 0.19                       | 0.07                |
|                               |             | 4000  | 0.14                    | 0.16                    | 0.20                           | 0.30                     | 0.30                    | 0.63                                   | 0.60                     | 1.23                                    | 0.19               | 0.22                       | 0.09                |
|                               |             | 4500  | 0.17                    | 0.20                    | 0.25                           | 0.37                     | 4000 Max CFM Evap       |                                        |                          |                                         | 0.25               | 0.25                       | 0.11                |
|                               |             | 4630  | 0.17                    | 0.21                    | 0.26                           | 0.39                     |                         |                                        |                          |                                         | 0.26               | 0.26                       | 0.11                |
| 150/175                       | C,D,E,F     | 1111  | 0.01                    | 0.02                    | 0.03                           | 0.04                     | 0.01                    | 0.07                                   | 0.03                     | 0.09                                    | 0.02               | 0.02                       | 0.01                |
|                               |             | 1500  | 0.02                    | 0.03                    | 0.04                           | 0.05                     | 0.03                    | 0.10                                   | 0.05                     | 0.15                                    | 0.02               | 0.03                       | 0.01                |
|                               |             | 2000  | 0.03                    | 0.04                    | 0.06                           | 0.08                     | 0.04                    | 0.15                                   | 0.09                     | 0.24                                    | 0.04               | 0.05                       | 0.02                |
|                               |             | 2500  | 0.05                    | 0.06                    | 0.09                           | 0.11                     | 0.07                    | 0.20                                   | 0.14                     | 0.34                                    | 0.05               | 0.08                       | 0.02                |
|                               |             | 3000  | 0.06                    | 0.08                    | 0.11                           | 0.15                     | 0.10                    | 0.27                                   | 0.20                     | 0.46                                    | 0.07               | 0.10                       | 0.04                |
|                               |             | 3500  | 0.08                    | 0.11                    | 0.14                           | 0.18                     | 0.14                    | 0.34                                   | 0.27                     | 0.61                                    | 0.10               | 0.14                       | 0.05                |
|                               |             | 4000  | 0.11                    | 0.13                    | 0.18                           | 0.23                     | 0.18                    | 0.41                                   | 0.35                     | 0.77                                    | 0.13               | 0.18                       | 0.06                |
|                               |             | 4500  | 0.13                    | 0.16                    | 0.21                           | 0.27                     | 0.23                    | 0.50                                   | 0.45                     | 0.95                                    | 0.17               | 0.22                       | 0.08                |
|                               |             | 5000  | 0.16                    | 0.19                    | 0.25                           | 0.32                     | 0.28                    | 0.59                                   | 0.55                     | 1.15                                    | 0.21               | 0.27                       | 0.10                |
|                               |             | 5200  | 0.17                    | 0.21                    | 0.27                           | 0.34                     | 0.30                    | 0.63                                   | 0.60                     | 1.23                                    | 0.23               | 0.29                       | 0.11                |
|                               |             | 5556  | 0.19                    | 0.23                    | 0.30                           | 0.38                     | 5200 Max CFM for Evap   |                                        |                          |                                         | 0.26               | 0.33                       | 0.13                |
| 200/225                       | C,D,E,F,G,H | 1481  | 0.01                    | 0.02                    | 0.03                           | 0.03                     | 0.02                    | 0.08                                   | 0.04                     | 0.12                                    | 0.02               | 0.03                       | 0.01                |
|                               |             | 2000  | 0.01                    | 0.02                    | 0.04                           | 0.04                     | 0.03                    | 0.12                                   | 0.07                     | 0.19                                    | 0.03               | 0.05                       | 0.01                |
|                               |             | 2500  | 0.02                    | 0.04                    | 0.05                           | 0.06                     | 0.05                    | 0.17                                   | 0.10                     | 0.27                                    | 0.04               | 0.08                       | 0.02                |
|                               |             | 3000  | 0.03                    | 0.05                    | 0.07                           | 0.08                     | 0.08                    | 0.22                                   | 0.15                     | 0.36                                    | 0.06               | 0.10                       | 0.04                |
|                               |             | 3500  | 0.03                    | 0.06                    | 0.09                           | 0.10                     | 0.10                    | 0.27                                   | 0.20                     | 0.47                                    | 0.09               | 0.14                       | 0.05                |
|                               |             | 4000  | 0.05                    | 0.08                    | 0.11                           | 0.12                     | 0.13                    | 0.33                                   | 0.27                     | 0.60                                    | 0.11               | 0.18                       | 0.06                |
|                               |             | 4500  | 0.06                    | 0.10                    | 0.13                           | 0.15                     | 0.17                    | 0.40                                   | 0.34                     | 0.73                                    | 0.14               | 0.22                       | 0.08                |
|                               |             | 5000  | 0.07                    | 0.11                    | 0.16                           | 0.18                     | 0.21                    | 0.47                                   | 0.42                     | 0.89                                    | 0.18               | 0.27                       | 0.10                |
|                               |             | 5500  | 0.09                    | 0.14                    | 0.19                           | 0.21                     | 0.25                    | 0.55                                   | 0.50                     | 1.05                                    | 0.21               | 0.32                       | 0.12                |
|                               |             | 6000  | 0.11                    | 0.16                    | 0.22                           | 0.25                     | 0.30                    | 0.63                                   | 0.60                     | 1.23                                    | 0.26               | 0.38                       | 0.14                |
| 250/300<br>500/600            | E,F,G,H     | 6500  | 0.13                    | 0.18                    | 0.25                           | 0.28                     | 6000 Max CFM for Evap   |                                        |                          |                                         | 0.30               | 0.45                       | 0.16                |
|                               |             | 1852  | 0.03                    | 0.02                    | 0.05                           | 0.05                     | 0.02                    | 0.10                                   | 0.05                     | 0.15                                    | 0.02               | 0.07                       | 0.02                |
|                               |             | 2000  | 0.03                    | 0.03                    | 0.05                           | 0.06                     | 0.03                    | 0.11                                   | 0.06                     | 0.17                                    | 0.02               | 0.08                       | 0.02                |
|                               |             | 2500  | 0.04                    | 0.04                    | 0.07                           | 0.09                     | 0.04                    | 0.15                                   | 0.09                     | 0.24                                    | 0.03               | 0.09                       | 0.03                |
|                               |             | 3000  | 0.05                    | 0.06                    | 0.10                           | 0.11                     | 0.06                    | 0.19                                   | 0.13                     | 0.32                                    | 0.04               | 0.12                       | 0.04                |
|                               |             | 3500  | 0.07                    | 0.08                    | 0.12                           | 0.15                     | 0.09                    | 0.24                                   | 0.17                     | 0.41                                    | 0.06               | 0.14                       | 0.06                |
|                               |             | 4000  | 0.08                    | 0.10                    | 0.15                           | 0.18                     | 0.11                    | 0.29                                   | 0.23                     | 0.52                                    | 0.08               | 0.16                       | 0.07                |
|                               |             | 4500  | 0.10                    | 0.13                    | 0.18                           | 0.22                     | 0.15                    | 0.35                                   | 0.29                     | 0.64                                    | 0.10               | 0.19                       | 0.09                |
|                               |             | 5500  | 0.14                    | 0.19                    | 0.25                           | 0.31                     | 0.22                    | 0.48                                   | 0.43                     | 0.91                                    | 0.15               | 0.25                       | 0.13                |
|                               |             | 6500  | 0.19                    | 0.26                    | 0.34                           | 0.42                     | 0.30                    | 0.63                                   | 0.60                     | 1.23                                    | 0.21               | 0.31                       | 0.18                |
|                               | I,J,K,L     | 7250  | 0.23                    | 0.32                    | 0.41                           | 0.51                     | 6500 Max CFM for Evap   |                                        |                          |                                         | 0.27               | 0.37                       | 0.23                |
|                               |             | 1925  | 0.02                    | 0.01                    | 0.03                           | 0.03                     | 0.01                    | 0.05                                   | 0.02                     | 0.08                                    | 0.02               | 0.07                       | 0.02                |
|                               |             | 3000  | 0.03                    | 0.03                    | 0.05                           | 0.05                     | 0.03                    | 0.10                                   | 0.05                     | 0.15                                    | 0.04               | 0.12                       | 0.04                |
|                               |             | 4000  | 0.05                    | 0.05                    | 0.08                           | 0.09                     | 0.04                    | 0.15                                   | 0.09                     | 0.23                                    | 0.08               | 0.16                       | 0.07                |
|                               |             | 5000  | 0.08                    | 0.08                    | 0.11                           | 0.12                     | 0.07                    | 0.20                                   | 0.14                     | 0.34                                    | 0.12               | 0.22                       | 0.11                |
|                               |             | 6000  | 0.11                    | 0.11                    | 0.15                           | 0.16                     | 0.10                    | 0.26                                   | 0.20                     | 0.46                                    | 0.18               | 0.28                       | 0.16                |
|                               |             | 7000  | 0.15                    | 0.15                    | 0.19                           | 0.21                     | 0.14                    | 0.34                                   | 0.27                     | 0.61                                    | 0.25               | 0.35                       | 0.21                |
|                               |             | 8000  | 0.19                    | 0.20                    | 0.24                           | 0.27                     | 0.18                    | 0.41                                   | 0.35                     | 0.77                                    | 0.33               | 0.42                       | 0.28                |
|                               |             | 9000  | 0.24                    | 0.25                    | 0.30                           | 0.33                     | 0.23                    | 0.50                                   | 0.45                     | 0.95                                    | 0.42               | 0.51                       | 0.35                |
|                               |             | 10400 | 0.32                    | 0.33                    | 0.38                           | 0.42                     | 0.30                    | 0.64                                   | 0.60                     | 1.23                                    | 0.57               | 0.64                       | 0.47                |
| 350/400<br>700/800<br>840/960 | E,F,G,H     | 11111 | 0.36                    | 0.38                    | 0.43                           | 0.47                     | 10400 Max CFM for Evap  |                                        |                          |                                         | 0.66               | 0.71                       | 0.53                |
|                               |             | 2593  | 0.02                    | 0.02                    | 0.04                           | 0.04                     | 0.03                    | 0.10                                   | 0.05                     | 0.16                                    | 0.02               | 0.03                       | 0.01                |
|                               |             | 3000  | 0.02                    | 0.02                    | 0.05                           | 0.05                     | 0.04                    | 0.13                                   | 0.07                     | 0.20                                    | 0.03               | 0.04                       | 0.01                |
|                               |             | 3500  | 0.03                    | 0.03                    | 0.06                           | 0.06                     | 0.05                    | 0.16                                   | 0.10                     | 0.25                                    | 0.04               | 0.05                       | 0.01                |
|                               |             | 4000  | 0.03                    | 0.04                    | 0.07                           | 0.08                     | 0.06                    | 0.19                                   | 0.13                     | 0.32                                    | 0.05               | 0.07                       | 0.01                |
|                               |             | 4500  | 0.04                    | 0.05                    | 0.09                           | 0.10                     | 0.08                    | 0.23                                   | 0.16                     | 0.39                                    | 0.06               | 0.09                       | 0.02                |
|                               |             | 5000  | 0.05                    | 0.06                    | 0.10                           | 0.12                     | 0.10                    | 0.27                                   | 0.20                     | 0.47                                    | 0.07               | 0.11                       | 0.02                |
|                               |             | 5500  | 0.06                    | 0.07                    | 0.12                           | 0.14                     | 0.12                    | 0.31                                   | 0.24                     | 0.55                                    | 0.09               | 0.14                       | 0.03                |
|                               |             | 6000  | 0.06                    | 0.08                    | 0.14                           | 0.17                     | 0.15                    | 0.36                                   | 0.29                     | 0.64                                    | 0.10               | 0.17                       | 0.04                |
|                               |             | 6500  | 0.07                    | 0.10                    | 0.16                           | 0.19                     | 0.17                    | 0.40                                   | 0.34                     | 0.74                                    | 0.12               | 0.20                       | 0.04                |
|                               | I,J,K,L     | 7000  | 0.08                    | 0.11                    | 0.18                           | 0.22                     | 0.20                    | 0.45                                   | 0.39                     | 0.85                                    | 0.14               | 0.23                       | 0.05                |
|                               |             | 2593  | 0.02                    | 0.01                    | 0.02                           | 0.02                     | 0.02                    | 0.08                                   | 0.03                     | 0.11                                    | 0.02               | 0.03                       | 0.01                |
|                               |             | 3000  | 0.02                    | 0.02                    | 0.02                           | 0.03                     | 0.02                    | 0.09                                   | 0.04                     | 0.14                                    | 0.03               | 0.04                       | 0.01                |
|                               |             | 4000  | 0.03                    | 0.03                    | 0.04                           | 0.04                     | 0.04                    | 0.14                                   | 0.08                     | 0.22                                    | 0.05               | 0.07                       | 0.01                |
|                               |             | 5000  | 0.04                    | 0.04                    | 0.05                           | 0.06                     | 0.06                    | 0.19                                   | 0.12                     | 0.31                                    | 0.07               | 0.11                       | 0.02                |
|                               |             | 6000  | 0.06                    | 0.05                    | 0.07                           | 0.08                     | 0.09                    | 0.25                                   | 0.18                     | 0.42                                    | 0.10               | 0.17                       | 0.04                |
|                               |             | 7000  | 0.07                    | 0.07                    | 0.10                           | 0.11                     | 0.12                    | 0.31                                   | 0.24                     | 0.55                                    | 0.14               | 0.23                       | 0.05                |
|                               |             | 8000  | 0.09                    | 0.09                    | 0.12                           | 0.13                     | 0.16                    | 0.38                                   | 0.32                     | 0.70                                    | 0.19               | 0.30                       | 0.08                |
|                               |             | 9000  | 0.11                    | 0.12                    | 0.15                           | 0.16                     | 0.20                    | 0.46                                   | 0.40                     | 0.86                                    | 0.24               | 0.38                       | 0.10                |
|                               |             | 10000 | 0.13                    | 0.14                    | 0.18                           | 0.19                     | 0.25                    | 0.54                                   | 0.50                     | 1.04                                    | 0.30               | 0.48                       | 0.14                |
| 11050                         | 0.15        | 0.17  | 0.22                    | 0.23                    | 0.31                           | 0.64                     | 0.61                    | 1.24                                   | 0.36                     | 0.58                                    | 0.17               |                            |                     |
| 12000                         | 0.18        | 0.20  | 0.26                    | 0.27                    | 11050 Max CFM for Evap         |                          |                         |                                        | 0.43                     | 0.69                                    | 0.21               |                            |                     |
| 13000                         | 0.20        | 0.24  | 0.30                    | 0.31                    |                                |                          |                         |                                        | 0.51                     | 0.81                                    | 0.26               |                            |                     |

① Accessory / Option static pressure losses are approximate values only. Please consult the Accuspec selection software for static pressure losses at other than listed CFM.

BLOWER PERFORMANCE DATA

Table 34.1 - Unit Performance Tables ①②

| Unit Size | Digit 16 | Air Temp. Rise | CFM  | Total Static Pressure, "W.C. |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
|-----------|----------|----------------|------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
|           |          |                |      | 0.25                         |      | 0.50 |      | 0.75 |      | 1.00 |      | 1.25 |      | 1.50 |      | 2.00 |      | 2.50 |      | 3.00 |      |
|           |          |                |      | BHP                          | RPM  | BHP  | RPM  | BHP  | RPM  | BHP  | RPM  | BHP  | RPM  | BHP  | RPM  | BHP  | RPM  | BHP  | RPM  | BHP  | RPM  |
| 75        | A,B      | 100°F / -      | 556  | 0.09                         | 679  | 0.15 | 871  | 0.22 | 1031 | 0.29 | 1170 | 0.37 | 1296 | 0.45 | 1411 | 0.63 | 1617 | 0.81 | 1800 | 1.01 | 1968 |
|           |          | 79°F / -       | 700  | 0.14                         | 747  | 0.21 | 924  | 0.29 | 1074 | 0.37 | 1206 | 0.46 | 1327 | 0.55 | 1438 | 0.75 | 1638 | 0.95 | 1818 | 1.17 | 1982 |
|           |          | 69°F / -       | 800  | 0.18                         | 801  | 0.26 | 966  | 0.35 | 1109 | 0.44 | 1237 | 0.54 | 1354 | 0.64 | 1462 | 0.84 | 1658 | 1.06 | 1832 | 1.30 | 1996 |
|           |          | 56°F / -       | 1000 | 0.29                         | 917  | 0.39 | 1062 | 0.50 | 1192 | 0.60 | 1310 | 0.72 | 1419 | 0.83 | 1522 | 1.07 | 1709 | 1.32 | 1879 | -    | -    |
|           |          | 46°F / -       | 1200 | 0.45                         | 1042 | 0.57 | 1171 | 0.69 | 1289 | 0.82 | 1397 | 0.94 | 1499 | 1.08 | 1595 | 1.35 | 1773 | -    | -    | -    | -    |
|           |          | 40°F / -       | 1400 | 0.66                         | 1173 | 0.80 | 1288 | 0.94 | 1395 | 1.08 | 1495 | 1.23 | 1589 | 1.38 | 1680 | -    | -    | -    | -    | -    | -    |
|           |          | 35°F / -       | 1600 | 0.93                         | 1308 | 1.09 | 1412 | 1.25 | 1509 | 1.42 | 1601 | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 31°F / -       | 1800 | 1.28                         | 1445 | 1.46 | 1539 | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 69°F / -       | 800  | -                            | -    | 0.15 | 795  | 0.21 | 960  | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 56°F / -       | 1000 | -                            | -    | 0.20 | 822  | 0.28 | 975  | 0.36 | 1112 | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
| 75        | C,D      | 46°F / -       | 1200 | 0.19                         | 705  | 0.27 | 862  | 0.35 | 1003 | 0.44 | 1131 | 0.54 | 1250 | 0.65 | 1361 | -    | -    | -    | -    | -    | -    |
|           |          | 40°F / -       | 1400 | 0.27                         | 770  | 0.36 | 912  | 0.45 | 1041 | 0.55 | 1161 | 0.66 | 1273 | 0.77 | 1377 | 1.00 | 1572 | -    | -    | -    | -    |
|           |          | 35°F / -       | 1600 | 0.37                         | 839  | 0.47 | 968  | 0.57 | 1087 | 0.68 | 1199 | 0.80 | 1304 | 0.92 | 1403 | 1.17 | 1589 | 1.44 | 1760 | 1.72 | 1920 |
|           |          | 31°F / -       | 1800 | 0.49                         | 912  | 0.60 | 1030 | 0.72 | 1139 | 0.84 | 1244 | 0.96 | 1343 | 1.09 | 1437 | 1.36 | 1613 | 1.65 | 1777 | 1.94 | 1931 |
|           |          | 28°F / -       | 2000 | 0.65                         | 987  | 0.77 | 1095 | 0.90 | 1197 | 1.03 | 1295 | 1.16 | 1388 | 1.30 | 1477 | 1.59 | 1645 | 1.89 | 1802 | 2.20 | 1950 |
|           |          | 24°F / -       | 2300 | 0.94                         | 1104 | 1.08 | 1200 | 1.22 | 1292 | 1.37 | 1380 | 1.52 | 1465 | 1.67 | 1547 | 1.98 | 1703 | 2.31 | 1850 | 2.65 | 1990 |
|           |          | 20°F / -       | 2778 | 1.59                         | 1296 | 1.75 | 1377 | 1.92 | 1456 | 2.09 | 1532 | 2.26 | 1606 | 2.44 | 1679 | 2.80 | 1818 | -    | -    | -    | -    |
| 100/125   | C,D      | 100°F / -      | 741  | -                            | -    | 0.15 | 808  | 0.23 | 962  | 0.30 | 1093 | 0.38 | 1212 | 0.47 | 1320 | 0.60 | 1514 | 0.86 | 1686 | 1.07 | 1840 |
|           |          | 80°F/100°F     | 926  | 0.13                         | 670  | 0.21 | 846  | 0.29 | 993  | 0.38 | 1121 | 0.47 | 1236 | 0.56 | 1342 | 0.77 | 1532 | 0.99 | 1702 | 1.22 | 1856 |
|           |          | 62°F/77°F      | 1200 | 0.22                         | 758  | 0.31 | 916  | 0.41 | 1052 | 0.52 | 1173 | 0.62 | 1282 | 0.74 | 1384 | 0.97 | 1568 | 1.22 | 1733 | 1.48 | 1884 |
|           |          | 53°F/66°F      | 1400 | 0.30                         | 828  | 0.41 | 975  | 0.53 | 1103 | 0.64 | 1218 | 0.76 | 1323 | 0.89 | 1422 | 1.15 | 1600 | 1.42 | 1762 | 1.70 | 1910 |
|           |          | 41°F/51°F      | 1800 | 0.55                         | 982  | 0.69 | 1108 | 0.83 | 1220 | 0.98 | 1325 | 1.12 | 1422 | 1.27 | 1513 | 1.58 | 1681 | 1.90 | 1834 | 2.23 | 1976 |
|           |          | 34°F/42°F      | 2200 | 0.93                         | 1145 | 1.10 | 1254 | 1.27 | 1354 | 1.44 | 1449 | 1.61 | 1537 | 1.79 | 1621 | 2.15 | 1778 | 2.52 | 1923 | 2.90 | 2057 |
|           |          | 28°F/36°F      | 2600 | 1.45                         | 1315 | 1.65 | 1410 | 1.85 | 1500 | 2.05 | 1585 | 2.25 | 1666 | 2.46 | 1744 | 1.35 | 1638 | -    | -    | -    | -    |
|           |          | 25°F/31°F      | 3000 | 2.16                         | 1489 | 2.39 | 1573 | 2.61 | 1654 | 2.84 | 1731 | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 41°F/51°F      | 1800 | 0.28                         | 497  | 0.41 | 622  | 0.56 | 735  | 0.72 | 837  | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 34°F/42°F      | 2200 | 0.43                         | 553  | 0.58 | 662  | 0.75 | 762  | 0.93 | 855  | 1.12 | 942  | 1.33 | 1025 | -    | -    | -    | -    | -    | -    |
| 100/125   | E,F      | 28°F/36°F      | 2600 | 0.63                         | 614  | 0.81 | 710  | 1.00 | 800  | 1.20 | 885  | 1.41 | 965  | 1.63 | 1042 | -    | -    | -    | -    | -    | -    |
|           |          | 25°F/31°F      | 3000 | 0.91                         | 680  | 1.11 | 766  | 1.32 | 847  | 1.54 | 1731 | 1.77 | 997  | 2.01 | 1068 | 2.51 | 1202 | 3.04 | 1328 | 3.60 | 1446 |
|           |          | 22°F/27°F      | 3400 | 1.26                         | 748  | 1.48 | 825  | 1.72 | 899  | 1.96 | 970  | 2.21 | 1038 | 2.47 | 1104 | 3.01 | 1229 | 3.58 | 1347 | 4.17 | 1459 |
|           |          | 20°F/25°F      | 3704 | 1.58                         | 802  | 1.83 | 873  | 2.08 | 942  | 2.34 | 1008 | 2.60 | 1072 | 2.88 | 1135 | 3.45 | 1254 | 4.04 | 1367 | 4.67 | 1474 |
|           |          | - / 23°F       | 4100 | 2.09                         | 873  | 2.35 | 938  | 2.63 | 1001 | 2.91 | 1062 | 3.20 | 1122 | 3.49 | 1180 | 4.10 | 1291 | 4.74 | 1398 | -    | -    |
|           |          | - / 20°F       | 4630 | 2.93                         | 969  | 3.23 | 1028 | 3.53 | 1085 | 3.84 | 1140 | 4.16 | 1194 | 4.48 | 1247 | -    | -    | -    | -    | -    | -    |
| 150/175   | C,D      | 100°F/117°F    | 1111 | 0.19                         | 727  | 0.28 | 884  | 0.38 | 1023 | 0.48 | 1148 | 0.59 | 1262 | 0.70 | 1369 | 0.94 | 1563 | 1.21 | 1738 | 1.48 | 1899 |
|           |          | 86°F/100°F     | 1296 | 0.27                         | 793  | 0.37 | 937  | 0.47 | 1066 | 0.59 | 1184 | 0.71 | 1293 | 0.83 | 1395 | 1.09 | 1582 | 1.37 | 1752 | 1.66 | 1909 |
|           |          | 79°F/93°F      | 1400 | 0.32                         | 832  | 0.42 | 970  | 0.54 | 1093 | 0.66 | 1208 | 0.78 | 1313 | 0.91 | 1412 | 1.18 | 1596 | 1.47 | 1763 | 1.78 | 1917 |
|           |          | 62°F/72°F      | 1800 | 0.59                         | 994  | 0.72 | 1109 | 0.86 | 1216 | 1.00 | 1316 | 1.15 | 1410 | 1.30 | 1500 | 1.62 | 1667 | 1.95 | 1823 | 2.29 | 1967 |
|           |          | 51°F/59°F      | 2200 | 1.00                         | 1166 | 1.16 | 1264 | 1.32 | 1356 | 1.49 | 1444 | 1.66 | 1529 | 1.84 | 1610 | 2.20 | 1762 | 2.57 | 1906 | 2.96 | 2041 |
|           |          | 43°F/50°F      | 2600 | 1.58                         | 1344 | 1.76 | 1429 | 1.95 | 1510 | 2.14 | 1589 | 2.34 | 1664 | 2.54 | 1737 | 2.95 | 1877 | -    | -    | -    | -    |
|           |          | 37°F/43°F      | 3000 | 2.35                         | 1526 | 2.57 | 1600 | 2.78 | 1673 | 3.00 | 1743 | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 86°F/100°F     | 1296 | -                            | -    | 0.25 | 609  | 0.37 | 734  | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 79°F/93°F      | 1400 | 0.17                         | 474  | 0.28 | 615  | 0.40 | 737  | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 62°F/72°F      | 1800 | 0.28                         | 526  | 0.41 | 650  | 0.55 | 760  | 0.70 | 859  | 0.85 | 952  | -    | -    | -    | -    | -    | -    | -    | -    |
| 150/175   | E,F      | 51°F/59°F      | 2200 | 0.44                         | 588  | 0.59 | 697  | 0.75 | 796  | 0.91 | 887  | 1.09 | 972  | 1.27 | 1052 | 1.67 | 1201 | -    | -    | -    | -    |
|           |          | 43°F/50°F      | 2600 | 0.67                         | 657  | 0.83 | 753  | 1.01 | 842  | 1.19 | 925  | 1.39 | 1004 | 1.59 | 1078 | 2.02 | 1218 | 2.47 | 1348 | 2.96 | 1469 |
|           |          | 37°F/43°F      | 3000 | 0.96                         | 729  | 1.15 | 815  | 1.35 | 895  | 1.55 | 972  | 1.76 | 1044 | 1.98 | 1114 | 2.45 | 1245 | 2.94 | 1368 | 3.45 | 1483 |
|           |          | 33°F/38°F      | 3400 | 1.35                         | 804  | 1.55 | 881  | 1.77 | 955  | 2.00 | 1025 | 2.23 | 1092 | 2.47 | 1157 | 2.96 | 1280 | 3.49 | 1396 | 4.03 | 1505 |
|           |          | 29°F/34°F      | 3800 | 1.82                         | 880  | 2.05 | 951  | 2.29 | 1018 | 2.53 | 1083 | 2.79 | 1146 | 3.04 | 1206 | 3.58 | 1322 | 4.14 | 1431 | 4.72 | 1535 |
|           |          | 26°F/31°F      | 4200 | 2.40                         | 959  | 2.66 | 1023 | 2.92 | 1085 | 3.18 | 1145 | 3.45 | 1204 | 3.73 | 1260 | 4.30 | 1369 | 4.90 | 1472 | -    | -    |
|           |          | 24°F/28°F      | 4700 | 3.30                         | 1058 | 3.58 | 1116 | 3.87 | 1172 | 4.16 | 1227 | 4.46 | 1281 | 4.76 | 1333 | -    | -    | -    | -    | -    | -    |
|           |          | 21°F/25°F      | 5200 | 4.40                         | 1158 | 4.71 | 1212 | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
| 200/225   | C,D      | 100°F/113°F    | 1481 | 0.36                         | 871  | 0.48 | 1016 | 0.60 | 1144 | 0.73 | 1259 | 0.85 | 1366 | 0.99 | 1465 | 1.26 | 1646 | 1.54 | 1808 | 1.84 | 1958 |
|           |          | 89°F/100°F     | 1667 | 0.48                         | 943  | 0.61 | 1078 | 0.75 | 1198 | 0.88 | 1309 | 1.03 | 1411 | 1.17 | 1507 | 1.47 | 1682 | 1.77 | 1842 | 2.09 | 1988 |
|           |          | 85°F/95°F      | 1750 | 0.54                         | 975  | 0.68 | 1106 | 0.82 | 1224 | 0.96 | 1332 | 1.11 | 1433 | 1.26 | 1527 | 1.57 | 1700 | 1.88 | 1857 | 2.21 | 2003 |
|           |          | 74°F/83°F      | 2000 | 0.76                         | 1077 | 0.92 | 1197 | 1.08 | 1306 | 1.24 | 1407 | 1.40 | 1502 | 1.57 | 1592 | 1.91 | 1758 | 2.26 | 1910 | 2.62 | 2051 |
|           |          | 66°F/74°F      | 2250 | 1.04                         | 1181 | 1.21 | 1291 | 1.39 | 1393 | 1.57 | 1488 | 1.75 | 1577 | 1.94 | 1663 | 2.31 | 1822 | 2.69 | 1969 | -    | -    |
|           |          | 59°F/67°F      | 2500 | 1.38                         | 1288 | 1.57 | 1389 | 1.77 | 1484 | 1.97 | 1573 | 2.17 | 1658 | 2.37 | 1739 | 2.78 | 1892 | -    | -    | -    | -    |
|           |          | 54°F/61°F      | 2750 | 1.79                         | 1396 | 2.00 | 1490 | 2.22 | 1579 | 2.44 | 1663 | 2.66 | 1743 | 2.88 | 1820 | -    | -    | -    | -    | -    | -    |
|           |          | 49°F/56°F      | 3000 | 2.28                         | 1506 | 2.51 | 1593 | 2.75 | 1677 | 2.98 | 1756 | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    |
|           |          | 85°F/95°F      | 1750 | 0.29                         | 594  | 0.43 | 723  | 0.58 | 838  | 0.75 | 944  | 0.94 | 1042 | 1.14 | 1134 | 1.58 | 1303 | 2.07 | 1458 | 2.60 | 1600 |
|           |          | 74°F/83°F      | 2000 | 0.40                         | 642  | 0.54 | 759  | 0.71 | 866  | 0.88 | 966  | 1.08 | 1058 | 1.28 | 1146 | 1.74 | 1309 | 2.23 | 1458 | 2.78 | 1595 |
| 200/225   | E,F      | 59°F/67°F      | 2500 | 0.68                         | 746  | 0    |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |

# BLOWER PERFORMANCE DATA

Table 35.1 - Unit Performance Tables ①②

| Unit Size            | Digit 16 | Air Temp. Rise | CFM   | Total Static Pressure, "W.C. |       |       |      |       |      |       |      |       |      |       |      |       |      |       |      |       |      |   |
|----------------------|----------|----------------|-------|------------------------------|-------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|------|---|
|                      |          |                |       | 0.25                         |       | 0.50  |      | 0.75  |      | 1.00  |      | 1.25  |      | 1.50  |      | 2.00  |      | 2.50  |      | 3.00  |      |   |
|                      |          |                |       | BHP                          | RPM   | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  |   |
| 250/300<br>Start 300 | E,F      | 100°F / 120°F  | 1852  | 0.26                         | 532   | 0.39  | 665  | 0.54  | 782  | 0.69  | 887  | 0.85  | 985  | 1.03  | 1074 | 1.39  | 1239 | 1.79  | 1387 | 2.21  | 1523 |   |
|                      |          | 83°F / 100°F   | 2222  | 0.39                         | 582   | 0.54  | 703  | 0.70  | 810  | 0.87  | 909  | 1.05  | 1000 | 1.24  | 1085 | 1.64  | 1242 | 2.06  | 1385 | 2.52  | 1517 |   |
|                      |          | 74°F / 89°F    | 2500  | 0.51                         | 625   | 0.68  | 736  | 0.85  | 836  | 1.04  | 930  | 1.23  | 1016 | 1.43  | 1099 | 1.85  | 1250 | 2.30  | 1389 | 2.78  | 1517 |   |
|                      |          | 62°F / 74°F    | 3000  | 0.80                         | 706   | 0.99  | 803  | 1.19  | 893  | 1.40  | 978  | 1.62  | 1058 | 1.84  | 1133 | 2.31  | 1275 | 2.81  | 1406 | 3.33  | 1529 |   |
|                      |          | 53°F / 63°F    | 3500  | 1.19                         | 793   | 1.41  | 878  | 1.64  | 959  | 1.87  | 1036 | 2.12  | 1109 | 2.36  | 1179 | 2.88  | 1312 | 3.42  | 1435 | 3.99  | 1552 |   |
|                      |          | 46°F / 56°F    | 4000  | 1.69                         | 882   | 1.94  | 958  | 2.20  | 1032 | 2.46  | 1102 | 2.73  | 1170 | 3.01  | 1234 | 3.58  | 1358 | 4.17  | 1474 | 4.78  | 1584 |   |
|                      |          | 41°F / 49°F    | 4500  | 2.34                         | 974   | 2.62  | 1043 | 2.90  | 1109 | 3.19  | 1174 | 3.49  | 1236 | 3.79  | 1296 | 4.41  | 1412 | -     | -    | -     | -    |   |
|                      |          | 37°F / 44°F    | 5000  | 3.14                         | 1067  | 3.44  | 1130 | 3.76  | 1191 | 4.08  | 1250 | 4.40  | 1308 | 4.73  | 1364 | -     | -    | -     | -    | -     | -    |   |
|                      |          | 34°F / 40°F    | 5500  | 4.11                         | 1161  | 4.44  | 1219 | 4.78  | 1275 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |   |
| 250/300<br>Start 300 | G,H      | 100°F / 120°F  | 1852  | -                            | -     | 0.34  | 519  | 0.49  | 623  | 0.66  | 713  | 0.85  | 795  | 1.05  | 870  | 1.47  | 1005 | 1.94  | 1126 | 2.44  | 1237 |   |
|                      |          | 83°F / 100°F   | 2222  | 0.28                         | 424   | 0.43  | 537  | 0.61  | 634  | 0.79  | 721  | 0.99  | 800  | 1.20  | 872  | 1.65  | 1005 | 2.14  | 1123 | 2.67  | 1231 |   |
|                      |          | 74°F / 89°F    | 2500  | 0.35                         | 447   | 0.52  | 553  | 0.71  | 646  | 0.90  | 730  | 1.11  | 806  | 1.33  | 877  | 1.81  | 1006 | 2.32  | 1123 | 2.87  | 1230 |   |
|                      |          | 62°F / 74°F    | 3000  | 0.53                         | 492   | 0.72  | 588  | 0.93  | 674  | 1.15  | 752  | 1.38  | 824  | 1.62  | 892  | 2.13  | 1016 | 2.68  | 1129 | 3.27  | 1232 |   |
|                      |          | 53°F / 63°F    | 3500  | 0.76                         | 542   | 0.98  | 634  | 1.21  | 707  | 1.45  | 780  | 1.71  | 848  | 1.97  | 912  | 2.52  | 1031 | 3.11  | 1140 | 3.74  | 1240 |   |
|                      |          | 46°F / 56°F    | 4000  | 1.07                         | 594   | 1.31  | 673  | 1.57  | 746  | 1.83  | 814  | 2.11  | 878  | 2.39  | 939  | 2.99  | 1052 | 3.62  | 1156 | 4.28  | 1253 |   |
|                      |          | 41°F / 49°F    | 4500  | 1.45                         | 649   | 1.72  | 721  | 2.00  | 789  | 2.29  | 852  | 2.59  | 912  | 2.90  | 969  | 3.54  | 1077 | 4.22  | 1177 | 4.92  | 1270 |   |
|                      |          | 37°F / 44°F    | 5000  | 1.92                         | 706   | 2.22  | 771  | 2.52  | 834  | 2.84  | 894  | 3.16  | 950  | 3.50  | 1004 | 4.18  | 1107 | 4.90  | 1202 | -     | -    |   |
|                      |          | 34°F / 40°F    | 5500  | 2.50                         | 767   | 2.81  | 824  | 3.14  | 882  | 3.49  | 938  | 3.83  | 991  | 4.19  | 1042 | 4.93  | 1140 | -     | -    | -     | -    |   |
|                      |          | 31°F / 37°F    | 6000  | 3.16                         | 822   | 3.52  | 878  | 3.87  | 933  | 4.24  | 984  | 4.61  | 1035 | 5.00  | 1084 | -     | -    | -     | -    | -     | -    |   |
| 250/300<br>End 250   | I, J, K  | 28°F / 34°F    | 6500  | 3.96                         | 881   | 4.34  | 934  | 4.72  | 984  | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |   |
|                      |          | 46°F / 56°F    | 4000  | -                            | -     | 0.97  | 507  | 1.25  | 583  | 1.56  | 654  | 1.89  | 719  | 2.24  | 781  | -     | -    | -     | -    | -     | -    | - |
|                      |          | 37°F / 44°F    | 5000  | -                            | -     | 1.51  | 560  | 1.84  | 626  | 2.19  | 688  | 2.56  | 748  | 2.95  | 804  | 3.77  | 908  | 4.67  | 1005 | -     | -    | - |
|                      |          | 31°F / 37°F    | 6000  | 1.94                         | 559   | 2.29  | 620  | 2.66  | 679  | 3.06  | 734  | 3.46  | 787  | 3.89  | 838  | 4.79  | 935  | 5.75  | 1025 | 6.77  | 1110 |   |
|                      |          | 26°F / 32°F    | 7000  | 2.93                         | 632   | 3.33  | 686  | 3.75  | 738  | 4.19  | 788  | 4.64  | 836  | 5.11  | 882  | 6.09  | 971  | 7.13  | 1055 | 8.22  | 1134 |   |
|                      |          | 23°F / 28°F    | 8000  | 4.24                         | 707   | 4.69  | 755  | 5.16  | 802  | 5.64  | 847  | 6.14  | 891  | 6.65  | 933  | 7.72  | 1015 | 8.83  | 1093 | 10.00 | 1167 |   |
|                      |          | 20°F / 24°F    | 9259  | 6.40                         | 804   | 6.91  | 846  | 7.45  | 887  | 7.99  | 927  | 8.55  | 966  | 9.12  | 1004 | 10.30 | 1079 | 11.52 | 1150 | 12.79 | 1218 |   |
|                      |          | - / 22°F       | 10000 | 7.97                         | 862   | 8.52  | 901  | 9.09  | 939  | 9.67  | 977  | 10.27 | 1014 | 10.87 | 1050 | 12.12 | 1120 | 13.41 | 1187 | 14.74 | 1252 |   |
|                      |          | - / 20°F       | 11111 | 10.79                        | 949   | 11.40 | 985  | 12.03 | 1020 | 12.66 | 1054 | 13.31 | 1087 | 13.97 | 1121 | -     | -    | -     | -    | -     | -    | - |
| 350/400<br>Start 400 | E,F      | 100°F / -      | 2593  | 0.61                         | 668   | 0.80  | 781  | 1.01  | 882  | 1.22  | 975  | 1.45  | 1061 | 1.69  | 1142 | 2.19  | 1290 | 2.73  | 1425 | 3.30  | 1550 |   |
|                      |          | 96°F / -       | 2700  | 0.67                         | 686   | 0.87  | 796  | 1.08  | 895  | 1.30  | 986  | 1.53  | 1071 | 1.78  | 1151 | 2.29  | 1297 | 2.84  | 1431 | 3.42  | 1555 |   |
|                      |          | 87°F / 100°F   | 2963  | 0.85                         | 730   | 1.06  | 834  | 1.28  | 928  | 1.52  | 1015 | 1.76  | 1097 | 2.02  | 1174 | 2.56  | 1316 | 3.13  | 1446 | 3.74  | 1568 |   |
|                      |          | 74°F / 85°F    | 3500  | 1.30                         | 826   | 1.54  | 917  | 1.80  | 1002 | 2.07  | 1081 | 2.34  | 1157 | 2.62  | 1228 | 3.22  | 1362 | 3.84  | 1486 | 4.50  | 1602 |   |
|                      |          | 65°F / 74°F    | 4000  | 1.86                         | 918   | 2.13  | 1000 | 2.42  | 1078 | 2.71  | 1151 | 3.01  | 1221 | 3.32  | 1288 | 3.97  | 1414 | 4.65  | 1531 | -     | -    |   |
|                      |          | 58°F / 66°F    | 4500  | 2.57                         | 1012  | 2.87  | 1087 | 3.18  | 1158 | 3.51  | 1226 | 3.84  | 1291 | 4.18  | 1353 | 4.88  | 1472 | -     | -    | -     | -    | - |
|                      |          | 52°F / 59°F    | 5000  | 3.44                         | 1109  | 3.78  | 1177 | 4.12  | 1242 | 4.47  | 1305 | 4.84  | 1366 | -     | -    | -     | -    | -     | -    | -     | -    | - |
|                      |          | 47°F / 54°F    | 5500  | 4.50                         | 1206  | 4.87  | 1269 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | - |
|                      |          | 40°F / 46°F    | 6500  | 7.97                         | 862   | 8.52  | 901  | 9.09  | 939  | 9.67  | 977  | 10.27 | 1014 | 10.87 | 1050 | 12.12 | 1120 | 13.41 | 1187 | 14.74 | 1252 | - |
| 350/400<br>Start 400 | G,H      | 100°F / -      | 2593  | 0.43                         | 479   | 0.62  | 585  | 0.84  | 679  | 1.09  | 764  | 1.35  | 841  | 1.64  | 1142 | 2.26  | 1046 | 2.94  | 1165 | 3.68  | 1275 |   |
|                      |          | 87°F / 100°F   | 2963  | 0.57                         | 516   | 0.79  | 614  | 1.02  | 702  | 1.28  | 782  | 1.56  | 856  | 1.86  | 926  | 2.50  | 1053 | 3.20  | 1170 | 3.96  | 1277 |   |
|                      |          | 74°F / 85°F    | 3500  | 0.85                         | 574   | 1.09  | 662  | 1.35  | 742  | 1.63  | 815  | 1.93  | 885  | 2.25  | 951  | 2.93  | 1072 | 3.66  | 1183 | 4.45  | 1287 |   |
|                      |          | 65°F / 74°F    | 4000  | 1.19                         | 631   | 1.45  | 710  | 1.74  | 784  | 2.04  | 853  | 2.36  | 918  | 2.70  | 980  | 3.41  | 1096 | 4.19  | 1202 | -     | -    |   |
|                      |          | 58°F / 66°F    | 4500  | 1.61                         | 690   | 1.91  | 762  | 2.22  | 830  | 2.55  | 895  | 2.89  | 956  | 3.25  | 1014 | 4.00  | 1124 | 4.81  | 1226 | -     | -    |   |
|                      |          | 52°F / 59°F    | 5000  | 2.22                         | 767   | 2.46  | 817  | 2.80  | 880  | 3.15  | 940  | 3.52  | 998  | 3.90  | 1053 | 4.70  | 1157 | -     | -    | -     | -    | - |
|                      |          | 47°F / 54°F    | 5500  | 2.77                         | 813   | 3.12  | 874  | 3.49  | 933  | 3.87  | 989  | 4.25  | 1042 | 4.66  | 1095 | -     | -    | -     | -    | -     | -    | - |
|                      |          | 43°F / 49°F    | 6000  | 3.53                         | 876   | 3.91  | 933  | 4.30  | 987  | 4.70  | 1040 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | - |
|                      |          | 40°F / 46°F    | 6500  | 4.42                         | 939   | 4.82  | 992  | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | - |
| 350/400<br>Start 400 | I,J,K    | 100°F / -      | 2593  | -                            | -     | -     | -    | 0.77  | 561  | 1.04  | 639  | 1.34  | 709  | 1.66  | 774  | 2.36  | 891  | 3.14  | 995  | 4.00  | 1090 |   |
|                      |          | 87°F / 100°F   | 2963  | -                            | -     | -     | -    | 0.89  | 571  | 1.18  | 646  | 1.49  | 715  | 1.81  | 779  | 2.54  | 894  | 3.34  | 997  | 4.20  | 1091 |   |
|                      |          | 65°F / 74°F    | 4000  | -                            | -     | 1.07  | 533  | 1.37  | 609  | 1.69  | 679  | 2.03  | 742  | 2.40  | 802  | 3.18  | 910  | 4.04  | 1009 | 4.96  | 1099 |   |
|                      |          | 52°F / 59°F    | 5000  | 1.37                         | 515   | 1.69  | 590  | 2.04  | 658  | 2.41  | 721  | 2.79  | 779  | 3.19  | 835  | 4.05  | 937  | 4.98  | 1030 | 5.96  | 1117 |   |
|                      |          | 43°F / 49°F    | 6000  | 2.20                         | 588   | 2.58  | 654  | 2.97  | 715  | 3.39  | 772  | 3.82  | 826  | 4.26  | 877  | 5.20  | 973  | 6.21  | 1061 | 7.26  | 1144 |   |
|                      |          | 37°F / 42°F    | 7000  | 3.34                         | 665   | 3.77  | 723  | 4.22  | 778  | 4.68  | 830  | 5.16  | 879  | 5.65  | 927  | 6.68  | 1016 | 7.77  | 1099 | 8.90  | 1178 |   |
|                      |          | 32°F / 37°F    | 8000  | 4.84                         | 744   | 5.33  | 796  | 5.83  | 845  | 6.34  | 893  | 6.87  | 938  | 7.41  | 982  | 8.53  | 1066 | 9.70  | 1144 | 10.92 | 1219 |   |
|                      |          | 29°F / 33°F    | 9000  | 6.75                         | 824   | 7.29  | 871  | 7.85  | 917  | 8.41  | 960  | 8.99  | 1002 | 9.58  | 1043 | 10.80 | 1121 | 12.07 | 1194 | 13.37 | 1265 |   |
|                      |          | 26°F / 30°F    | 10000 | 9.13                         | 906   | 9.72  | 948  | 10.33 | 990  | 10.95 | 1030 | 11.58 | 1069 | 12.22 | 1107 | 13.54 | 1180 | 14.90 | 1249 | -     | -    | - |
|                      |          | 24°F / 27°F    | 11000 | 12.01                        | 988   | 12.66 | 1027 | 13.32 | 1065 | 14.00 | 1103 | 14.68 | 1139 | -     | -    | -     | -    | -     | -    | -     | -    | - |
|                      |          | 23°F / 26°F    | 11500 | 13.66                        | 12.09 | 14.34 | 1067 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | - |

- ① Total static pressure should include external static pressure and accessory / option static pressure from Table 33.1. Unit internal resistance has been included in the unit performance tables.
- ② Brake Horsepower and RPM values are approximate values only. Please consult the AccuSpec selection software for values at other than listed CFM / static pressures.

# BLOWER PERFORMANCE DATA

Table 36.1 - Unit Performance Tables ①②

| Unit Size            | Digit 16     | Air Temp Rise | CFM   | Total Static Pressure Inches "W.C. |      |       |      |       |      |       |      |       |      |       |      |       |      |       |      |       |      |
|----------------------|--------------|---------------|-------|------------------------------------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|------|
|                      |              |               |       | 0.25                               |      | 0.50  |      | 0.75  |      | 1.00  |      | 1.25  |      | 1.50  |      | 2.00  |      | 2.50  |      | 3.00  |      |
|                      |              |               |       | BHP                                | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  | BHP   | RPM  |
| 500/600<br>Start 600 | G or H<br>→  | 120°F / -     | 3086  | 0.62                               | 529  | 0.82  | 620  | 1.03  | 703  | 1.26  | 779  | 1.50  | 849  | 1.75  | 916  | 2.28  | 1038 | 2.84  | 1149 | 3.44  | 1252 |
|                      |              | 106°F / -     | 3500  | 0.84                               | 575  | 1.06  | 658  | 1.30  | 736  | 1.54  | 807  | 1.80  | 874  | 2.07  | 937  | 2.63  | 1054 | 3.23  | 1162 | 3.86  | 1262 |
|                      |              | 100°F / 120°F | 3704  | 0.97                               | 598  | 1.20  | 678  | 1.45  | 753  | 1.70  | 822  | 1.97  | 887  | 2.25  | 949  | 2.83  | 1064 | 3.44  | 1170 | 4.09  | 1268 |
|                      |              | 93°F / 111°F  | 4000  | 1.18                               | 633  | 1.43  | 709  | 1.69  | 779  | 1.96  | 846  | 2.24  | 908  | 2.53  | 968  | 3.14  | 1080 | 3.78  | 1183 | 4.45  | 1279 |
|                      |              | 82°F / 99°F   | 4500  | 1.61                               | 693  | 1.88  | 762  | 2.17  | 827  | 2.46  | 889  | 2.77  | 948  | 3.09  | 1001 | 3.74  | 1110 | 4.43  | 1208 | -     | -    |
|                      |              | 74°F / 89°F   | 5000  | 2.13                               | 755  | 2.43  | 818  | 2.75  | 878  | 3.07  | 936  | 3.40  | 991  | 3.74  | 1044 | 4.44  | 1145 | -     | -    | -     | -    |
|                      |              | 67°F / 81°F   | 5500  | 2.77                               | 818  | 3.10  | 876  | 3.44  | 932  | 3.79  | 986  | 4.15  | 1038 | 4.51  | 1088 | -     | -    | -     | -    | -     | -    |
|                      |              | 62°F / 74°F   | 6000  | 3.53                               | 882  | 3.89  | 936  | 4.25  | 988  | 4.63  | 1038 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
|                      |              | 57°F / 68°F   | 6500  | 4.41                               | 946  | 4.80  | 996  | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
|                      |              | 120°F / -     | 3086  | 0.46                               | 401  | 0.69  | 496  | 0.95  | 580  | 1.23  | 657  | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
| 500/600<br>Start 600 | I, J, K<br>→ | 100°F / 120°F | 3704  | 0.69                               | 443  | 0.95  | 527  | 1.23  | 604  | 1.54  | 675  | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
|                      |              | 93°F / 111°F  | 4000  | 0.82                               | 464  | 1.09  | 544  | 1.39  | 618  | 1.71  | 686  | 2.05  | 749  | 2.42  | 810  | -     | -    | -     | -    | -     | -    |
|                      |              | 74°F / 89°F   | 5000  | 1.43                               | 542  | 1.75  | 609  | 2.09  | 673  | 2.46  | 733  | 2.84  | 790  | 3.24  | 844  | 4.09  | 946  | 5.01  | 1041 | -     | -    |
|                      |              | 62°F / 74°F   | 6000  | 2.31                               | 624  | 2.68  | 682  | 3.07  | 738  | 3.48  | 791  | 3.91  | 842  | 4.35  | 891  | 5.29  | 984  | 6.28  | 1072 | 7.33  | 1155 |
|                      |              | 53°F / 63°F   | 7000  | 3.51                               | 709  | 3.94  | 760  | 4.38  | 809  | 4.84  | 857  | 5.31  | 903  | 5.80  | 947  | 6.82  | 1032 | 7.90  | 1113 | 9.03  | 1191 |
|                      |              | 46°F / 56°F   | 8000  | 5.09                               | 797  | 5.57  | 842  | 6.07  | 886  | 6.58  | 928  | 7.10  | 970  | 7.64  | 1010 | 8.75  | 1089 | 9.92  | 1163 | 11.13 | 1235 |
|                      |              | 41°F / 49°F   | 9000  | 7.11                               | 885  | 7.65  | 926  | 8.20  | 965  | 8.76  | 1001 | 9.33  | 1042 | 9.92  | 1079 | 11.13 | 1151 | 12.38 | 1220 | 13.69 | 1287 |
|                      |              | - / 44°F      | 10000 | 9.62                               | 975  | 10.21 | 1012 | 10.81 | 1048 | 11.43 | 1083 | 12.05 | 1118 | 12.69 | 1152 | 14.00 | 1218 | 15.35 | 1283 | -     | -    |
|                      |              | - / 43°F      | 10400 | 10.77                              | 1011 | 11.38 | 1046 | 12.01 | 1081 | 12.64 | 1115 | 13.29 | 1149 | 13.95 | 1182 | 15.30 | 1247 | -     | -    | -     | -    |
|                      |              | - / 40°F      | 11000 | 12.66                              | 1065 | 13.31 | 1099 | 13.97 | 1132 | 14.64 | 1164 | 15.32 | 1197 | 16.01 | 1228 | 17.42 | 1290 | -     | -    | -     | -    |
| 500/600<br>Start 500 | L<br>→       | - / 40°F      | 11111 | 13.04                              | 1075 | 13.69 | 1109 | 14.36 | 1141 | 15.03 | 1174 | 15.72 | 1205 | 16.41 | 1237 | 17.83 | 1298 | -     | -    | -     | -    |
|                      |              | 62°F / 74°F   | 6000  | 1.69                               | 512  | 1.97  | 565  | 2.26  | 615  | 2.57  | 664  | 2.89  | 710  | 3.23  | 755  | -     | -    | -     | -    | -     | -    |
|                      |              | 53°F / 63°F   | 7000  | 2.57                               | 580  | 2.89  | 626  | 3.22  | 671  | 3.56  | 714  | 3.92  | 756  | 4.29  | 797  | 5.06  | 874  | -     | -    | -     | -    |
|                      |              | 46°F / 56°F   | 8000  | 3.73                               | 650  | 4.09  | 691  | 4.46  | 731  | 4.84  | 770  | 5.23  | 808  | 5.64  | 845  | 6.47  | 916  | 7.35  | 984  | -     | -    |
|                      |              | 41°F / 49°F   | 9000  | 5.21                               | 721  | 5.60  | 758  | 6.01  | 795  | 6.43  | 830  | 6.86  | 864  | 7.30  | 898  | 8.21  | 964  | 9.16  | 1027 | 10.14 | 1088 |
|                      |              | - / 44°F      | 10000 | 7.04                               | 793  | 7.48  | 827  | 7.93  | 860  | 8.39  | 892  | 8.85  | 924  | 9.33  | 955  | 10.31 | 1016 | 11.33 | 1074 | 12.38 | 1131 |
|                      |              | - / 43°F      | 10400 | 7.88                               | 823  | 8.34  | 855  | 8.80  | 887  | 9.28  | 918  | 9.76  | 949  | 10.25 | 979  | 11.26 | 1038 | 12.31 | 1095 | 13.38 | 1150 |
|                      |              | - / 40°F      | 11000 | 9.27                               | 866  | 9.75  | 897  | 10.24 | 927  | 10.74 | 957  | 11.24 | 986  | 11.76 | 1015 | 12.81 | 1071 | 13.90 | 1126 | -     | -    |
|                      |              | - / 40°F      | 11111 | 9.54                               | 874  | 10.03 | 905  | 10.52 | 935  | 11.02 | 964  | 11.53 | 993  | 12.05 | 1022 | 13.12 | 1078 | 14.21 | 1132 | -     | -    |
|                      |              | 120°F / -     | 4321  | 1.51                               | 685  | 1.80  | 760  | 2.11  | 830  | 2.43  | 896  | 2.77  | 958  | 3.13  | 1018 | 3.88  | 1131 | 4.69  | 1236 | -     | -    |
| 700/800<br>Start 800 | G or H<br>→  | 115°F / -     | 4500  | 1.68                               | 708  | 1.98  | 780  | 2.30  | 847  | 2.63  | 912  | 2.98  | 973  | 3.34  | 1032 | 4.11  | 1142 | 4.94  | 1245 | -     | -    |
|                      |              | 105°F / 120°F | 4938  | 2.15                               | 763  | 2.48  | 89   | 2.82  | 893  | 3.17  | 953  | 3.54  | 1011 | 3.93  | 1066 | 4.74  | 1172 | -     | -    | -     | -    |
|                      |              | 104°F / 119°F | 5000  | 2.23                               | 770  | 2.55  | 836  | 2.90  | 899  | 3.26  | 959  | 3.63  | 1016 | 4.02  | 1072 | 4.83  | 1176 | -     | -    | -     | -    |
|                      |              | 94°F / 108°F  | 5500  | 2.89                               | 834  | 3.25  | 895  | 3.62  | 953  | 4.00  | 1009 | 4.40  | 1063 | 4.81  | 1116 | -     | -    | -     | -    | -     | -    |
|                      |              | 86°F / 99°F   | 6000  | 3.68                               | 900  | 4.06  | 956  | 4.46  | 1010 | 4.87  | 1062 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
|                      |              | 80°F / 91°F   | 6500  | 4.61                               | 965  | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
|                      |              | 120°F / -     | 4321  | 0.87                               | 443  | 1.14  | 421  | 1.42  | 591  | 1.72  | 657  | 2.04  | 717  | 2.37  | 774  | 3.08  | 879  | 3.84  | 974  | 4.65  | 1063 |
|                      |              | 104°F / 119°F | 5000  | 1.26                               | 488  | 1.55  | 558  | 1.87  | 623  | 2.20  | 683  | 2.54  | 740  | 2.90  | 794  | 3.66  | 894  | 4.47  | 985  | 5.33  | 1071 |
|                      |              | 86°F / 99°F   | 6000  | 2.02                               | 558  | 2.36  | 619  | 2.73  | 677  | 3.10  | 731  | 3.49  | 782  | 3.89  | 832  | 4.73  | 924  | 5.62  | 1010 | 6.55  | 1091 |
|                      |              | 65°F / 74°F   | 8000  | 4.44                               | 707  | 4.89  | 755  | 5.35  | 801  | 5.82  | 845  | 6.30  | 888  | 6.79  | 930  | 7.81  | 1009 | 8.87  | 1085 | 9.96  | 1156 |
| 700/800<br>Start 800 | I, J, K<br>→ | 58°F / 66°F   | 9000  | 6.19                               | 784  | 6.69  | 827  | 7.20  | 869  | 7.72  | 909  | 8.25  | 949  | 8.79  | 987  | 9.90  | 1061 | 11.04 | 1131 | 12.23 | 1199 |
|                      |              | 52°F / 59°F   | 10000 | 8.36                               | 861  | 8.91  | 901  | 9.47  | 939  | 10.04 | 976  | 10.62 | 1012 | 11.21 | 1048 | 12.42 | 1117 | 13.66 | 1183 | 14.93 | 1246 |
|                      |              | 47°F / 54°F   | 11000 | 11.00                              | 940  | 11.60 | 976  | 12.22 | 1011 | 12.84 | 1045 | 13.47 | 1079 | 14.11 | 1112 | 15.41 | 1176 | 16.74 | 1238 | -     | -    |
|                      |              | 43°F / 49°F   | 12000 | 14.16                              | 1019 | 14.81 | 1052 | 15.48 | 1085 | 16.15 | 1117 | 16.83 | 1148 | 17.52 | 1179 | 18.92 | 1239 | -     | -    | -     | -    |
|                      |              | 40°F / 46°F   | 13000 | 17.88                              | 1098 | 18.59 | 1129 | 19.30 | 1159 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
|                      |              | 65°F / 74°F   | 8000  | 3.26                               | 566  | 3.60  | 611  | 3.95  | 654  | 4.31  | 696  | 4.67  | 736  | 5.05  | 774  | 5.84  | 848  | 6.66  | 918  | 7.51  | 984  |
|                      |              | 58°F / 66°F   | 9000  | 4.54                               | 626  | 4.92  | 667  | 5.30  | 706  | 5.70  | 744  | 6.10  | 780  | 6.52  | 816  | 7.37  | 885  | 8.25  | 950  | 9.17  | 1012 |
|                      |              | 52°F / 59°F   | 10000 | 6.13                               | 687  | 6.54  | 724  | 6.97  | 760  | 7.40  | 794  | 7.85  | 828  | 8.30  | 861  | 9.22  | 925  | 10.17 | 987  | 11.15 | 1046 |
|                      |              | 47°F / 54°F   | 11000 | 8.06                               | 749  | 8.52  | 782  | 8.98  | 815  | 9.45  | 847  | 9.93  | 879  | 10.42 | 910  | 11.41 | 969  | 12.43 | 1027 | 13.48 | 1083 |
|                      |              | 47°F / 54°F   | 11050 | 8.17                               | 752  | 8.62  | 785  | 9.09  | 818  | 9.56  | 850  | 10.04 | 881  | 10.53 | 912  | 11.53 | 972  | 12.56 | 1029 | 13.61 | 1084 |
| 700/800<br>End 700   | L<br>→       | 43°F / 49°F   | 12000 | 10.37                              | 811  | 10.86 | 842  | 11.37 | 872  | 11.88 | 902  | 12.40 | 931  | 12.92 | 960  | 13.99 | 1016 | 15.08 | 1070 | 16.20 | 1123 |
|                      |              | 40°F / 46°F   | 13000 | 13.09                              | 873  | 13.63 | 902  | 14.17 | 930  | 14.72 | 958  | 15.27 | 986  | 15.83 | 1013 | 16.98 | 1065 | 18.14 | 1116 | 19.33 | 1166 |
|                      |              | - / 42°F      | 14000 | 16.26                              | 936  | 16.83 | 963  | 17.41 | 989  | 18.00 | 1015 | 18.59 | 1041 | 19.19 | 1066 | -     | -    | -     | -    | -     | -    |
|                      |              | - / 41°F      | 14500 | 18.02                              | 968  | 18.61 | 994  | 19.21 | 1019 | 19.82 | 1045 | -     | -    | -     | -    | -     | -    | -     | -    | -     | -    |
|                      |              | 120°F / -     | 6481  | 2.72                               | 630  | 3.09  | 685  | 3.48  | 736  | 3.88  | 785  | 4.30  | 832  | 4.72  | 876  | 5.60  | 960  | 6.52  | 1038 | 7.48  | 1112 |
|                      |              | 111°F / -     | 7000  | 3.36                               | 672  | 3.76  | 723  | 4.17  | 772  | 4.60  | 818  | 5.04  | 863  | 5.49  | 905  | 6.42  | 986  | 7.38  | 1061 | 8.39  | 1133 |
|                      |              | 105°F / 120°F | 7407  | 3.93                               | 705  | 4.35  | 754  | 4.79  | 800  | 5.23  | 845  | 5.69  | 888  | 6.16  | 929  | 7.13  | 1007 | 8.13  | 1081 | 9.17  | 1151 |
|                      |              | 97°F / 111°F  | 8000  | 4.87                               | 754  | 5.33  | 799  | 5.90  | 843  | 6.27  | 885  | 6.76  | 926  | 7.26  | 965  | 8.28  | 1040 | 9.33  | 1111 | 10.43 | 1179 |
|                      |              | 86°F / 99°F   | 9000  | 6.80                               | 837  | 7.31  | 878  | 7.83  | 918  | 8.36  | 956  | 8.90  | 994  | 9.44  | 1030 | 10.56 | 1100 | 11.71 | 1166 | 12.90 | 1230 |
|                      |              | 78°F / 89°F   | 10000 | 9.20                               | 921  | 9.76  | 958  | 10.33 | 995  | 10.91 | 1030 |       |      |       |      |       |      |       |      |       |      |

# BLOWER SHEAVE ASSEMBLY DATA

## Adjusting the Blower Drive Setting

Based on the Sheave Arrangement, Tables 37.1 through 38.5 give the Sheave Assembly numbers used on units that include a blower. The Sheave Arrangement is Digit 19 and is found on the unit Model Identification Plate. The Sheave Assembly describes the motor and blower sheave size and bore as well as the belt provided.


To determine how many turns open the motor sheave should be set for:

1. From Table 33.1, determine the individual static pressure drops for any features included on the unit. Add those and the design external static pressure to calculate the total static pressure. Use Tables 34.1 through 36.1 to determine

the blower rpm required to meet the job specifications.

2. Locate the unit Model Identification Plate and note Digit 16 and Digit 19 of the model number. Digit 16 is the Blower Size and Type and Digit 19 is the Sheave Arrangement.
3. Once the Blower Size and Type (Digit 16) is known, enter the proper Sheave Arrangement table.
4. Use the Sheave Arrangement (Digit 19) to determine the Sheave Assembly provided.
5. Use Table 39.1 and the Sheave Assembly number to determine the required turns open to achieve the desired blower rpm.
6. Set the motor sheave as described in Blower Adjustments.

**Figure 37.1 - Blower Section**

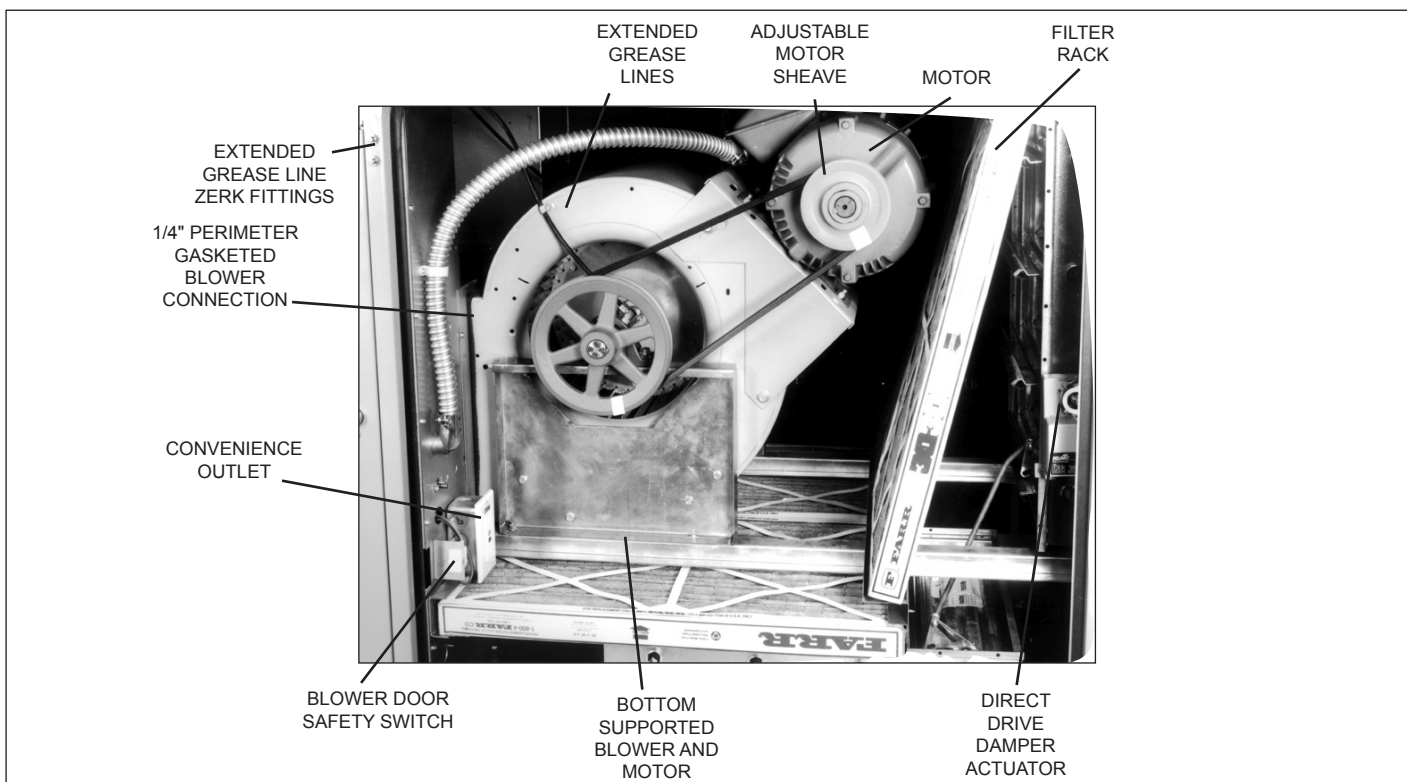

## Blower Sheave Assembly Numbers

**Table 37.1 - Digit 16 = A or B (9-7 Blower Units)**

| Motor Frame | RPM Range |                 |          |                 |           |                 |           |                 |           |                 |
|-------------|-----------|-----------------|----------|-----------------|-----------|-----------------|-----------|-----------------|-----------|-----------------|
|             | 656-1001  |                 | 978-1265 |                 | 1150-1561 |                 | 1526-1858 |                 | 1763-2147 |                 |
| Size        | Digit 19  | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19  | Sheave Assembly | Digit 19  | Sheave Assembly | Digit 19  | Sheave Assembly |
| 48          | A         | 3H35125B1       | C        | 3H35125B3       |           |                 |           |                 |           |                 |
| 56          | B         | 3H35125B2       | D        | 3H35125B4       | F         | 3H35125B6       | H         | 3H35125B8       | J         | 3H35125B10      |
| 143 or 145  |           |                 | E        | 3H35125B5       | G         | 3H35125B7       | I         | 3H35125B9       | K         | 3H35125B11      |

**Table 37.2 - Digit 16 = C or D (9-9 Blower Units)**

| Motor Frame | RPM Range |                 |          |                 |           |                 |           |                 |           |                 |
|-------------|-----------|-----------------|----------|-----------------|-----------|-----------------|-----------|-----------------|-----------|-----------------|
|             | 656-1001  |                 | 978-1265 |                 | 1150-1561 |                 | 1526-1858 |                 | 1763-2147 |                 |
| Size        | Digit 19  | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19  | Sheave Assembly | Digit 19  | Sheave Assembly | Digit 19  | Sheave Assembly |
| 48          | A         | 3H35126B1       | C        | 3H35126B3       |           |                 |           |                 |           |                 |
| 56          | B         | 3H35126B2       | D        | 3H35126B4       | F         | 3H35126B6       | I         | 3H35126B9       | L         | 3H35126B12      |
| 143 or 145  |           |                 | E        | 3H35126B5       | G         | 3H35126B7       | J         | 3H35126B10      | M         | 3H35126B13      |
| 182 or 184  |           |                 |          |                 | H         | 3H35126B8       | K         | 3H35126B11      | N         | 3H35126B14      |

# BLOWER SHEAVE ASSEMBLY DATA

## Blower Sheave Assembly Numbers (Con't)

Table 38.1 - Digit 16 = E or F (12-12 Blower Units)

| Motor Frame<br>Size | RPM Range |                 |          |                 |          |                 |           |                 |           |                 |           |                 |
|---------------------|-----------|-----------------|----------|-----------------|----------|-----------------|-----------|-----------------|-----------|-----------------|-----------|-----------------|
|                     | 468-715   |                 | 644-874  |                 | 863-1078 |                 | 1029-1332 |                 | 1150-1438 |                 | 1327-1659 |                 |
|                     | Digit 19  | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19  | Sheave Assembly | Digit 19  | Sheave Assembly | Digit 19  | Sheave Assembly |
| 48                  | A         | 3H35127B1       |          |                 |          |                 |           |                 |           |                 |           |                 |
| 56                  | B         | 3H35127B2       | C        | 3H35127B3       | F        | 3H35127B6       | Q         | 3H35127B17      |           |                 |           |                 |
| 143 to 145          |           |                 | D        | 3H35127B4       | G        | 3H35127B7       | I         | 3H35127B9       | L         | 3H35127B12      |           |                 |
| 182 or 184          |           |                 | E        | 3H35127B5       | H        | 3H35127B8       | J         | 3H35127B10      | M         | 3H35127B13      | O         | 3H35127B15      |
| 213 or 215          |           |                 |          |                 |          |                 | K         | 3H35127B11      | N         | 3H35127B14      | P         | 3H35127B16      |

Table 38.2 - Digit 16 = G or H (15-15 Blower Units)

| Motor Frame<br>Size | RPM Range |                 |          |                 |          |                 |          |                 |           |                 |
|---------------------|-----------|-----------------|----------|-----------------|----------|-----------------|----------|-----------------|-----------|-----------------|
|                     | 410-625   |                 | 568-771  |                 | 767-958  |                 | 934-1136 |                 | 1136-1380 |                 |
|                     | Digit 19  | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19  | Sheave Assembly |
| 48                  | A         | 3H35128B1       |          |                 |          |                 |          |                 |           |                 |
| 56                  | B         | 3H35128B2       | D        | 3H35128B4       | G        | 3H35128B7       | O        | 3H35128B15      |           |                 |
| 143 to 145          | C         | 3H35128B3       | E        | 3H35128B5       | H        | 3H35128B8       | J        | 3H35128B10      |           |                 |
| 182 or 184          |           |                 | F        | 3H35128B6       | I        | 3H35128B9       | K        | 3H35128B11      | M         | 3H35128B13      |
| 213 or 215          |           |                 |          |                 |          |                 | L        | 3H35128B12      | N         | 3H35128B14      |

Table 38.3 - Digit 16 = I or J (18-18 Blower Units under 15 Hp motor)

| Motor Frame<br>Size | RPM Range |                 |          |                 |          |                 |          |                 |          |                 |           |                 |
|---------------------|-----------|-----------------|----------|-----------------|----------|-----------------|----------|-----------------|----------|-----------------|-----------|-----------------|
|                     | 491-649   |                 | 586-744  |                 | 682-821  |                 | 821-1009 |                 | 995-1161 |                 | 1101-1285 |                 |
|                     | Digit 19  | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19  | Sheave Assembly |
| 56                  | A         | 3H35129B1       | D        | 3H35129B4       |          |                 |          |                 |          |                 |           |                 |
| 143 or 145          | B         | 3H35129B2       | E        | 3H35129B5       | H        | 3H35129B8       |          |                 |          |                 |           |                 |
| 182 to 184          | C         | 3H35129B3       | F        | 3H35129B6       | I        | 3H35129B9       | K        | 3H35129B11      | O        | 3H35129B15      |           |                 |
| 213 or 215          |           |                 | G        | 3H35129B7       | J        | 3H35129B10      | L        | 3H35129B12      | P        | 3H35129B16      | S         | 3H35129B19      |
| 254                 |           |                 |          |                 |          |                 | M        | 3H35129B13      | Q        | 3H35129B17      | T         | 3H35129B20      |
| 256                 |           |                 |          |                 |          |                 | N        | 3H35129B14      | R        | 3H35129B18      | U         | 3H35129B21      |

Table 38.4 - Digit 16 = K (18-18 Blower Units with 15 Hp motor & up)

| Motor Frame<br>Size | RPM Range |                 |          |                 |           |                 |           |                 |
|---------------------|-----------|-----------------|----------|-----------------|-----------|-----------------|-----------|-----------------|
|                     | 826-1009  |                 | 995-1161 |                 | 1101-1285 |                 | 1232-1438 |                 |
|                     | Digit 19  | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19  | Sheave Assembly | Digit 19  | Sheave Assembly |
| 254                 | A         | 3H35130B1       | C        | 3H35130B3       | E         | 3H35130B5       |           |                 |
| 256                 | B         | 3H35130B2       | D        | 3H35130B4       | F         | 3H35130B6       |           |                 |
| 284                 | G         | 3H35130B13      | I        | 3H35130B15      | K         | 3H35130B17      | M         | 3H35130B19      |
| 286                 | H         | 3H35130B14      | J        | 3H35130B16      | L         | 3H35130B18      | N         | 3H35130B20      |

Table 38.5 - Digit 16 = L (20-18 Blower Units)

| Motor Frame<br>Size | RPM Range |                 |          |                 |          |                 |          |                 |          |                 |           |                 |
|---------------------|-----------|-----------------|----------|-----------------|----------|-----------------|----------|-----------------|----------|-----------------|-----------|-----------------|
|                     | 491-649   |                 | 626-765  |                 | 765-901  |                 | 901-1059 |                 | 995-1161 |                 | 1101-1285 |                 |
|                     | Digit 19  | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19 | Sheave Assembly | Digit 19  | Sheave Assembly |
| 143 or 145          | A         | 3H36622B1       | C        | 3H36622B3       |          |                 |          |                 |          |                 |           |                 |
| 182 to 184          | B         | 3H36622B2       | D        | 3H36622B4       | F        | 3H36622B6       | L        | 3H36622B12      |          |                 |           |                 |
| 213 or 215          |           |                 | E        | 3H36622B5       | G        | 3H36622B7       | M        | 3H36622B13      | R        | 3H36622B18      |           |                 |
| 254                 |           |                 |          |                 | H        | 3H36622B8       | N        | 3H36622B14      | S        | 3H36622B19      | W         | 3H36622B23      |
| 256                 |           |                 |          |                 | I        | 3H36622B9       | O        | 3H36622B15      | T        | 3H36622B20      | X         | 3H36622B24      |
| 284                 |           |                 |          |                 | J        | 3H36622B10      | P        | 3H36622B16      | U        | 3H36622B21      | Y         | 3H36622B25      |
| 286                 |           |                 |          |                 | K        | 3H36622B11      | Q        | 3H36622B17      | V        | 3H36622B22      | Z         | 3H36622B26      |

# BLOWER SHEAVE ASSEMBLY DATA

**Table 39.1 - Blower Sheave Assembly Settings**

| Sheave Assembly | Turns Open |      |      |      |      |      |      |      |      |      |      |
|-----------------|------------|------|------|------|------|------|------|------|------|------|------|
|                 | 0          | 0.5  | 1    | 1.5  | 2    | 2.5  | 3    | 3.5  | 4    | 4.5  | 5    |
|                 | Blower RPM |      |      |      |      |      |      |      |      |      |      |
| 3H35125B1-2     | 1001       | 966  | 932  | 897  | 863  | 828  | 794  | 759  | 725  | 690  | 656  |
| 3H35125B3-5     | 1265       | 1236 | 1208 | 1179 | 1150 | 1121 | 1093 | 1064 | 1035 | 1006 | 978  |
| 3H35125B6-7     | 1561       | 1520 | 1479 | 1438 | 1396 | 1355 | 1314 | 1273 | 1232 | 1191 | 1150 |
| 3H35125B8-9     | 1858       | 1825 | 1791 | 1758 | 1725 | 1692 | 1659 | 1625 | 1592 | 1559 | 1526 |
| 3H35125B10-11   | 2147       | 2108 | 2070 | 2032 | 1993 | 1955 | 1917 | 1878 | 1840 | 1802 | 1763 |
| 3H35126B1-2     | 1001       | 966  | 932  | 897  | 863  | 828  | 794  | 759  | 725  | 690  | 656  |
| 3H35126B3-5     | 1265       | 1236 | 1208 | 1179 | 1150 | 1121 | 1093 | 1064 | 1035 | 1006 | 978  |
| 3H35126B6-8     | 1561       | 1520 | 1479 | 1438 | 1396 | 1355 | 1314 | 1273 | 1232 | 1191 | 1150 |
| 3H35126B9-11    | 1858       | 1825 | 1791 | 1758 | 1725 | 1692 | 1659 | 1625 | 1592 | 1559 | 1526 |
| 3H35126B12-14   | 2147       | 2108 | 2070 | 2032 | 1993 | 1955 | 1917 | 1878 | 1840 | 1802 | 1763 |
| 3H35127B1-2     | 715        | 690  | 665  | 641  | 616  | 591  | 567  | 542  | 518  | 493  | 468  |
| 3H35127B3-5     | 874        | 851  | 828  | 805  | 782  | 759  | 736  | 713  | 690  | 667  | 644  |
| 3H35127B6-8     | 1078       | 1057 | 1035 | 1013 | 992  | 970  | 949  | 927  | 906  | 884  | 863  |
| 3H35127B9-11    | 1332       | 1301 | 1271 | 1241 | 1211 | 1180 | 1150 | 1120 | 1089 | 1059 | 1029 |
| 3H35127B12-14   | 1438       | 1409 | 1380 | 1351 | 1323 | 1294 | 1265 | 1236 | 1208 | 1179 | 1150 |
| 3H35127B15-16   | 1659       | 1625 | 1592 | 1559 | 1526 | 1493 | 1460 | 1426 | 1393 | 1360 | 1327 |
| 3H35127B17      | 1332       | 1301 | 1271 | 1241 | 1211 | 1180 | 1150 | 1120 | 1089 | 1059 | 1029 |
| 3H35128B1-3     | 625        | 604  | 582  | 561  | 539  | 518  | 496  | 474  | 453  | 431  | 410  |
| 3H35128B4-6     | 771        | 751  | 731  | 710  | 690  | 670  | 649  | 629  | 609  | 589  | 568  |
| 3H35128B7-9     | 958        | 939  | 920  | 901  | 882  | 863  | 843  | 824  | 805  | 786  | 767  |
| 3H35128B10-12   | 1136       | 1116 | 1096 | 1076 | 1055 | 1035 | 1015 | 994  | 974  | 954  | 934  |
| 3H35128B13-14   | 1380       | 1355 | 1331 | 1306 | 1281 | 1257 | 1232 | 1208 | 1183 | 1158 | 1136 |
| 3H35128B15      | 1136       | 1116 | 1096 | 1076 | 1055 | 1035 | 1015 | 994  | 974  | 954  | 934  |
| 3H35129B1-3     | 649        | 633  | 617  | 601  | 586  | 570  | 554  | 538  | 522  | 506  | 491  |
| 3H35129B4-7     | 744        | 728  | 712  | 696  | 681  | 665  | 649  | 633  | 617  | 601  | 586  |
| 3H35129B8-10    | 821        | 807  | 793  | 779  | 765  | 751  | 737  | 723  | 709  | 696  | 682  |
| 3H35129B11-14   | 1009       | 991  | 973  | 954  | 936  | 918  | 899  | 881  | 863  | 844  | 821  |
| 3H35129B15-18   | 1161       | 1144 | 1128 | 1111 | 1095 | 1078 | 1062 | 1045 | 1028 | 1012 | 995  |
| 3H35129B19-21   | 1285       | 1266 | 1248 | 1230 | 1211 | 1193 | 1174 | 1156 | 1138 | 1119 | 1101 |
| 3H35130B1-2     | 1009       | 991  | 973  | 954  | 936  | 918  | 899  | 881  | 863  | 844  | 826  |
| 3H35130B3-4     | 1161       | 1144 | 1128 | 1111 | 1095 | 1078 | 1062 | 1045 | 1028 | 1012 | 995  |
| 3H35130B5-6     | 1285       | 1266 | 1248 | 1230 | 1211 | 1193 | 1174 | 1156 | 1138 | 1119 | 1101 |
| 3H35130B13-14   | 974        | 960  | 946  | 932  | 918  | 904  | 890  | 876  | 863  | 849  | 835  |
| 3H35130B15-16   | 1161       | 1144 | 1128 | 1111 | 1095 | 1078 | 1062 | 1045 | 1028 | 1012 | 995  |
| 3H35130B17-18   | 1285       | 1266 | 1248 | 1230 | 1211 | 1193 | 1174 | 1156 | 1138 | 1119 | 1101 |
| 3H35130B19-20   | 1438       | 1417 | 1396 | 1376 | 1355 | 1335 | 1314 | 1294 | 1273 | 1253 | 1232 |
| 3H36622B1-2     | 649        | 633  | 617  | 601  | 586  | 570  | 554  | 538  | 522  | 506  | 491  |
| 3H36622B3-5     | 765        | 751  | 737  | 723  | 709  | 696  | 682  | 668  | 654  | 640  | 626  |
| 3H36622B6-11    | 901        | 888  | 875  | 863  | 850  | 837  | 824  | 811  | 798  | 785  | 765  |
| 3H36622B12-17   | 1059       | 1044 | 1029 | 1014 | 999  | 984  | 968  | 953  | 938  | 923  | 901  |
| 3H36622B18-22   | 1161       | 1144 | 1128 | 1111 | 1095 | 1078 | 1062 | 1045 | 1028 | 1012 | 995  |
| 3H36622B23-26   | 1285       | 1266 | 1248 | 1230 | 1211 | 1193 | 1174 | 1156 | 1138 | 1119 | 1101 |

# BLOWER SHEAVE ASSEMBLY DATA

Table 40.1 - Blower Sheave Assembly Components

| Sheave Assembly |        | Browning<br>Belt # | Motor Sheave       |            | Blower Sheave      |               |
|-----------------|--------|--------------------|--------------------|------------|--------------------|---------------|
| Prefix          | Suffix |                    | Pitch Dia<br>(in.) | Bore (in.) | Pitch Dia<br>(in.) | Bore<br>(in.) |
| 3H35125         | 1      | A30                | 2.9                | 0.5        | 5                  | 0.75          |
|                 | 2      | A31                | 2.9                | 0.625      |                    |               |
|                 | 3      | A34                | 4.4                | 0.5        |                    |               |
|                 | 4      | A35                | 4.4                | 0.625      | 6                  |               |
|                 | 5      | A35                | 4.4                | 0.875      |                    |               |
|                 | 6      | A31                | 3.8                | 0.625      |                    |               |
|                 | 7      | A31                | 3.8                | 0.875      | 4.2                |               |
|                 | 8      | A35                | 5.6                | 0.625      |                    |               |
|                 | 9      | A35                | 5.6                | 0.875      |                    |               |
|                 | 10     | A34                | 5.6                | 0.625      | 5.2                |               |
|                 | 11     | A34                | 5.6                | 0.875      |                    |               |
| 3H35126         | 1      | A33                | 2.9                | 0.5        | 5                  | 0.75          |
|                 | 2      | A34                | 2.9                | 0.625      |                    |               |
|                 | 3      | A37                | 4.4                | 0.5        |                    |               |
|                 | 4      | A38                | 4.4                | 0.625      | 6                  |               |
|                 | 5      | A38                | 4.4                | 0.875      |                    |               |
|                 | 6      | A34                | 3.8                | 0.625      |                    |               |
|                 | 7      | A34                | 3.8                | 0.875      | 4.2                |               |
|                 | 8      | A36                | 3.8                | 1.125      |                    |               |
|                 | 9      | A38                | 5.6                | 0.625      |                    |               |
|                 | 10     | A38                | 5.6                | 0.875      | 5.2                |               |
|                 | 11     | A40                | 5.6                | 1.125      |                    |               |
|                 | 12     | A37                | 5.6                | 0.625      |                    |               |
|                 | 13     | A37                | 5.6                | 0.875      | 4.5                |               |
|                 | 14     | A39                | 5.6                | 1.125      |                    |               |
| 3H35127         | 1      | A42                | 2.9                | 0.5        | 7                  | 1             |
|                 | 2      | A43                | 2.9                | 0.625      |                    |               |
|                 | 3      | A46                | 3.8                | 0.625      |                    |               |
|                 | 4      | A45                | 3.8                | 0.875      | 7.5                |               |
|                 | 5      | A47                | 3.8                | 1.125      |                    |               |
|                 | 6      | A48                | 5                  | 0.625      |                    |               |
|                 | 7      | A48                | 5                  | 0.875      | 8                  |               |
|                 | 8      | A50                | 5                  | 1.125      |                    |               |
|                 | 9      | A43                | 4.4                | 0.875      |                    |               |
|                 | 10     | A45                | 4.4                | 1.125      | 5.7                |               |
|                 | 11     | A49                | 5.2                | 1.375      |                    |               |
|                 | 12     | A45                | 5                  | 0.875      |                    |               |
|                 | 13     | A47                | 5                  | 1.125      | 6.7                |               |
|                 | 14     | A49                | 5.2                | 1.375      | 6                  |               |
|                 | 15     | A45                | 5                  | 1.125      | 6.2                |               |
|                 | 16     | A48                | 5.6                | 1.375      | 5.2                |               |
|                 | 17     | A43                | 4.4                | 0.625      | 5.7                |               |
| 3H35128         | 1      | A47                | 2.9                | 0.5        |                    | 8             |
|                 | 2      | A48                | 2.9                | 0.625      |                    |               |
|                 | 3      | A48                | 2.9                | 0.875      |                    |               |
|                 | 4      | A50                | 3.8                | 0.625      | 8.5                |               |
|                 | 5      | A50                | 3.8                | 0.875      |                    |               |
|                 | 6      | A52                | 3.8                | 1.125      |                    |               |
|                 | 7      | A53                | 5                  | 0.625      | 9                  |               |
|                 | 8      | A52                | 5                  | 0.875      |                    |               |
|                 | 9      | A54                | 5                  | 1.125      |                    |               |
|                 | 10     | A53                | 5.6                | 0.875      | 8.5                |               |
|                 | 11     | A54                | 5.6                | 1.125      |                    |               |
|                 | 12     | A54                | 5.2                | 1.375      |                    |               |
|                 | 13     | A52                | 5.6                | 1.375      | 8                  |               |
|                 | 14     | A52                | 5.2                | 1.375      | 7                  |               |
|                 | 15     | A53                | 5.6                | 0.625      | 6.5                |               |
|                 |        |                    |                    | 8.5        |                    |               |

| Sheave Assembly |             | Browning Belt # | Motor Sheave    |            | Blower Sheave   |            |  |
|-----------------|-------------|-----------------|-----------------|------------|-----------------|------------|--|
| Prefix          | Suffix      |                 | Pitch Dia (in.) | Bore (in.) | Pitch Dia (in.) | Bore (in.) |  |
| 3H35129         | 1           | B71             | 4.1             | 0.625      | 10.9            | 1          |  |
|                 | 2           | B71             | 4.1             | 0.875      |                 |            |  |
|                 | 3           | B70             | 4.1             | 1.125      |                 |            |  |
|                 | 4           | BX71            | 4.7             | 0.625      |                 |            |  |
|                 | 5           | BX71            | 4.7             | 0.875      |                 |            |  |
|                 | 6           | BX71            | 4.7             | 1.125      | 12.4            |            |  |
|                 | 7           | BX71            | 5.5             | 1.375      |                 |            |  |
|                 | 8           | BX77            | 5.9             | 0.875      |                 |            |  |
|                 | 9           | BX75            | 5.9             | 1.125      |                 |            |  |
|                 | 10          | BX75            | 5.9             | 1.375      |                 |            |  |
|                 | 11          | BX68            | 5.3             | 1.125      | 8.9             |            |  |
|                 | 12          | BX68            | 5.5             | 1.375      | 9.4             |            |  |
|                 | 13          | BX75            | 5.5             | 1.625      |                 |            |  |
|                 | 14          | BX75            | 5.5             | 1.625      |                 |            |  |
|                 | 15          | B73             | 7               | 1.125      | 10.4            |            |  |
|                 | 16          | B72             | 7               | 1.375      |                 |            |  |
|                 | 17          | B78             | 7               | 1.625      |                 |            |  |
|                 | 18          | B78             | 7               | 1.625      |                 |            |  |
|                 | 19          | B70             | 7               | 1.375      |                 |            |  |
|                 | 20          | B77             | 7               | 1.625      | 9.4             |            |  |
|                 | 21          | B77             | 7               | 1.625      |                 |            |  |
| 3H35130         | 1           | Qty (2) B74     | 5.5             | 1.625      | 9.4             | 1.44       |  |
|                 | 2           | Qty (2) B74     | 5.5             | 1.625      |                 |            |  |
|                 | 3           | Qty (2) B78     | 7               | 1.625      | 10.4            |            |  |
|                 | 4           | Qty (2) B78     | 7               | 1.625      |                 |            |  |
|                 | 5           | Qty (2) B77     | 7               | 1.625      | 9.4             |            |  |
|                 | 6           | Qty (2) B77     | 7               | 1.625      |                 |            |  |
|                 | 13          | Qty (2) B82     | 7               | 1.875      | 12.4            |            |  |
|                 | 14          | Qty (2) B82     | 7               | 1.875      |                 |            |  |
|                 | 15          | Qty (2) B79     | 7               | 1.875      | 10.4            |            |  |
|                 | 16          | Qty (2) B79     | 7               | 1.875      |                 |            |  |
|                 | 17          | Qty (2) B77     | 7               | 1.875      | 9.4             |            |  |
|                 | 18          | Qty (2) B77     | 7               | 1.875      |                 |            |  |
|                 | 19          | Qty (2) B75     | 7               | 1.875      | 8.4             |            |  |
| 20              | Qty (2) B75 | 7               | 1.875           |            |                 |            |  |
| 3H36622         | 1           | B75             | 4.1             | 0.875      | 10.9            | 1.44       |  |
|                 | 2           | BX73            | 4.1             | 1.125      |                 |            |  |
|                 | 3           | B72             | 4.1             | 0.875      | 8.9             |            |  |
|                 | 4           | B70             | 4.1             | 1.125      |                 |            |  |
|                 | 5           | BX78            | 5.5             | 1.375      | 12.4            |            |  |
|                 | 6           | B74             | 4.7             | 1.125      | 8.9             |            |  |
|                 | 7           | BX75            | 5.5             | 1.375      | 10.4            |            |  |
|                 | 8           | Qty (2) BX82    | 6               | 1.625      | 11.4            |            |  |
|                 | 9           | Qty (2) BX82    | 6               | 1.625      |                 |            |  |
|                 | 10          | Qty (2) B86     | 7               | 1.875      | 13.4            |            |  |
|                 | 11          | Qty (2) B86     | 7               | 1.875      |                 |            |  |
|                 | 12          | B71             | 5.3             | 1.125      | 8.4             |            |  |
|                 | 13          | BX74            | 5.9             | 1.375      | 9.4             |            |  |
|                 | 14          | Qty (2) BX79    | 6               | 1.625      |                 |            |  |
|                 | 15          | Qty (2) BX79    | 6               | 1.625      |                 |            |  |
|                 | 16          | Qty (2) B83     | 7               | 1.875      | 11.4            |            |  |
|                 | 17          | Qty (2) B83     | 7               | 1.875      |                 |            |  |
|                 | 18          | B77             | 7               | 1.375      | 10.4            |            |  |
|                 | 19          | Qty (2) B82     | 7               | 1.625      |                 |            |  |
|                 | 20          | Qty (2) B82     | 7               | 1.625      |                 |            |  |
|                 | 21          | Qty (2) B81     | 7               | 1.875      |                 |            |  |
|                 | 22          | Qty (2) B81     | 7               | 1.875      |                 |            |  |
|                 | 23          | Qty (2) B80     | 7               | 1.625      | 9.4             |            |  |
|                 | 24          | Qty (2) B80     | 7               | 1.625      |                 |            |  |
|                 | 25          | Qty (2) B80     | 7               | 1.875      |                 |            |  |
|                 | 26          | Qty (2) B80     | 7               | 1.875      |                 |            |  |

**PAGE INTENTIONALLY LEFT BLANK**

## DIMENSIONS - UNIT

Figure 42.1 - DBS Separated Combustion Blower Package Unit Dimensions

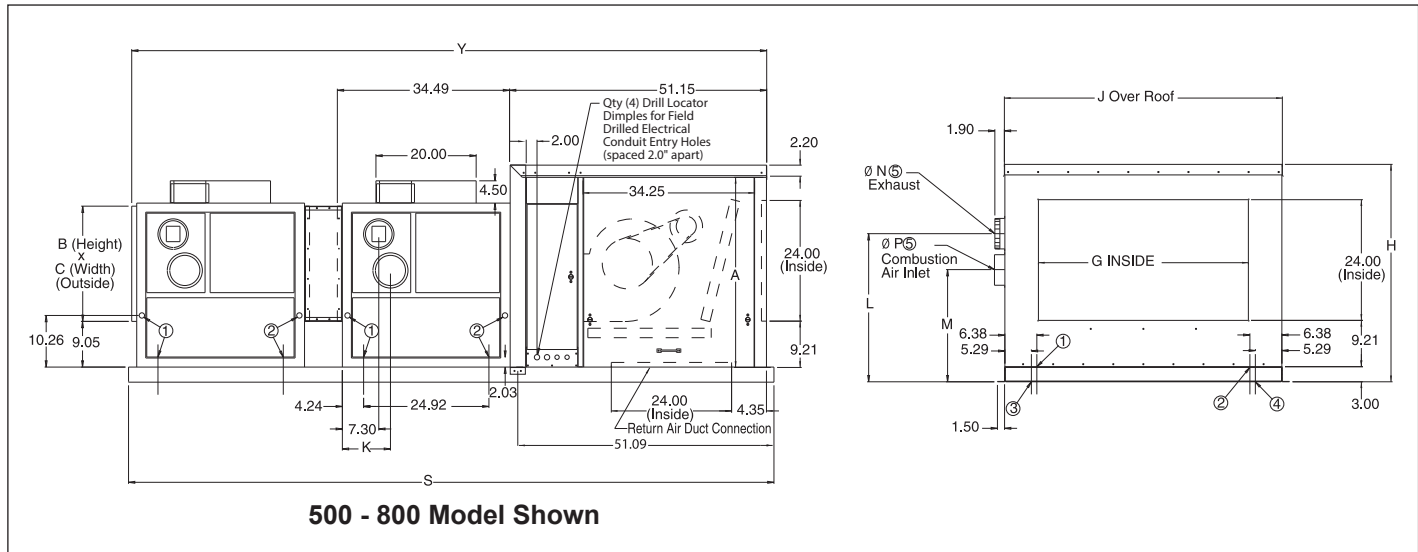


Figure 42.2 - DCS Separated Combustion Cooling Package Unit Dimensions

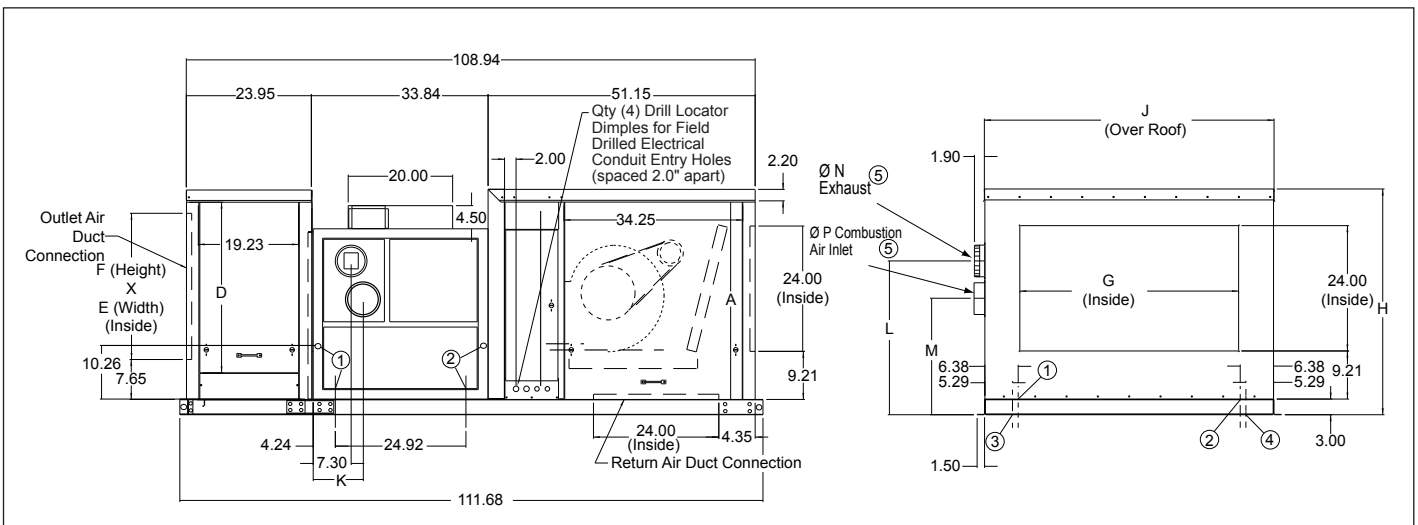


Table 42.1 - Indoor Separated Combustion Unit Dimensions (All dimensions in inches)

| Model Size | Blower Type<br>(Digit 16) | Qty. of<br>Furnaces | Dimensions |       |       |       |       |       |       |       |       |       |       |       |      |      |        |        |       | Gas |
|------------|---------------------------|---------------------|------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|------|------|--------|--------|-------|-----|
|            |                           |                     | A          | B     | C     | D     | E     | F     | G     | H     | J     | K     | L     | M     | N ⑤  | P ⑤  | S      | Y      | Conn. |     |
| 75         | All                       | 1                   | 33.75      | 18.90 | 15.18 | 28.75 | 18.00 | 25.00 | 20.02 | 39.23 | 32.06 | 10.26 | 23.08 | 18.19 | 3.86 | 4.17 | 87.77  | 85.69  | 1/2   |     |
| 100/125    | All                       | 1                   | 33.75      | 18.90 | 17.67 | 28.75 | 21.00 | 25.00 | 20.02 | 39.23 | 34.56 | 10.26 | 23.08 | 18.19 | 3.86 | 4.17 | 87.77  | 85.69  | 1/2   |     |
| 150/175    | All                       | 1                   | 33.75      | 18.90 | 21.95 | 28.75 | 24.00 | 25.00 | 23.99 | 39.23 | 38.82 | 10.26 | 23.08 | 18.19 | 3.86 | 4.17 | 87.77  | 85.69  | 1/2   |     |
| 200/225    | All                       | 1                   | 37.75      | 22.90 | 24.05 | 32.75 | 27.00 | 28.00 | 23.99 | 43.23 | 40.94 | 9.60  | 26.43 | 19.21 | 5.86 | 6.18 | 87.77  | 85.69  | 1/2   |     |
| 250/300    | E, F, G, or H             | 1                   | 37.75      | 22.90 | 27.05 | 32.75 | 30.00 | 28.00 | 29.96 | 43.23 | 44.05 | 9.60  | 26.43 | 19.21 | 5.86 | 6.18 | 87.77  | 85.69  | 3/4   |     |
| 350/400    | E, F, G, or H             | 1                   | 37.75      | 22.90 | 38.60 | 32.75 | 42.00 | 28.00 | 41.90 | 43.23 | 55.57 | 9.60  | 26.43 | 19.21 | 5.86 | 6.18 | 87.77  | 85.69  | 3/4   |     |
| 500/600    | G or H                    | 2                   | 37.75      | 22.90 | 27.05 | 32.75 | n/a   | n/a   | 29.96 | 43.23 | 44.05 | 9.60  | 26.43 | 19.21 | 5.86 | 6.18 | 128.77 | 126.78 | 3/4   |     |
| 700/800    | G or H                    | 2                   | 37.75      | 22.90 | 38.60 | 32.75 | n/a   | n/a   | 41.90 | 43.23 | 55.57 | 9.60  | 26.43 | 19.21 | 5.86 | 6.18 | 128.77 | 126.78 | 3/4   |     |

① For Right Hand Access Units - Location of drill locator dimples for field drilled gas connection entry holes - one side of unit and one on bottom.

② For Left Hand Access Units - Location of drill locator dimples for field drilled gas connection entry holes - one side of unit and one on bottom.


③ For Right Hand Access Units - Location of drill locator dimples for field drilled electrical connection entry holes - identical sizes as side electrical connections.

④ For Left Hand Access Units - Location of drill locator dimples for field drilled electrical connection entry holes - identical sizes as side electrical connections.


⑤ Nominal vent pipe size is 4" (Models 75-175) and 6" (Models 200-800). Exhaust pipe installed over collar. Combustion air pipe installed collar.

## DIMENSIONS - UNIT

**Figure 43.1 - DBS Separated Combustion Blower Package Unit Dimensions with Blower Type I, J, K, or L**

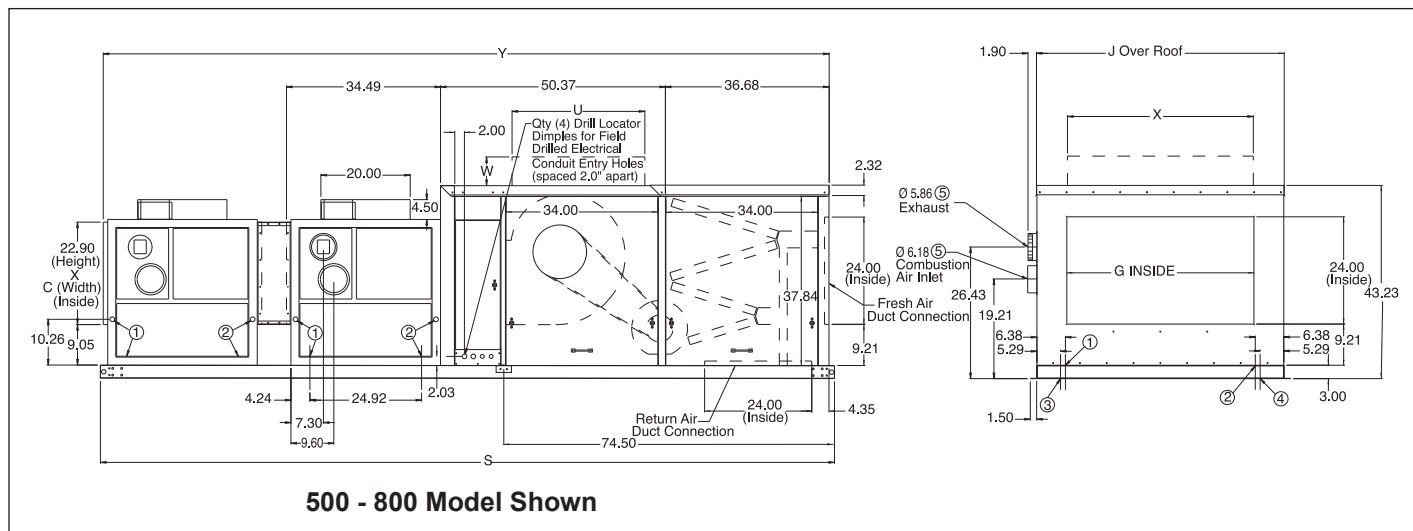

**Figure 43.2 - DCS Separated Combustion Cooling Package Unit Dimensions with Blower Type I, J, or K**

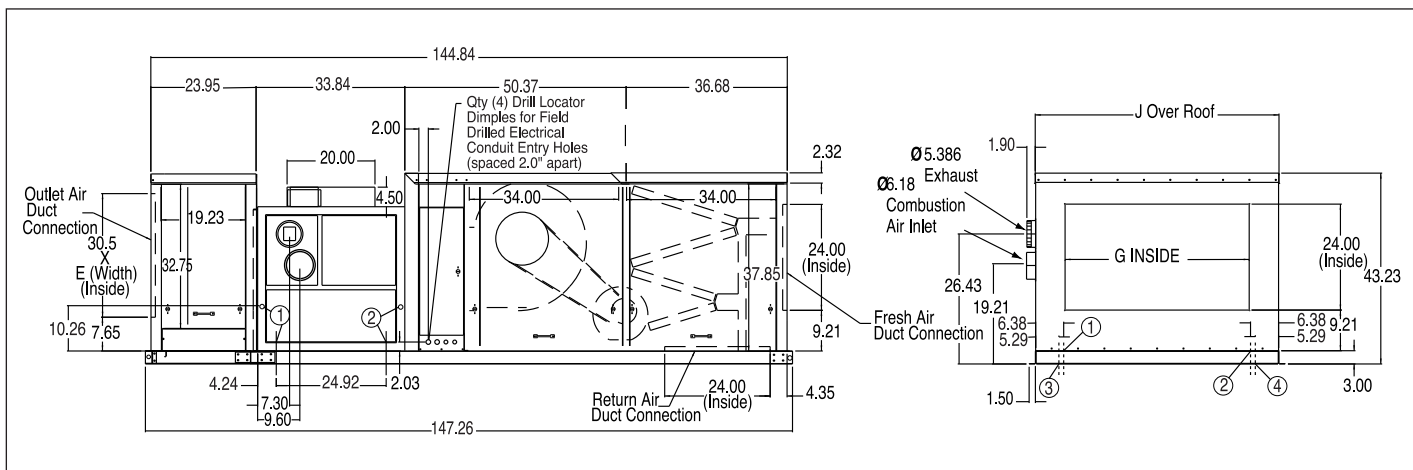


**Table 43.1 - Indoor Separated Combustion Unit Dimensions with Blower I, J, K, or L (All dimensions in inches)**

| Model Size | Blower Type (Digit 16) | Qty. of Furnaces | Dimensions |       |       |       |        |       |      |       |        | Gas Conn. |
|------------|------------------------|------------------|------------|-------|-------|-------|--------|-------|------|-------|--------|-----------|
|            |                        |                  | C          | E     | G     | J     | S      | U ⑤   | W ⑤  | X ⑤   | Y      |           |
| 250/300    | I, J, or K             | 1                | 27.05      | 30.00 | 29.96 | 44.05 | 123.63 | n/a   | n/a  | n/a   | 121.53 | 3/4       |
| 350/400    | I, J, or K             | 1                | 38.60      | 42.00 | 41.90 | 55.57 | 123.63 | n/a   | n/a  | n/a   | 121.53 | 3/4       |
| 500/600    | I, J, K, or L          | 2                | 27.05      | n/a   | 29.96 | 44.05 | 164.63 | 29.74 | 6.50 | 41.62 | 162.63 | 3/4       |
| 700/800    | I, J, K, or L          | 2                | 38.60      | n/a   | 41.90 | 55.57 | 164.63 | 29.74 | 6.50 | 41.62 | 162.63 | 3/4       |
| 840/960    | I, J, K, or L          | 3                | 38.60      | n/a   | 41.90 | 55.57 | 205.77 | 29.74 | 6.50 | 41.62 | 203.72 | 3/4       |

- ① For Right Hand Access Units - Location of drill locator dimples for field drilled gas connection entry holes - one side of unit and one on bottom.
- ② For Left Hand Access Units - Location of drill locator dimples for field drilled gas connection entry holes - one side of unit and one on bottom.
- ③ For Right Hand Access Units - Location of drill locator dimples for field drilled electrical connection entry holes - identical sizes as side electrical connections.
- ④ For Left Hand Access Units - Location of drill locator dimples for field drilled electrical connection entry holes - identical sizes as side electrical connections.
- ⑤ Nominal vent pipe size is 4" (Models 75-175) and 6" (Models 200-800). Exhaust pipe installed over collar. Combustion air pipe installed collar.
- ⑥ Applies to units with Digit 16 = L only.

# DIMENSIONS - UNIT

**Figure 44.1 - Unit Base Dimensions**

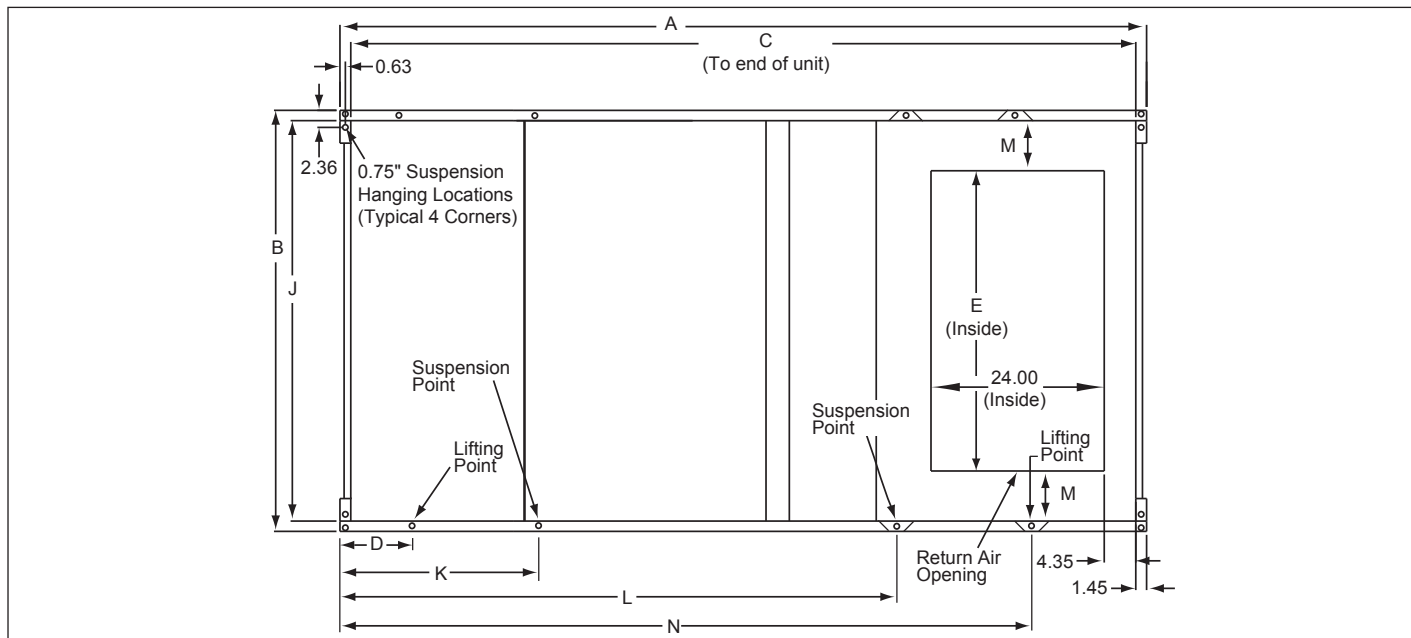

**Table 44.1 - Indoor Separated Combustion Blower Package Units (All dimensions in inches)**

| Model Size | Blower Type (Digit 16) | Dimensions |       |        |       |       |        |       |        |       |        |       |      |
|------------|------------------------|------------|-------|--------|-------|-------|--------|-------|--------|-------|--------|-------|------|
|            |                        | A          | B     | C      | D     | E     | F      | G     | N      | K     | L      | J     | M    |
| 75         | All                    | 87.77      | 34.85 | 84.73  |       | 19.52 | 81.88  | 56.96 |        |       |        | 32.00 | 6.23 |
| 100/125    | All                    | 87.77      | 37.36 | 84.73  |       | 19.52 | 81.88  | 56.96 |        |       |        | 34.50 | 7.49 |
| 150/175    | All                    | 87.77      | 41.61 | 84.73  |       | 23.49 | 81.88  | 56.96 |        |       |        | 38.75 | 7.63 |
| 200/225    | All                    | 87.77      | 43.71 | 84.73  |       | 23.49 | 81.88  | 56.96 |        |       |        | 40.85 | 8.69 |
| 250/300    | E,F,G, or H            | 87.77      | 46.75 | 84.73  |       | 29.46 | 81.88  | 56.96 |        |       |        | 43.89 | 7.21 |
| 250/300    | I, J, or K             | 123.62     | 46.75 | 120.57 |       | 29.46 | 117.73 | 92.81 |        |       |        | 43.89 | 7.21 |
| 350/400    | E,F,G, or H            | 87.77      | 58.27 | 84.73  |       | 41.40 | 81.88  | 56.96 |        |       |        | 55.41 | 7.00 |
| 350/400    | I, J, or K             | 123.62     | 58.27 | 120.57 |       | 41.40 | 117.73 | 92.81 |        |       |        | 55.41 | 7.00 |
| 500/600    | G, or H                | 128.77     | 46.75 | 119.54 | 42.00 | 29.46 | 81.88  | 56.96 | 97.03  | 42.00 |        | 43.89 | 7.21 |
| 500/600    | I, J, K, or L          | 164.63     | 46.75 | 155.41 | 42.00 | 29.46 | 117.73 | 92.81 | 125.70 | 90.15 |        | 43.89 | 7.21 |
| 700/800    | G, or H                | 128.77     | 58.27 | 119.54 | 42.00 | 41.40 | 81.88  | 56.96 | 97.03  | 42.00 |        | 55.41 | 7.00 |
| 700/800    | I, J, K, or L          | 164.63     | 58.27 | 155.41 | 42.00 | 41.40 | 117.73 | 92.81 | 125.70 | 90.15 |        | 55.41 | 7.00 |
| 840/960    | I, J, K, or L          | 205.77     | 58.27 | 196.52 | 48.58 | 41.40 | 117.73 | 92.81 | 166.84 | 82.94 | 166.84 | 55.41 | 7.00 |


**Table 44.2 - Indoor Separated Combustion Cooling Package Units (All dimensions in inches)**

| Model Size | Blower Type (Digit 16) | Dimensions |       |        |       |        |       |       |      |
|------------|------------------------|------------|-------|--------|-------|--------|-------|-------|------|
|            |                        | A          | B     | C      | E     | F      | G     | J     | M    |
| 75         | All                    | 111.75     | 34.85 | 108.75 | 19.52 | 81.88  | 56.96 | 32.00 | 6.23 |
| 100/125    | All                    | 111.75     | 37.36 | 108.75 | 19.52 | 81.88  | 56.96 | 34.50 | 7.49 |
| 150/175    | All                    | 111.75     | 41.61 | 108.75 | 23.49 | 81.88  | 56.96 | 38.75 | 7.63 |
| 200/225    | All                    | 111.75     | 43.71 | 108.75 | 23.49 | 81.88  | 56.96 | 40.85 | 8.69 |
| 250/300    | E, F, G, or H          | 111.75     | 46.75 | 108.75 | 29.46 | 81.88  | 56.96 | 43.89 | 7.21 |
| 250/300    | I, J, or K             | 147.60     | 46.75 | 144.60 | 29.46 | 117.73 | 92.81 | 43.89 | 7.21 |
| 350/400    | E, F, G, or H          | 111.75     | 58.27 | 108.75 | 41.40 | 81.88  | 56.96 | 55.41 | 7.00 |
| 350/400    | I, J, or K             | 147.60     | 58.27 | 144.60 | 41.40 | 117.73 | 92.81 | 55.41 | 7.00 |

① Gas connection for 1st furnace. For Models 500-800 add 41.09" for second furnace gas connection.  
For Model 840-960 add 41.09" and 82.19" for second and third furnace gas connections.

## DIMENSIONS - COOLING COILS

**Figure 44.1 - DX Coil Drawing** - (All dimensions in inches)

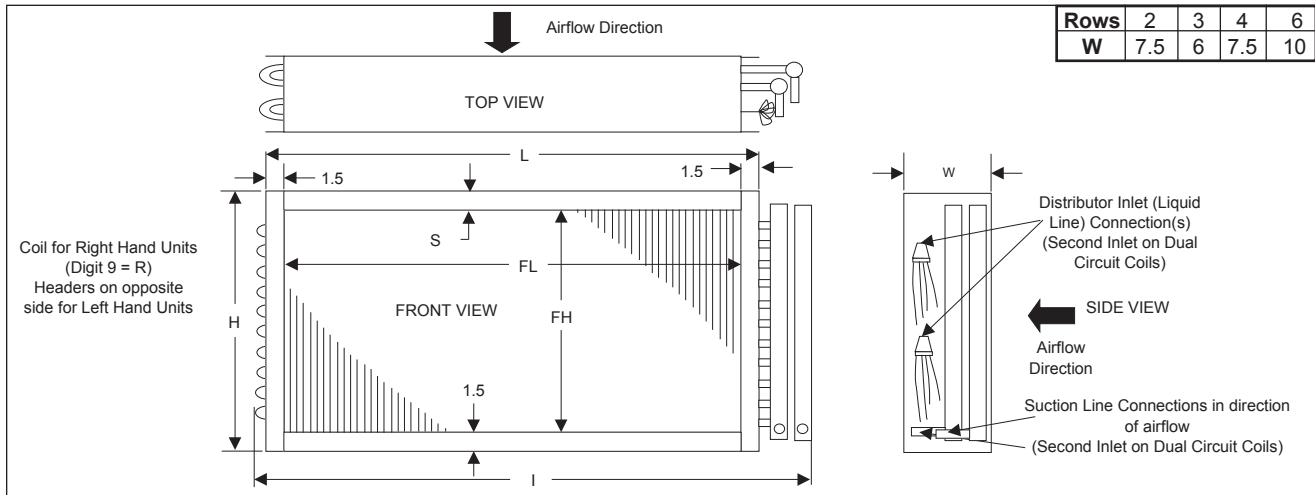


**Table 44.1 - DX Coil Dimensions**

| Model Size | Cooling MBH   | FH   | H    | S   | DX - Single Circuit ① |      |    | DX - Dual Circuit ② |       |       |
|------------|---------------|------|------|-----|-----------------------|------|----|---------------------|-------|-------|
|            |               |      |      |     | FL                    | I    | L  | FL                  | I     | L     |
| 75         | All           | 27.5 | 30.5 | 1.5 | 18                    | 25   | 21 | 16.25               | 26.5  | 19.25 |
| 100/125    | All           | 27.5 | 30.5 | 1.5 | 21                    | 28   | 24 | 19.5                | 29.75 | 22.5  |
| 150/175    | All           | 27.5 | 30.5 | 1.5 | 24                    | 31   | 27 | 23                  | 33.25 | 28.5  |
| 200/225    | Below 185 MBH | 32.5 | 34.5 | 0.5 | 27                    | 34   | 30 | 25.5                | 35.75 | 28.5  |
|            | 185 MBH & Up  | 32.5 | 34.5 | 0.5 | 27                    | 34.5 | 30 |                     |       |       |
| 250/300    | Below 185 MBH | 32.5 | 34.5 | 0.5 | 30                    | 37   | 33 | 28.5                | 38.75 | 31.5  |
|            | 185 MBH & Up  | 32.5 | 34.5 | 0.5 | 30                    | 37.5 | 33 |                     |       |       |
| 350/400    | Below 185 MBH | 32.5 | 34.5 | 0.5 | 42                    | 49   | 45 | 40.25               | 50.5  | 43.25 |
|            | 185 MBH & Up  | 32.5 | 34.5 | 0.5 | 42                    | 49.5 | 45 |                     |       |       |

① Single Circuit DX coils have 1 each Suction Line and Liquid Lines. Refer to AccuSpec for line size diameters.

② Dual Circuit DX coils have 2 each Suction Line and Liquid Lines. Refer to AccuSpec for line size diameters.

**Figure 44.2 - Chilled Water Coil Drawing** (All dimensions in inches)

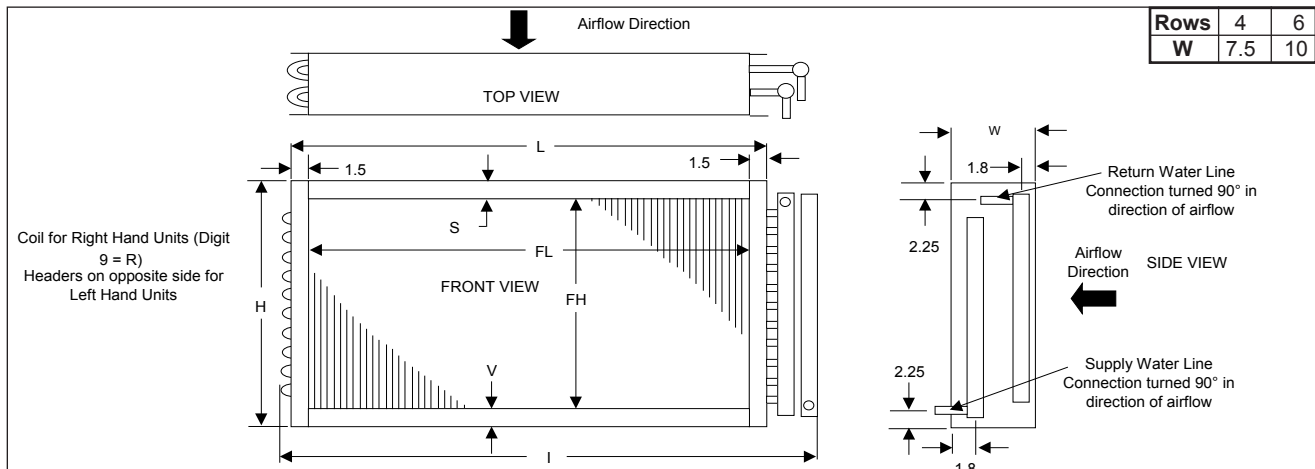


**Table 44.2 - Chilled Water Coil Dimensions**

| Model Size | FH | H    | S   | V   | FL    | I     | L     | Supply Line | Return Line |
|------------|----|------|-----|-----|-------|-------|-------|-------------|-------------|
| 75         | 27 | 30   | 1.5 | 1.5 | 16.25 | 25.50 | 19.25 | 1.50 MPT    | 1.50 MPT    |
| 100/125    | 27 | 30   | 1.5 | 1.5 | 19.50 | 28.75 | 22.50 | 1.50 MPT    | 1.50 MPT    |
| 150/175    | 27 | 30   | 1.5 | 1.5 | 23.00 | 32.25 | 26.00 | 1.50 MPT    | 1.50 MPT    |
| 200/225    | 33 | 34.5 | 0.5 | 1   | 25.50 | 34.75 | 28.50 | 1.50 MPT    | 1.50 MPT    |
| 250/300    | 33 | 34.5 | 0.5 | 1   | 28.50 | 37.75 | 31.50 | 1.50 MPT    | 1.50 MPT    |
| 350/400    | 33 | 34.5 | 0.5 | 1   | 40.25 | 49.50 | 43.25 | 1.50 MPT    | 1.50 MPT    |

# DIMENSIONS/WEIGHTS / MAINTENANCE

**Figure 46.1 - Remote Panel Dimensions**

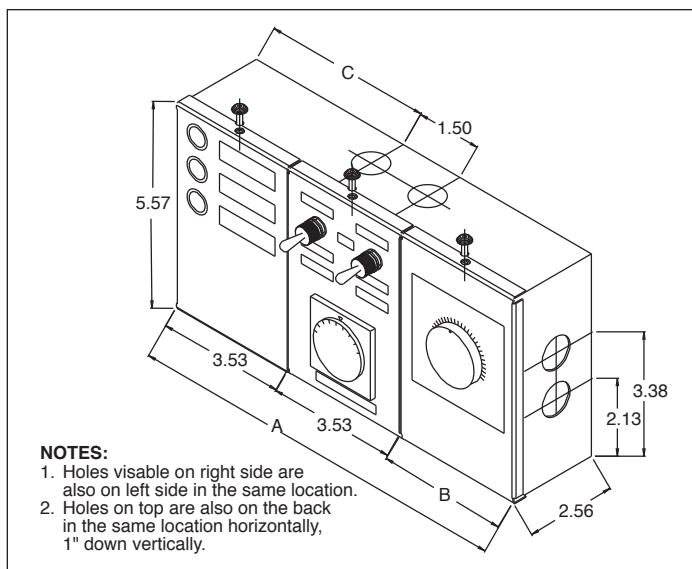

**Table 46.1 - Remote Panel Dimensions**

(All dimensions in inches)

| Remote Panel Type                                                                     | A     | B    | C    |
|---------------------------------------------------------------------------------------|-------|------|------|
| Light and Switch Panels Only                                                          | 7.06  | -    | 2.81 |
| Light and Switch Panels with Single Stage Thermostat or Electronic Set Point Adjustor | 10.60 | 3.53 | 4.58 |
| Light and Switch Panels with Two Stage Thermostat                                     | 13.09 | 6.03 | 5.82 |

**Table 46.2 - Blower Package Unit Operating Weights ①**

| Model Size | Blower Type (Digit 16) | Unit | Motor          | Filters | Dampers Fresh Air | Dampers F & RA | Insulation | Double Wall (All Sections) |
|------------|------------------------|------|----------------|---------|-------------------|----------------|------------|----------------------------|
| 75         | All                    | 373  | See Motor Data | 6       | 26                | 46             | 5          | 38                         |
| 100/125    | All                    | 409  |                | 6       | 26                | 46             | 5          | 38                         |
| 150/175    | All                    | 441  |                | 6       | 29                | 52             | 5          | 43                         |
| 200/225    | All                    | 515  |                | 6       | 29                | 52             | 7          | 46                         |
| 250/300    | E,F,G, or H            | 568  |                | 8       | 33                | 60             | 7          | 46                         |
| 250/300    | I, J, or K             | 817  |                | 15      | 33                | 60             | 14         | 93                         |
| 350/400    | E,F,G, or H            | 652  |                | 12      | 38                | 70             | 7          | 53                         |
| 350/400    | I, J, or K             | 933  |                | 17      | 38                | 70             | 14         | 96                         |
| 500/600    | G or H                 | 843  |                | 8       | 33                | 60             | 7          | 46                         |
| 500/600    | I, J, K, or L          | 1092 |                | 15      | 33                | 60             | 14         | 93                         |
| 700/800    | G or H                 | 981  |                | 12      | 38                | 70             | 7          | 53                         |
| 700/800    | I, J, K, or L          | 1262 |                | 17      | 38                | 70             | 14         | 96                         |
| 840/960    | I, J, K, or L          | 1591 |                | 17      | 38                | 70             | 14         | 96                         |

**Table 46.3 - Cooling Package Unit Operating Weights ①**

| Model Size | Blower Type (Digit 16) | DCS Unit | Motor          | Filters | Dampers Fresh Air | Dampers F & RA | Insulation (Indoor only) | Double Wall (All Sections) |
|------------|------------------------|----------|----------------|---------|-------------------|----------------|--------------------------|----------------------------|
| 75         | All                    | 480      | See Motor Data | 6       | 26                | 46             | 10                       | 72                         |
| 100/125    | All                    | 519      |                | 6       | 26                | 46             | 10                       | 72                         |
| 150/175    | All                    | 556      |                | 6       | 29                | 52             | 10                       | 77                         |
| 200/225    | All                    | 641      |                | 6       | 29                | 52             | 12                       | 85                         |
| 250/300    | E,F,G, or H            | 698      |                | 8       | 33                | 60             | 12                       | 87                         |
| 250/300    | I, J, or K             | 947      |                | 15      | 33                | 60             | 19                       | 134                        |
| 350/400    | E,F,G, or H            | 801      |                | 12      | 38                | 70             | 12                       | 101                        |
| 350/400    | I, J, or K             | 1082     |                | 17      | 38                | 70             | 19                       | 144                        |

① All weights in inches.

## MAINTENANCE

### ⚠ WARNING

When servicing or repairing this equipment, use only factory-approved service replacement parts. A complete replacement parts list may be obtained by contacting Modine Manufacturing Company. Refer to the rating plate on the appliance for complete appliance model number, serial number, and company address. Any substitution of parts or controls not approved by the factory will be at the owner's risk.

### ⚠ CAUTION

Do not attempt to reuse any mechanical or electrical controllers which have been wet. Replace defective controller.

### IMPORTANT

To check most of the Possible Remedies in the troubleshooting guide listed in Table 49.1 to 50.1, refer to the applicable sections of the manual.

All heating equipment should be serviced before each heating season to assure proper operations. The following items may be required to have more frequent service schedule based on the environment in which the unit is installed, and the frequency of the equipment operation.

#### Blower Assembly

The blower assembly includes the bearings, drive sheaves and belts. Blower bearings should be checked and lubricated based on the blower manufacturer's recommendations. Bearings should also be checked for any unusual wear and replaced if needed.


Drive sheaves should be checked at the same time the bearings are inspected. Check to make sure the sheaves are in alignment and are securely fastened to the blower and motor shafts. Belt tension should be rechecked shortly after the unit has been installed to check for belt stretching. After the initial start-up, monthly checks are recommended.

#### Filters


If the unit is supplied with a dirty filter switch and light, clean or replace the filters any time the dirty filter light comes on.

Units which do not have a dirty filter warning light should have the filters checked monthly. Clean or replace if necessary. In dirty atmospheres, filter maintenance may be required more often.

**Figure 47.1 - Filter Replacement Arrangement for Blower Size (Digit 16) A, B, C, D, E, F, G and H**

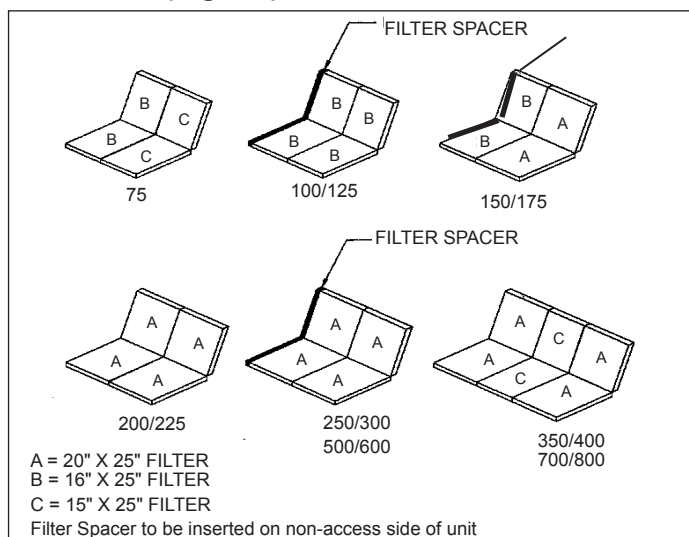

**Figure 47.2 - Filter Replacement Arrangement for Blower Size (Digit 16) I, J, K, and L**

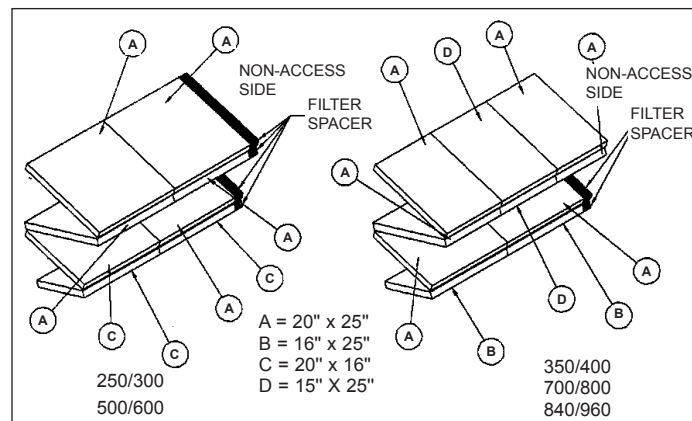

#### Cooling Coil Drain Pan and Drain System

The drain pan, trap, and drain pipe must be cleaned regularly to avoid blockage that can reduce or stop water flow as follows:

1. At the beginning of the cooling season, inspect and clean the entire cooling coil cabinet and condensate drain pan to remove contaminants.
2. Inspect and clean the condensate drain trap and piping. The use of a cleanout opening at the top of the trap can help facilitate this maintenance.
3. Fill the trap with water to ensure proper operation and replace the cap on the cleanout opening to close the system.
4. During the end of cooling season shutdown of the system, disconnect and remove all water from the trap and drain to prevent freeze damage. If local building codes permit, the trap may be filled with an antifreeze solution.
5. If the unit is used year round, regularly inspect and clean the cooling coil cabinet, condensate drain pan, and trap/drain system to ensure proper function.
6. Depending on climate, freeze protection of the trap may be required during non-cooling days.

#### Cooling Coil Maintenance

1. Periodically, inspect the coil for signs of corrosion and leaks. Repair and replacement of the coil and the connecting piping, valves, etc., must be performed as needed by a qualified technician.
2. Should the coil surface need cleaning, caution should be exercised in selecting the cleaning solution as well as the cleaning equipment. Improper selection can result in damage to the coil and/or health hazards. Cleaning solutions must not be corrosive or cause damage to copper tube/aluminum fin coils. Clean the coil from the leaving air-side so that foreign material will be washed out of the coil rather than pushed further in. Be sure to carefully read and follow the cleaning fluid manufacturer's recommendations before using any cleaning fluid.
3. For DX coils, replace the filter dryer(s) as needed.
4. For chilled fluid coils:
  - a. Maintain the circulated fluid free of sediment, corrosive products and biological contaminants.
  - b. Freeze Protection - During the winter, chilled water coils need to be protected against freezing. Two common methods are 1) blowing out the coils with air, or 2) flushing coils with inhibited glycol designed for corrosion protection in HVAC applications. Select an inhibited glycol solution that will protect the coil from the lowest possible temperatures that can occur at that locality.


# MAINTENANCE

## Manifold Assembly Removal

### To remove the manifold (Refer to Figure 48.1)

1. Shut off gas and electric supply.
2. Disconnect gas manifold at ground union joint.
3. Remove the two screws holding the manifold to the heat exchanger support.
4. Slide the manifold through the manifold bracket.
5. Clean the orifices and adjust the air shutters as necessary.
6. Follow steps 3-6 in reverse order to install the manifold assembly.
7. Turn on the electric and gas supply.
8. Check the ground union joint for leaks with a soap solution. Tighten if necessary.

**Figure 48.1 - Manifold Assembly Removal**

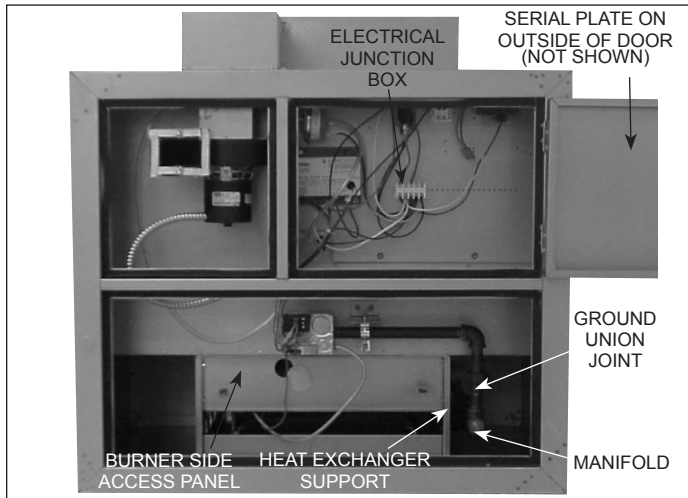


## Burner and Pilot Assembly Removal

### To remove the burner (Refer to Figure 48.2)

1. Shut off gas and electric supply.
2. Disconnect the pilot supply line from the gas valve.
3. Disconnect the ignition cable from the ignition controller (located in the electrical junction box). Feed the cable through the bushing in the bottom of the electrical junction box.
4. Remove the screws holding the burner side access panel. Attached to the panel are the burner retaining pins that align the burner.
5. Slide the burner assembly out. The pilot is attached to the burner assembly.
6. Examine the burner and pilot assembly for cleanliness and/or obstructions as necessary (see Duct Furnace for cleaning instructions).
7. Replace the burner assembly in reverse order. In replacing the burner, be certain that the rear burner slots are located properly on the burner retaining pins. Do not force the burner side access panel, it will not fit if the burner is not properly aligned.
8. Reconnect the ignition cable and pilot gas supply line.
9. Turn on the electric and gas supply.

**Figure 48.2 - Burner and Pilot Assembly Removal**

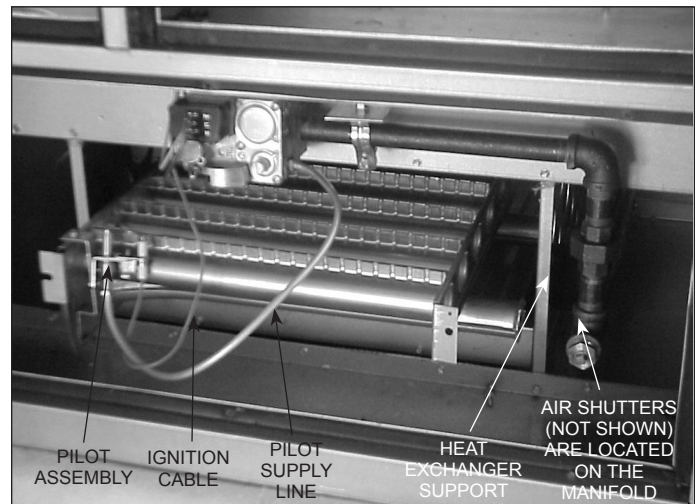

## SERVICE & TROUBLESHOOTING

### WARNING

When servicing or repairing this equipment, use only Modine-approved service replacement parts. A complete replacement parts list may be obtained by contacting Modine Manufacturing Company. Refer to the rating plate on the appliance for complete appliance model number, serial number, and company address. Any substitution of parts or controls not approved by Modine will be at the owner's risk.

### CAUTION

Do not attempt to reuse ignition controllers which have been wet. Replace defective controller.

### IMPORTANT

To check most of the Possible Remedies in the troubleshooting guide listed in Tables 49.1 and 50.1, refer to the applicable sections of the manual.

**Table 49.1 - Troubleshooting**

| Trouble                                                                             | Possible Cause                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             | Possible Remedy                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Power Exhauster Motor will not start</b>                                         | <ol style="list-style-type: none"> <li>1. Power supply is off.</li> <li>2. No 24V power to thermostat.</li> <li>3. Thermostat malfunction.</li> <li>4. Defective power exhauster relay.</li> <li>5. Defective power exhauster motor.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                            | <ol style="list-style-type: none"> <li>1. Turn on main power.</li> <li>2. Check control transformer.</li> <li>3. Check/replace thermostat.</li> <li>4. Replace power exhauster relay.</li> <li>5. Replace power exhauster motor.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>Pilot does not light</b>                                                         | <ol style="list-style-type: none"> <li>1. Main gas is off.</li> <li>2. Power supply is off.</li> <li>3. Air in gas line.</li> <li>4. Dirt in pilot orifice.</li> <li>5. Gas pressure out of proper range.</li> <li>6. Pilot valve does not open. <ol style="list-style-type: none"> <li>a. Defective ignition controller.</li> <li>b. Defective gas valve.</li> </ol> </li> <li>7. No Spark at ignitor. <ol style="list-style-type: none"> <li>a. Loose wire connections.</li> <li>b. Pilot sensor is grounded.</li> <li>c. Defective ignition controller.</li> </ol> </li> <li>8. Safety device has cut power.</li> </ol> | <ol style="list-style-type: none"> <li>1. Open manual gas valve.</li> <li>2. Turn on main power.</li> <li>3. Purge gas line.</li> <li>4. Check for plugged pilot orifice and clean with compressed air if necessary.</li> <li>5. Adjust to a maximum of 14" W.C. Minimum for Natural Gas - 6" W.C. Minimum for Propane Gas - 11" W.C.</li> <li>6. Check wiring for 24 volts to valve. <ol style="list-style-type: none"> <li>a. Replace ignition controller.</li> <li>b. Replace gas valve.</li> </ol> </li> <li>7. <ol style="list-style-type: none"> <li>a. Check all ignition controller wiring.</li> <li>b. Replace sensor if cracked or worn</li> <li>c. Replace ignition controller.</li> </ol> </li> <li>8. Check all safety devices (High limit, air flow proving switch, differential pressure switch, gas pressure switches, etc.) Determine and correct problem. Reset if necessary.</li> </ol> |
| <b>Main burners do not light (Pilot is lit)</b>                                     | <ol style="list-style-type: none"> <li>1. Defective valve.</li> <li>2. Loose wiring.</li> <li>3. Defective pilot sensor</li> <li>4. Defective ignition controller.</li> <li>5. Improper thermostat wiring.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                      | <ol style="list-style-type: none"> <li>1. Replace valve.</li> <li>2. Check wiring to gas valve.</li> <li>3. Replace pilot sensor.</li> <li>4. Replace ignition controller.</li> <li>5. Verify wiring compared to wiring diagram.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>Lifting Flames (See Figure 50.1)</b>                                             | <ol style="list-style-type: none"> <li>1. Too much primary air.</li> <li>2. Main pressure set too high.</li> <li>3. Orifice too large.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                          | <ol style="list-style-type: none"> <li>1. Reduce primary air.</li> <li>2. Adjust to a maximum of 14" W.C.</li> <li>3. Check orifice size with those listed on the serial plate.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>Yellow Tipping</b><br>(With propane gas, some yellow tipping is always present.) | <ol style="list-style-type: none"> <li>1. Insufficient primary air.</li> <li>2. Dirty orifice.</li> <li>3. Misaligned orifice.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  | <ol style="list-style-type: none"> <li>1. Increase primary air.</li> <li>2. Check orifices and clean with compressed air if necessary.</li> <li>3. Check manifold, replace if necessary.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| <b>Flashback</b>                                                                    | <ol style="list-style-type: none"> <li>1. Too much primary air.</li> <li>2. Main pressure set too high.</li> <li>3. Orifice too large.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                          | <ol style="list-style-type: none"> <li>1. Reduce primary air.</li> <li>2. Adjust to a maximum of 14" W.C.</li> <li>3. Check orifice size with those listed on the serial plate.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |

# SERVICE & TROUBLESHOOTING


**Table 50.1 - Troubleshooting (continued)**

| Trouble                                  | Possible Cause                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      | Possible Remedy                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
|------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Floating Flames (See Figure 50.2)</b> | <ol style="list-style-type: none"> <li>Insufficient primary air.</li> <li>Main pressure set too high.</li> <li>Orifice too large.</li> <li>Blocked vent.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 | <ol style="list-style-type: none"> <li>Increase primary air.</li> <li>Adjust to a maximum of 14" W.C.</li> <li>Check orifice size with those listed on the serial plate.</li> <li>Clean/correct venting system.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>Flame Rollout (See Figure 50.3)</b>   | <ol style="list-style-type: none"> <li>Main pressure set too high.</li> <li>Orifice too large.</li> <li>Blocked vent.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | <ol style="list-style-type: none"> <li>Adjust to a maximum of 14" W.C.</li> <li>Check orifice size with those listed on the serial plate.</li> <li>Clean/correct venting system.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>Not Enough Heat</b>                   | <ol style="list-style-type: none"> <li>Unit cycling on high limit. ①               <ol style="list-style-type: none"> <li>Obstructions/leaks in duct system.</li> <li>Main pressure set too high.</li> <li>Blower motor not energized.</li> <li>Loose belt</li> <li>Blower speed too low.</li> <li>Blocked/damaged venting system.</li> <li>Air distribution baffle removed (high temperature rise units only).</li> <li>Defective high limit switch.</li> </ol> </li> <li>Main pressure set too low.</li> <li>Too much outside air.</li> <li>Thermostat malfunction.</li> <li>Gas controls wired incorrectly.</li> <li>Unit undersized.</li> </ol> | <ol style="list-style-type: none"> <li> <ol style="list-style-type: none"> <li>Clean/correct duct system.</li> <li>Adjust to a maximum of 14" W.C.</li> <li>Check/correct to insure blower motor operates within 45 seconds of when - gas controls are energized.</li> <li>Adjust belt tension.</li> <li>Check/correct blower drive settings for proper rpm.</li> <li>Check/correct venting system.</li> <li>Replace air distribution baffle.</li> <li>Replace high limit switch.</li> </ol> </li> <li>Adjust main gas pressure.<br/>Minimum for Natural Gas — 6" W.C.<br/>Minimum for Propane Gas — 11" W.C.</li> <li>Adjust outside air damper to decrease outside air percentage (if possible).</li> <li>Check/replace thermostat.</li> <li>Check unit wiring against the wiring diagram.</li> <li>Check design conditions. If unit is undersized, an additional unit(s) or other heat source must be added.</li> </ol> |
| <b>Too Much Heat</b>                     | <ol style="list-style-type: none"> <li>Thermostat malfunction.</li> <li>Gas controls do not shut-off.               <ol style="list-style-type: none"> <li>Gas controls wired incorrectly.</li> <li>Short circuit.</li> </ol> </li> <li>Main gas pressure set too high.</li> <li>Defective gas valve.</li> </ol>                                                                                                                                                                                                                                                                                                                                    | <ol style="list-style-type: none"> <li>Check/replace thermostat.</li> <li> <ol style="list-style-type: none"> <li>Check unit wiring against the wiring diagram.</li> <li>Check for loose or worn wires.</li> </ol> </li> <li>Adjust to a maximum of 14" W.C.</li> <li>Replace gas valve.</li> </ol>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |


## ① Automatic Reset High Limit

The duct furnace comes standard with an automatic reset high limit switch that will shut-off the gas should the discharge air temperature become excessive. See Figure 23.1, indicator<sup>(46)</sup> for the location of either the standard automatic or optional manual reset high limit switch. The switch should operate only when something is seriously wrong with the unit operation. Anytime the switch operates, correct the difficulty immediately or serious damage may result. If the switch cuts off the gas supply during normal operation, refer to the "Not Enough Heat" section of Service & Troubleshooting.


**Figure 50.1 - Lifting Flame Condition**

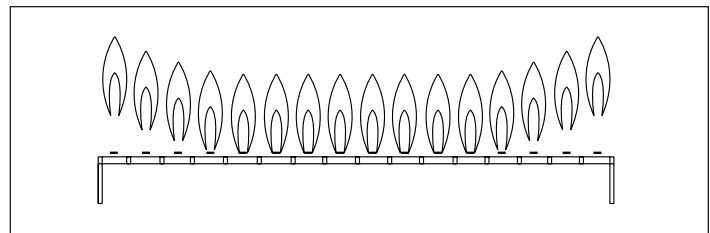

**Figure 50.2 - Floating Flame Condition**

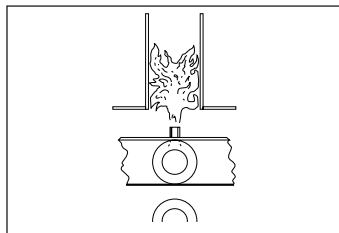

**Figure 50.3 - Flame Rollout Appearance**

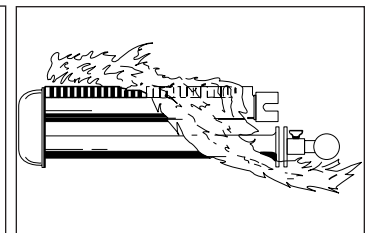

# MODEL DESIGNATIONS


## Model Identification

Indoor duct furnace/make-up air units contain ETL/ETL Canada certified indoor separated combustion duct furnace(s). This duct furnace is combined with either a blower section or a blower and cooling section to make a complete make-up air or heating/ventilating/cooling unit that is ETL/ETL Canada certified. For this reason, two identification plates are used on these models. The **Serial Plate** is used to identify the duct furnace and its components. The **Model Identification Plate** is used to identify the complete model, including blower and cooling sections.

## Ordering

When servicing, repairing or replacing parts on these units, locate the model identification plate of the unit and always give the complete Model Number and Serial Number from the model identification plate. The model identification plate is located on the door of the electrical control box (See Figure 51.1). The part numbers for some common replacement parts are listed on the serial plate (See Figure 51.2) and the model identification plate (See Figure 52.1). For a complete description of the model number, see Model Identification.

**Figure 51.1 - Serial Plate and Model Identification Plate Locations**

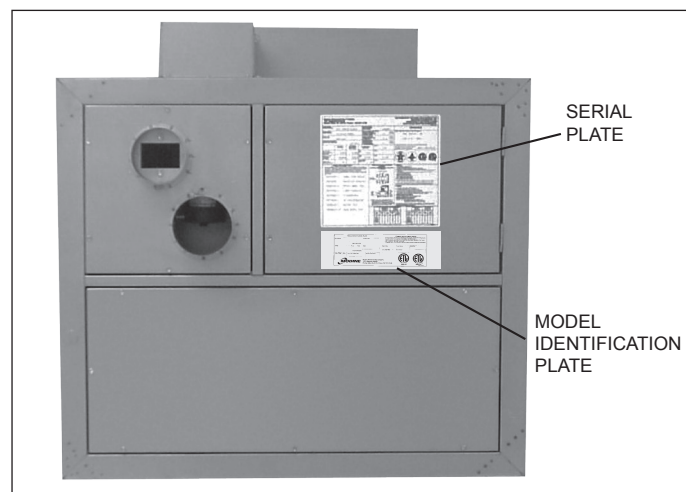


**Figure 51.2 - Serial Plate**

|                                                                                                                                                                                                                                                                                                                                                                                                                   |  |  |                                                                                                                                                                                                                                                                                  |  |  |                                                                                                                                                                                                                                 |  |                                                                                                                                                                                                                                                        |  |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|--|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|--|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|
| Modine Manufacturing Company<br>1500 DeKoven Avenue<br>Racine, WI 53403-2552; Phone: 800-828-4328                                                                                                                                                                                                                                                                                                                 |  |  | SEPARATED COMBUSTION DUCT FURNACE<br>FOR INDUSTRIAL/COMMERCIAL USE<br>CHAUDIERE À GAZ À CONDUIT SÉPARÉ<br>POUR USAGE INDUSTRIEL/COMMERCIAL                                                                                                                                       |  |  | Made in U.S.A.                                                                                                                                                                                                                  |  | <b>APPROVALS</b><br><br>DESIGN COMPLES WITH DUCT FURNACE STANDARD:<br><b>ANSI Z83.8-2013</b><br><b>CSA 2.6-2013</b>                                                |  |
| MODEL NUMBER<br>NUMERO DE MODELE <b>DFS200SFRHN13F1</b>                                                                                                                                                                                                                                                                                                                                                           |  |  | MIN. INPUT<br>DEBIT CALORIFIQUE MIN.                                                                                                                                                                                                                                             |  |  | BTU/HR<br>W                                                                                                                                                                                                                     |  | <b>VOLTS 460</b>                                                                                                                                                                                                                                       |  |
| SERIAL NUMBER<br>NUMERO DE SERIE <b>0917093615-0035</b>                                                                                                                                                                                                                                                                                                                                                           |  |  | MIN. INLET PRESS. FOR PURPOSE OF<br>INPUT ADJUSTMENT / PRESSION<br>D'ALIMENTATION EN GAZ MIN. ADMISE                                                                                                                                                                             |  |  | <b>6</b> IN W.C.<br><b>1.49</b> kPa                                                                                                                                                                                             |  | <b>PHASE 1</b>                                                                                                                                                                                                                                         |  |
| TYPE OF GAS<br>TYPE OF GAZ <b>Natural</b>                                                                                                                                                                                                                                                                                                                                                                         |  |  | MANIFOLD PRESSURE<br>PRESSION A LA TUBULURE<br>D'ALIMENTATION                                                                                                                                                                                                                    |  |  | <b>3.5</b> IN W.C.<br><b>0.87</b> kPa                                                                                                                                                                                           |  | <b>HERTZ 60</b>                                                                                                                                                                                                                                        |  |
| TEMPERATURE RISE RANGE<br>ELEVATION DE TEMPERATURE                                                                                                                                                                                                                                                                                                                                                                |  |  | MAXIMUM EXTERNAL STATIC PRESSURE<br>PRESSION STATIQUE EXTERIEUR MAXIMUM                                                                                                                                                                                                          |  |  | <b>3</b> IN W.C.<br><b>0.75</b> kPa                                                                                                                                                                                             |  | <b>AMPS 0.63</b>                                                                                                                                                                                                                                       |  |
| 20-100 °F<br>-7-38 °C                                                                                                                                                                                                                                                                                                                                                                                             |  |  | CATEGORY (HORIZ/VERT)<br>CATEGORIE (HORIZ/VERT) <b>III / III</b>                                                                                                                                                                                                                 |  |  | VENT CONNECTOR SIZE<br>CONNECTEUR DE VENTILATION <b>6</b> IN<br><b>15.24</b> CM                                                                                                                                                 |  | APPROVED FOR USE IN MASSACHUSETTS<br>APPROVED FOR USE IN CA BY THE CBC                                                                                                                                                                                 |  |
| 0 TO 2000 FT.<br>0 FT 610 M                                                                                                                                                                                                                                                                                                                                                                                       |  |  | AIR THROUGHPUT<br>DEBIT D'AIR                                                                                                                                                                                                                                                    |  |  | <b>GENERAL</b>                                                                                                                                                                                                                  |  | <b>GÉNÉRAL</b>                                                                                                                                                                                                                                         |  |
| INPUT<br>DEBIT CALORIFIQUE                                                                                                                                                                                                                                                                                                                                                                                        |  |  | MIN. CFM<br>CMH MIN                                                                                                                                                                                                                                                              |  |  | FOR INDOR INSTALLATIONS ONLY.<br>MINIMUM AMBIENT TEMPERATURE -40°F.<br>FOR INSTALLATION DOWNSTREAM OF REFRIGERATION SYSTEMS.<br>INSTALL ON THE POSITIVE PRESSURE SIDE OF AIR CIRCULATING BLOWER.                                |  | SEULEMENT POUR INSTALLATION INTÉRIEURE<br>LA TEMPERATURE MINIMUM DE L'AIR DEHORS EST -40°C.<br>POUR L'INSTALLATION QUE SUIVE LES SYSTEMES REFRIGÉRANTS.<br>INSTALLER DU CÔTÉ DE LA PRESSION POSITIVE DU VENTILATEUR.                                   |  |
| 200000 BTU/HR<br>58560 W                                                                                                                                                                                                                                                                                                                                                                                          |  |  | MAX. CFM<br>CMH MAX                                                                                                                                                                                                                                                              |  |  | FOR UNITS WITH MANUAL RESET HIGH LIMIT SWITCH, RESET BUTTON IS LOCATED IN ELECTRICAL JUNCTION BOX.<br>(IN USA) FOR INSTALLATIONS ABOVE 2000 FEET, DERATE 4 PERCENT FOR EACH 1000 FEET OF ELEVATION ABOVE SEA LEVEL.             |  | POUR APPAREILS AVEC INTERRUPTEUR REMIS MANUEL HAUT-LIMITE, REMISE EST SITUÉE DANS LA BOÎTE JUNCTION ÉLECTRIQUE. POUR REMETTRE PRESSER LE BOUTON.                                                                                                       |  |
| 162000 BTU/HR<br>46848 W                                                                                                                                                                                                                                                                                                                                                                                          |  |  | MIN VARIABLE SPEED CFM * <b>1125</b><br>MIN VARIABLE SPEED CMH * <b>31</b>                                                                                                                                                                                                       |  |  | <b>LIGHTING INSTRUCTIONS</b>                                                                                                                                                                                                    |  | <b>INSTRUCTIONS D'ALLUMAGE</b>                                                                                                                                                                                                                         |  |
| ORIFICE SIZE<br>DIM. DE L'INJECTEUR <b>23</b>                                                                                                                                                                                                                                                                                                                                                                     |  |  | COMBUSTIBLE MATERIALS AND SERVICE CLEARANCES<br>MATÉRIAUX COMBUSTIBLES ET DÉGAGEMENTS D'ENTRETIEN                                                                                                                                                                                |  |  | 1. OPEN ALL GAS VALVES. TURN ON POWER.<br>2. SET THERMOSTAT TO DESIRED SETTING.                                                                                                                                                 |  | 1. OUVRIRE TOUTES LES ROBINETS A GAZ. DONNER LE COURANT.<br>2. RÉGLER LE THERMOSTAT SUR LA POSITION DESIRÉE.                                                                                                                                           |  |
| 23                                                                                                                                                                                                                                                                                                                                                                                                                |  |  | 3 IN (7.6 CM) NON-ACCESS SIDE<br>0 IN 0 CM NON-CÔTÉ D'ACCÈS                                                                                                                                                                                                                      |  |  | REFER TO INSTALLATION AND SERVICE MANUAL FOR MORE INSTRUCTIONS<br>* FOR UNITS WITH TWO STAGE, MECHANICAL MODULATION, OR ELECTRONIC MODULATING GAS CONTROLS, A FACTORY DISCHARGE AIR CONTROLLER AND NO ROOM THERMOSTAT INCLUDED. |  | DE SERVICE POUR PLUS D' INSTRUCTIONS<br>* POUR APPAREILS AVEC DEUX PHASES MODULATION MÉCANIQUE, OU APPAREILS DE CONTRÔLE DE GAZ ÉLECTRIQUES MODULÉS, UN AIR CONTRÔLEUR DE CHARGE INSTALLÉ À LA MANUFACTURE, ET THERMOSTAT DE CHAMBRE N'EST PAS INCLUS. |  |
| COMMON REPLACEMENT PARTS<br>For parts ordering, contact the parts wholesaler or the manufacturer's representative serving your area.<br>When inquiring about parts, always provide model number, serial number, description, and part number.<br>When ordering parts, provide part number listed.<br>For service, contact your local qualified installation and service contactor or appropriate utility company. |  |  | 3 IN MINIMUM CLEARANCE TO COMBUSTIBLE MATERIAL IS FROM OUTSIDE SURFACE OF VENT<br>LA DISTANCE MINIMUM DE MATÉRIAU COMBUSTIBLE DE 7.6 CM EST DÉTERMINÉE À PARTIR DE L' EXTÉRIEUR DU CONDUIT DE VENTILATION.<br>RECOMMENDED SERVICE CLEARANCES<br>DÉGAGEMENT DE SERVICE RECOMMANDÉ |  |  | SHUT DOWN INSTRUCTIONS:<br>1. TURN OFF POWER & CLOSE ALL GAS VALVES.                                                                                                                                                            |  | INSTRUCTIONS DE FER METURE:<br>1. COUPER LE COURANT ET FERMER TOUTES LES ROBINETS A GAZ.                                                                                                                                                               |  |
| ACCESS SIDE<br>CÔTÉ D'ACCÈS                                                                                                                                                                                                                                                                                                                                                                                       |  |  | 27 IN 68.6 CM                                                                                                                                                                                                                                                                    |  |  |                                                                                                                                                                                                                                 |  |                                                                                                                                                                                                                                                        |  |
| NON-ACCESS SIDE<br>CÔTÉ NON-ACCÈS                                                                                                                                                                                                                                                                                                                                                                                 |  |  | 6 IN 15.2 CM                                                                                                                                                                                                                                                                     |  |  |                                                                                                                                                                                                                                 |  |                                                                                                                                                                                                                                                        |  |
| TOP<br>DESSUS                                                                                                                                                                                                                                                                                                                                                                                                     |  |  | 10 IN 25.4 CM                                                                                                                                                                                                                                                                    |  |  |                                                                                                                                                                                                                                 |  |                                                                                                                                                                                                                                                        |  |

# MODEL DESIGNATIONS

Figure 52.1 - Model Identification Plate

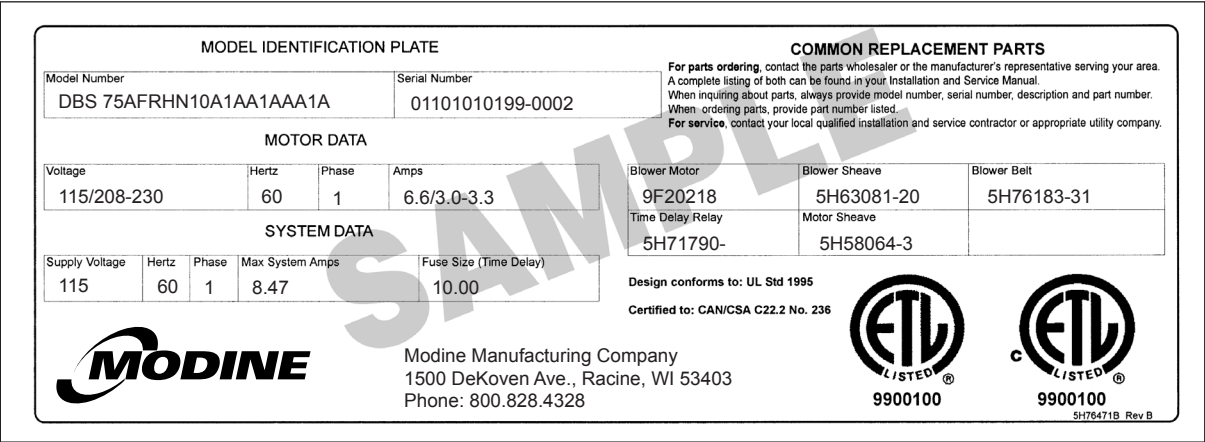

# START-UP CHECKLIST

## START-UP CHECKLIST INDIRECT GAS-FIRED HEATING EQUIPMENT

|                                                 |             |  |
|-------------------------------------------------|-------------|--|
| Job Name:                                       | Date:       |  |
| Address:                                        | Model No.:  |  |
| City & State:                                   | Order No.:  |  |
| Start-Up Check List "ALL ITEMS MUST BE CHECKED" | Serial No.: |  |

|                                                                                                                                                                                                                                                 |                                          |                                      |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------|--------------------------------------|
| 1. All shipping straps, braces, tie downs removed?                                                                                                                                                                                              | ___ Yes                                  | ___ No                               |
| 2. Unit installed level and secure?                                                                                                                                                                                                             | ___ Yes                                  | ___ No                               |
| 3. Gas burner properly located and aligned?                                                                                                                                                                                                     | ___ Yes                                  | ___ No                               |
| 4. Blower and motor alignment okay?                                                                                                                                                                                                             | ___ Yes                                  | ___ No                               |
| 5. Bearings aligned and tight on shaft/bearing supports?                                                                                                                                                                                        | ___ Yes                                  | ___ No                               |
| 6. Electrical connections checked and secure?                                                                                                                                                                                                   | ___ Yes                                  | ___ No                               |
| 7. Gas piping checked and tightened if necessary?                                                                                                                                                                                               | ___ Yes                                  | ___ No                               |
| 8. Any visible damage to unit?<br>Describe: _____<br>If damaged, was the damage repaired?                                                                                                                                                       | ___ Yes                                  | ___ No                               |
| 9. Air inlet and discharge checked for obstructions?                                                                                                                                                                                            | ___ Yes                                  | ___ No                               |
| 10. Bearings checked for proper lubrication?                                                                                                                                                                                                    | ___ Yes                                  | ___ No                               |
| 11. Filters in place and correct to direction of air flow?                                                                                                                                                                                      | ___ Yes                                  | ___ No                               |
| 12. Belt tension checked?                                                                                                                                                                                                                       | ___ Yes                                  | ___ No                               |
| 13. Electric supply to unit: _____ Volts, _____ Hz, _____ Phase                                                                                                                                                                                 |                                          |                                      |
| 14. Gas supply to unit: _____ Natural, _____ Propane                                                                                                                                                                                            |                                          |                                      |
| 15. Gas supply pressure to unit: _____ " W.C., _____ PSIG                                                                                                                                                                                       |                                          |                                      |
| 16. Inlet and/or discharge dampers operating correctly?                                                                                                                                                                                         | ___ Yes                                  | ___ No                               |
| 17. Blower rotation correct?                                                                                                                                                                                                                    | ___ Yes                                  | ___ No                               |
| 18. Blower speed: Hi Speed _____ RPM, Lo Speed _____ RPM                                                                                                                                                                                        |                                          |                                      |
| 19. Motor speed: Hi Speed _____ RPM, Lo Speed _____ RPM                                                                                                                                                                                         |                                          |                                      |
| 20. Is unit noisy? Excessive vibration?                                                                                                                                                                                                         | ___ Yes                                  | ___ No                               |
| 21. Motor voltage: L1 _____ V, L2 _____ V, L3 _____ V                                                                                                                                                                                           |                                          |                                      |
| 22. Motor amps: L1 _____ Amp, L2 _____ Amp, L3 _____ Amp                                                                                                                                                                                        |                                          |                                      |
| 23. High temperature limit control continuity checked?                                                                                                                                                                                          | ___ Yes                                  | ___ No                               |
| 24. Burner light off<br>Low Fire: Does entire burner light off?<br>Hi Fire: Burner pressure reading? _____ " W.C.<br>Is flame clean and stable?<br>Does flame modulate in response to temperature control(s)?                                   | ___ Yes<br>___ Yes<br>___ Yes<br>___ Yes | ___ No<br>___ No<br>___ No<br>___ No |
| 25. Gas input checked?<br>Input at maximum firing rate: _____ Btu/Hr<br>Input at minimum firing rate: - _____ Btu/Hr                                                                                                                            | ___ Yes                                  | ___ No                               |
| 26. Gas piping checked for and free of leaks?                                                                                                                                                                                                   | ___ Yes                                  | ___ No                               |
| 27. Has wiring been verified to match the unit wiring diagram?                                                                                                                                                                                  | ___ Yes                                  | ___ No                               |
| 28. Have all the modes of the sequence of operation been verified and tested?                                                                                                                                                                   | ___ Yes                                  | ___ No                               |
| 29. What optional and/or accessory control devices have been set?<br>Device: _____ Setting: _____ (°F/psi/Inches W.C./etc.)<br>Device: _____ Setting: _____ (°F/psi/Inches W.C./etc.)<br>Device: _____ Setting: _____ (°F/psi/Inches W.C./etc.) | ___ Yes<br>___ Yes<br>___ Yes            | ___ No<br>___ No<br>___ No           |

Customer/Owner instructed in operation and maintenance of unit? \_\_\_ Yes \_\_\_ No

Name of Person(s) Instructed: \_\_\_\_\_

Comments: \_\_\_\_\_

Start-Up Company Name: \_\_\_\_\_ Phone: \_\_\_\_\_

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

# MODEL NOMENCLATURE FOR SYSTEM UNITS

## Weatherproof Model Nomenclature

| 1  | 2  | 3 | 4 5 6 | 7  | 8  | 9  | 10  | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 21 | 22 | 23 |
|----|----|---|-------|----|----|----|-----|----|----|----|----|----|----|----|----|----|-------|----|----|
| PT | UC | V | MBH   | HE | DS | AS | ATR | GT | GV | SS | SV | TR | BB | HP | MT | SA | AC    | EC | CC |

### 1 - Product Type (PT)

D - Indoor HVAC Unit

### 2 - Unit Configuration (UC)

B - Blower Package - Furnace & Blower

C - Cooling Package - Furnace, Blower, & Cooling Cabinet

### 3 - Venting (V)

S - Separated Combustion

### 4,5,6 - Furnace Input Rating (MBH) (Except for 840 & 960)

100 - 100,000 Btu/Hr Input      500 - 500,000 Btu/Hr Input

175 - 175,000 Btu/Hr Input      600 - 600,000 Btu/Hr Input

250 - 250,000 Btu/Hr Input      840 - 1,050,000 Btu/Hr Input

400 - 400,000 Btu/Hr Input      960 - 1,200,000 Btu/Hr Input

### 7 - Heat Exchanger/Burner/Drip Pan Material (HE)

A - Aluminized Steel

S - 409 Stainless Steel Heat Exchanger/Burner

T - 409 Stainless Steel Heat Exchanger/Burner/Drip Pan

### 8 - Development Sequence Designation (DS)

F - Single Stage      M - 2-stage or Modulating

### 9 - Access Side (AS)

R - Right Hand      L - Left hand

### 10 - Air Temperature Rise (ATR)

H - High 60°-100°F

L - Low 20°-60°F

### 11- Gas Type (GT)

N - Natural with ignition controller

P - Propane with ignition controller

### 12 - Gas Valve (GV)

1 - Single Stage      6 - Electronic Modulation Slave

2 - Two Stage      7 - Electronic Modulation 0-10 Vdc

4 - Electronic Modulation      External Input

5 - Electronic Modulation Master      8 - Electronic Modulation 4-20 mA  
External Input

### 13 - Additional Safety Switches (SS)

0 - No Switches (Standard)

1 - Low Gas Pressure Switch (Premium)

2 - High Gas Pressure Switch (Premium)

3 - High and Low Gas Pressure Switch (Premium)

### 14 - Supply Voltage (SV)

A - 115/60/1      E - 230/60/3

B - 208/60/1      F - 460/60/3

C - 230/60/1      G - 575/60/3

D - 208/60/3

### 15 - Transformer (TR)

1 - 40 VA      4 - 250 VA

2 - 75 VA      0 - None

3 - 150 VA

### 16 - Blower Size & Bearing Type (BB)

A - 9-7 Spider Bearings

B - 9-7 Pillow Block Bearings

C - 9-9 Spider Bearings

D - 9-9 Pillow Block Bearings

E - 12-12 Spider Bearings

F - 12-12 Pillow Block Bearings

G - 15-15 Spider Bearings

H - 15-15 Pillow Block Bearings

I - 18-18 Spider Bearings under 15 Hp

J - 18-18 Pillow Block Bearings under 15 Hp

K - 18-18 Pillow Block Bearings for 15 Hp & up

L - 20-18 Pillow Block Bearings

### 17 - Motor Horsepower (HP)

A - 1/3 Hp

B - 1/2 Hp

C - 3/4 Hp

D - 1 Hp

E - 1-1/2 Hp

F - 2 Hp

G - 3 Hp

H - 5 Hp

I - 7-1/2 Hp

J - 10 Hp

K - 15 Hp

V - 20 Hp

L - 1/3 Hp with Motor Starter

M - 1/2 Hp with Motor Starter

N - 3/4 Hp with Motor Starter

P - 1 Hp with Motor Starter

Q - 1-1/2 Hp with Motor Starter

R - 2 Hp Hp with Motor Starter

S - 3 Hp with Motor Starter

T - 5 Hp with Motor Starter

W - 7-1/2 Hp with Motor Starter

X - 10 Hp with Motor Starter

Y - 15 Hp with Motor Starter

Z - 20 Hp with Motor Starter

### 18 - Motor Type (MT)

1 - ODP

2 - ODP - High Eff.

5 - TE

6 - TE - High Eff.

### 19 - Sheave Arrangement (SA)

A - (See Sheave Tables)

### 20,21 - Air Control (AC)

AA - RA Opening

BA - FA Opening

CA - FA & RA Openings

DA - FA Dampers w/ 2 pos motor (No RA)

EA - FA & RA Dampers w/ 2 pos motor

EQ - ASHRAE Cycle I - ("EA" with Warm-up Stat)

GA - FA & RA Mod motor w/ 0-10 Vdc External Input

GB - FA & RA Mod motor w/ 4-20 mA External Input

GC - FA & RA Mod motor w/ Minimum Position

GD - FA & RA Mod motor w/ Remote Position (On Remote Panel)

GE - FA & RA Mod motor w/ 3 pos. damper (100% RA, Variable, 100% OA)

GG - FA & RA Mod motor w/ Minimum Position & Prop. Temp Controller

GH - FA & RA Mod motor w/ Remote Position & Prop. Temp Controller

GJ - FA & RA Mod motor w/ FA Enthalpy Controller

GK - ASHRAE Cycle II - ("GG" with Warm-up Stat)

GM - ASHRAE Cycle II - ("GH" with Warm-up Stat)

HP - FA & RA Floating motor w/ Space Pressure Controller

JA - Manual FA & RA Dampers

### 22 - Evaporative Cooling (EC)

0 - None

### 23 - Cooling Coil (CC)

0 - None

1 - Factory Installed Coil

**PAGE INTENTIONALLY LEFT BLANK**

# COMMERCIAL WARRANTY

Seller warrants its products to be free from defects in material and workmanship, EXCLUSIVE, HOWEVER, of failures attributable to the use of materials substituted under emergency conditions for materials normally employed. This warranty covers replacement of any parts furnished from the factory of Seller, but does not cover labor of any kind and materials not furnished by Seller, or any charges for any such labor or materials, whether such labor, materials or charges thereon are due to replacement of parts, adjustments, repairs, or any other work done. This warranty does not apply to any equipment which shall have been repaired or altered outside the factory of Seller in any way so as, in the judgment of Seller, to affect its stability, nor which has been subjected to misuse, negligence, or operating conditions in excess of those for which such equipment was designed. This warranty does not cover the effects of physical or chemical properties of water or steam or other liquids or gases used in the equipment.

BUYER AGREES THAT SELLER'S WARRANTY OF ITS PRODUCTS TO BE FREE FROM DEFECT IN MATERIAL AND WORKMANSHIP, AS LIMITED HEREIN, SHALL BE IN LIEU OF AND EXCLUSIVE OF ALL OTHER WARRANTIES, EITHER EXPRESS OR IMPLIED, WHETHER ARISING FROM LAW, COURSE OF DEALING, USAGE OF TRADE, OR OTHERWISE, **THERE ARE NO OTHER WARRANTIES, INCLUDING WARRANTY OF MERCHANTABILITY OR FITNESS FOR PURPOSE, WHICH EXTEND BEYOND THE PRODUCT DESCRIPTION CONFIRMED BY BUYER AND SELLER AS OF THE DATE OF FINAL AGREEMENT.**

This warranty is void if the input to the product exceeds the rated input as indicated on the product serial plate by more than 5% on gas-fired and oil-fired units, or if the product in the judgment of SELLER has been installed in a corrosive atmosphere, or subjected to corrosive fluids or gases, been subjected to misuse, negligence, accident, excessive thermal shock, excessive humidity, physical damage, impact, abrasion, unauthorized alterations, or operation contrary to SELLER'S printed instructions, or if the serial number has been altered, defaced or removed.

BUYER AGREES THAT IN NO EVENT WILL SELLER BE LIABLE FOR COSTS OF PROCESSING, LOST PROFITS, INJURY TO GOODWILL, OR ANY OTHER CONSEQUENTIAL OR INCIDENTAL DAMAGES OF ANY KIND RESULTING FROM THE ORDER OR USE OF ITS PRODUCT, WHETHER ARISING FROM BREACH OF WARRANTY, NONCONFORMITY TO ORDERED SPECIFICATIONS, DELAY IN DELIVERY, OR ANY LOSS SUSTAINED BY THE BUYER.

BUYER'S REMEDY FOR BREACH OF WARRANTY, EXCLUSIVE OF ALL OTHER REMEDIES PROVIDED BY LAW, IS LIMITED TO REPAIR OR REPLACEMENT AT THE FACTORY OF SELLER, ANY COMPONENT WHICH SHALL, WITHIN THE APPLICABLE WARRANTY PERIOD DEFINED HEREIN AND UPON PRIOR WRITTEN APPROVAL, BE RETURNED TO SELLER WITH TRANSPORTATION CHARGES PREPAID AND WHICH THE EXAMINATION OF SELLER SHALL DISCLOSE TO HAVE BEEN DEFECTIVE; EXCEPT THAT WHEN THE PRODUCT IS TO BE USED BY BUYER AS A COMPONENT PART OF EQUIPMENT MANUFACTURED BY BUYER, BUYER'S REMEDY FOR BREACH, AS LIMITED HEREIN, SHALL BE LIMITED TO ONE YEAR FROM DATE OF SHIPMENT FROM SELLER. FOR GAS-FIRED PRODUCTS INSTALLED IN HIGH HUMIDITY APPLICATIONS AND UTILIZING STAINLESS STEEL HEAT EXCHANGERS, BUYER'S REMEDY FOR BREACH, AS LIMITED HEREIN, SHALL BE LIMITED TO TEN YEARS FROM DATE OF SHIPMENT FROM SELLER.

These warranties are issued only to the original owner-user and cannot be transferred or assigned. No provision is made in these warranties for any labor allowance or field labor participation. Seller will not honor any expenses incurred in its behalf with regard to repairs to any of Seller's products. No credit shall be issued for any defective part returned without proper written authorization (including, but not limited to, model number, serial number, date of failure, etc.) and freight prepaid.

## OPTIONAL SUPPLEMENTAL WARRANTY

Provided a supplemental warranty has been purchased, Seller extends the warranty herein for an additional four (4) years on certain compressors. Provided a supplemental warranty has been purchased, Seller extends the warranty herein for an additional four (4) years or nine (9) years on certain heat exchangers.

## EXCLUSION OF CONSUMABLES & CONDITIONS BEYOND SELLER'S CONTROL

This warranty shall not be applicable to any of the following items: refrigerant gas, belts, filters, fuses and other items consumed or worn out by normal wear and tear or conditions beyond Seller's control, including (without limitation as to generality) polluted or contaminated or foreign matter contained in the air or water utilized for heat exchanger (condenser) cooling or if the failure of the part is caused by improper air or water supply, or improper or incorrect sizing of power supply.

| <u>Component</u>                                                                                                                                                                                                                                                                                                                                                      | <b>"APPLICABLE WARRANTY PERIOD"</b>                                                                                                                                                                                                                                                                                  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Applicable Models                                                                                                                                                                                                                                                                                                                                                     |                                                                                                                                                                                                                                                                                                                      |
| <u>Heat Exchangers</u><br>Gas-Fired Units except MPR Models                                                                                                                                                                                                                                                                                                           | TEN YEARS FROM DATE OF FIRST BENEFICIAL USE BY BUYER OR ANY OTHER USER, WITHIN TEN YEARS FROM DATE OF RESALE BY BUYER OR ANY OTHER USER, WITHIN TEN YEARS FROM DATE OF RESALE BY BUYER IN ANY UNCHANGED CONDITION, OR WITHIN ONE HUNDRED TWENTY-SIX MONTHS FROM DATE OF SHIPMENT FROM SELLER, WHICHEVER OCCURS FIRST |
| <u>Heat Exchangers</u><br>Low Intensity Infrared Units , Gas Heat option on MPR models<br><u>Compressors</u><br>Condensing Units for Cassettes                                                                                                                                                                                                                        | FIVE YEARS FROM DATE OF FIRST BENEFICIAL USE BY BUYER OR ANY OTHER USER, WITHIN FIVE YEARS FROM DATE OF RESALE BY BUYER OR ANY OTHER USER, WITHIN FIVE YEARS FROM DATE OF RESALE BY BUYER IN ANY UNCHANGED CONDITION, OR WITHIN SIXTY-SIX MONTHS FROM DATE OF SHIPMENT FROM SELLER, WHICHEVER OCCURS FIRST           |
| <u>Burners</u><br>Low Intensity Infrared Units<br><u>Compressors</u><br>MPR Models<br><u>Other</u><br>Components excluding Heat Exchangers, Coils, Condensers, Burners, Sheet Metal                                                                                                                                                                                   | TWO YEARS FROM DATE OF FIRST BENEFICIAL USE BY BUYER OR ANY OTHER USER, WITHIN TWO YEARS FROM DATE OF RESALE BY BUYER IN ANY UNCHANGED CONDITION, OR WITHIN THIRTY MONTHS FROM DATE OF SHIPMENT FROM SELLER, WHICHEVER OCCURS FIRST                                                                                  |
| <u>Heat Exchangers/Coils</u><br>Indoor and Outdoor Duct Furnaces and System Units, Steam/Hot Water Units, Oil-Fired Units, Electric Units, Cassettes, Vertical Unit Ventilators, Geothermal Units<br><u>Compressors</u><br>Vertical Unit Ventilators, Geothermal Units<br><u>Burners</u><br>High Intensity Infrared Units<br><u>Sheet Metal Parts</u><br>All Products | ONE YEAR FROM DATE OF FIRST BENEFICIAL USE BY BUYER OR ANY OTHER USER, WITHIN ONE YEAR FROM DATE OF RESALE BY BUYER IN ANY UNCHANGED CONDITION, OR WITHIN EIGHTEEN MONTHS FROM DATE OF SHIPMENT FROM SELLER, WHICHEVER OCCURS FIRST                                                                                  |

As Modine Manufacturing Company has a continuous product improvement program, it reserves the right to change design and specifications without notice.

